
RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

NOTE: NO WORK IN HATCHED AREA.
ALL PROTECTION TO REMAIN AS-IS

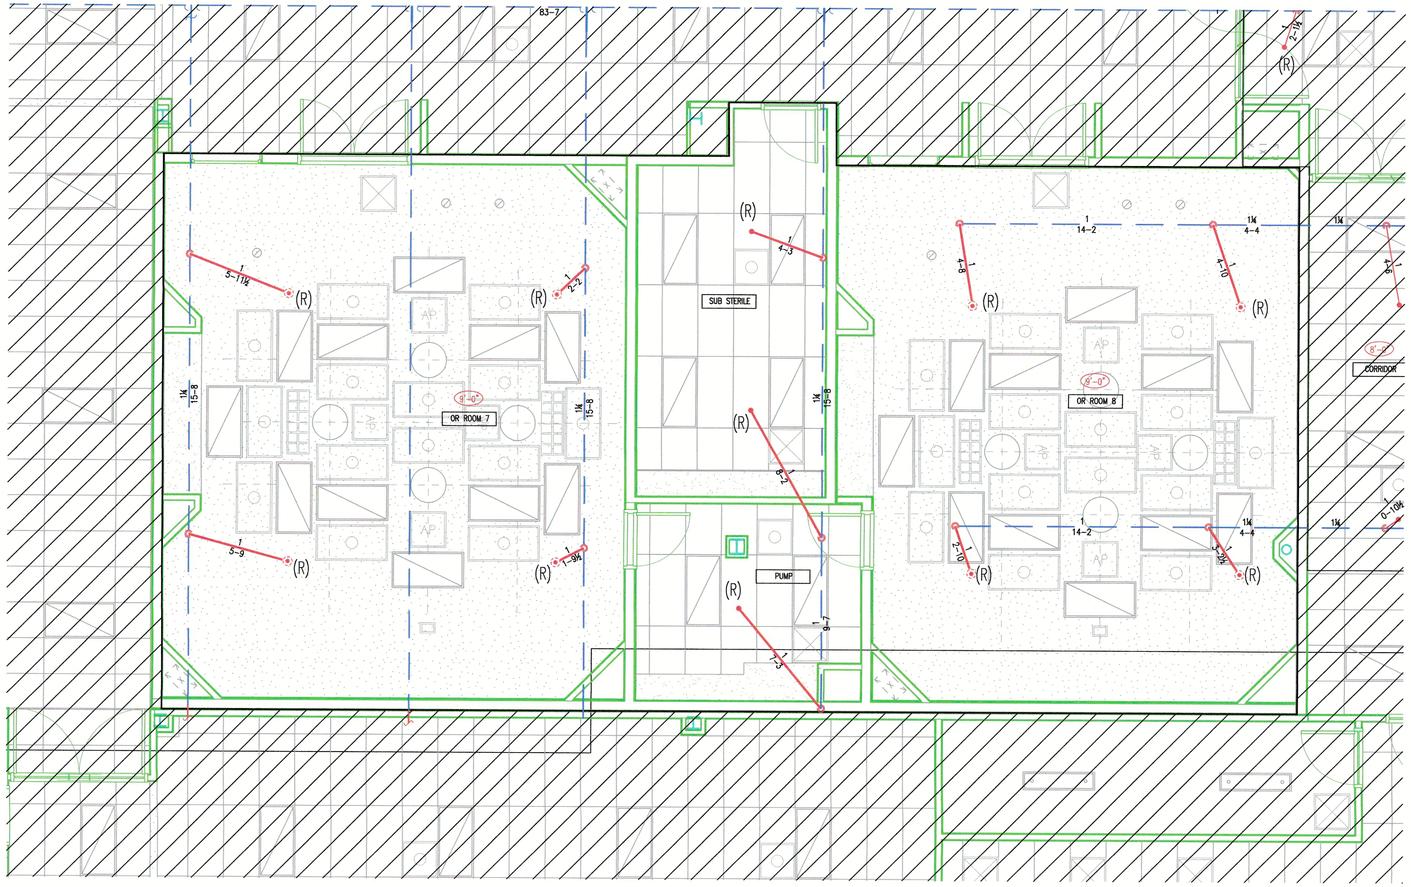

PHASE III (AREA 3) FIRE SPRINKLER PLAN
1/4" = 1'-0"

N


HANGER SPACING LEGEND	PER NFPA 13 TABLE 9.2.2.1 (a)									
NOMINAL PIPE SIZE	¾"	1"	1¼"	1½"	2"	2½"	3"	4"	6"	8"
STEEL PIPE: SCH 10/40 DYNAFLOW, EDDYFLOW	N/A	12-0	12-0	15-0	15-0	15-0	15-0	15-0	15-0	15-0
THREADED LIGHTWALL	N/A	12-0	12-0	12-0	12-0	12-0	N/A	N/A	N/A	N/A

UNSUPPORTED LENGTHS-PER NFPA 2013 9.2.3.4
MAXIMUM UNSUPPORTED LENGTH BETWEEN THE LAST HANGER ON A BRANCH LINE AND THE SPRINKLER, FOR PRESSURES UNDER 100 PSI:


1" STEEL PIPE 36"
1¼" STEEL PIPE 48"
1½" & LARGER STEEL PIPE 60"

WHEN THESE LIMITS ARE EXCEEDED THE PIPE SHALL BE EXTENDED BEYOND THE END SPRINKLER AND SHALL BE SUPPORTED BY AN ADDITIONAL HANGER.

THE CUMULATIVE HORIZONTAL LENGTH OF AN ARMOVER TO A SPRINKLER, SPRINKLER DROP OR SPRINKLER SPRIG SHALL NOT EXCEED 24" FOR STEEL PIPE.

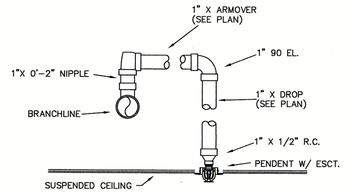

RETURN BEND ASSEMBLY



DROP-IN CONC. ANCHOR HANGER

PIPE HANGER NOTE

MAXIMUM HANGER SPACING FOR 1½" THRU 3" PIPE IS 15'-Ø"
MAXIMUM HANGER SPACING FOR 1" THRU 1¼" PIPE IS 12'-Ø"
PRESSURE EXCEEDS 100 PSI THEREFORE HOLD-DOWN CLIPS ARE REQUIRED ON THE END HANGER TO PREVENT UPWARD MOVEMENT ALSO ANY ARMOVER THAT EXCEEDS 12" IN LENGTH WILL REQUIREA PIPE HANGER AND THAT HANGER MUST HAVE A HOLD-DOWN CLIP.

GENERAL NOTES


1. REMOVE EXISTING PENDENTS AND INSTALL UPRIGHT PROTECTION THROUGHOUT THE DEMO PROCESS
2. ADD AND RELOCATE FIRE SPRINKLERS FROM EXISTING SYSTEM PER NFPA #13 REQUIREMENTS FOR LIGHT AND ORDINARY GROUP 1 HAZARD OCCUPANCY
3. MAXIMUM 225 SQ. FT. FOR LIGHT HAZARD AND 130 SQ. FT. FOR OHII.
4. THE FIRE SPRINKLER SYSTEM MUST REMAIN IN SERVICE AT ALL TIMES, EXCEPT WHEN WE HAVE AN APPROVED SHUT DOWN REQUEST
5. FIRE SPRINKLER FITTER MUST REMAIN ON JOB SITE AT ALL TIMES WHEN SYSTEM IS OUT OF SERVICE.
6. INSTALL THE FOLLOWING PIPE TYPE AND FITTINGS
   LINES (1" THRU 2" PIPE) - SCHEDULE 40 PIPE WITH DUCTILE IRON THREADED FITTINGS
7. SEAL ALL PIPE PENETRATIONS THRU FIRE RATED WALLS WITH HILTI'S FS-ONE FIRE STOP SEALENT.

LEGEND

R=RELOCATE - 11
NEW PIPE ———
EXISTING PIPE- - - - - -

City of Aurora Building Division
Project: *MCOA Phase III - Sprinkler*
Address: *1501 S POTOMAC ST AREA B*
Occupancy Group: *IBC I-2 / 1500 SF*
Construction Type: *IBC I-A, SPK*
RSN: *1119301*
Permit: *2016 1116232 000 00 CT*

CT
City of Aurora Building Division
Reviewed for Code Compliance
Approved as Noted: *Neil Wiegert*
Date: *Jun 10, 2016*
2009 INTERNATIONAL CODES & 2011 NEC

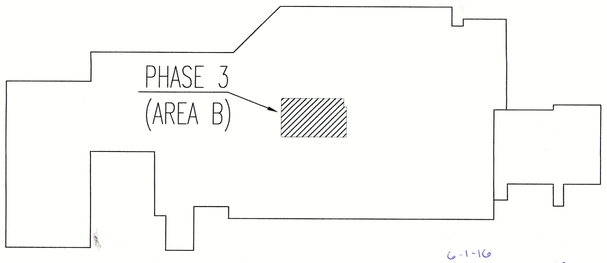

KEY PLAN N.T.S.

6-1-16
TRACY SKINNER
NICET #97029 - LEVEL III

2 1 0 4 8
SCALE 1/4"=1'-0"

1ST FLOOR PHASE III AREA B

Frontier Fire
2617 W Holden Pl, Denver CO 80204 | Phn 303-629-0221, Fax 303-623-7830
www.frontierfireprotection.com

Fire Sprinkler Plan Symbols	
Symbol	Description
○	Hydraulic Reference Points
[xx Bls]	Elev. Below Top of Steel
[xx-x]	Elev. Above Finished Floor
(TOS 20'-10")	Elev. of Top of Steel
(8'-0)	Ceiling Height
—/—	Denotes Hanger Location
O RN 1"x 6'-0	Rise up or down
— —o— —	Existing pipe and outlet
— —●R	New Head Location

Number of Sprinklers

Total This Sheet							Total This Job
Symbol	Degree	Description	SIN	K-Fact.	Thread	Quantity	
●	155°	CHROME RECESSED PENDENT QR.	VK302	5.6	1/2"	3	
◉	155°	WHITE CONCEALED Q.R. W/GASKET PLATES	VK462	5.6	1/2"	8	

Drawing Title	FIRE SPRINKLER PLAN	Revisions:	By:	Date:
Contract No.	15-3910			
File Name:	15-3910			
Drawn By	SHANE PARRIOTT			
Scale	AS SHOWN			
Date	06-01-2016			
Approval By	AHJ			

Job:
MEDICAL CENTER OF AURORA
1501 S. POTOMAC ST.
AURORA, CO. 80012

Contractor:
FRONTIER FIRE
2617 W. HOLDEN PLACE
DENVER, CO 80204

FP 1 OF 1
PLOT DATE 06-01-2016

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

CITY OF AURORA STANDARD FIRE SPRINKLER NOTES

- OWNER IS RESPONSIBLE FOR PROVIDING HEAT, ABOVE 40 DEGREES Fahrenheit, ADEQUATE ENOUGH TO PREVENT FREEZING OF THE SPRINKLER PIPING.
- ALL VALVES CONTROLLING THE WATER SUPPLY TO 20 OR MORE SPRINKLER HEADS MUST BE SUPERVISED. AT THE TIME OF FINAL INSPECTION, FIRE SAFETY SYSTEMS MUST BE SUPERVISED BY AN APPROVED UL-LISTED MONITORING AGENCY.
- THE CONTRACTOR (OR DESIGNEE) MUST PROVIDE ALL NESSESSARY TESTING EQUIPEMENT AND PERFORM ALL TESTING REQUIRED BY THE LIFE SAFETY INSPECTOR.
- ALL NEW OR EXISTING FIRE ALARM SYSTEMS MUST BE INTERCONNECTED WITH THE FLOW SWITCH OF THE FIRE SPRINKLER SYSTEMS OUTSIDE HORN AND STROBE.
- INSTALLATION OF INTERIOR ALARMS ACTIVATED BY THE FIRE SPRINKLER WATER FLOW WILL BE REQUIRED PER 2009 IFC, 903.4.2. APPROVED AUDIBLE DEVICES SHALL BE CONNECTED TO EVERY AUTOMATIC FIRE SPRINKLER SYSTEM.
- IMPORTANT: IN THE EVENT THAT A CONCEALED SPACE IS NOT SHOWN ON THE PLAN SUBMITTAL AND IS DISCOVERED IN THE FIELD, THE INSTALLING CONTRACTOR MUST COMPLY WITH 2007 NFPA 13, SECTION 8.15.1.
- ALL WATER SUPPLY VALVES AND WATER FLOW SWITCHES SHALL BE ELECTRICALLY SUPERVISED, IFC 2007, 903.4.
- ELECTRICAL EXTERIOR HORN AND STROBE SHALL BE LISTED FOR OUTDOOR USE, IFC 903.4.2. OUTSIDE HORN AND STROBE WILL ACTIVATE UPON BOTH GENERAL ALARM AND FLOW SWITCH ACTIVATION. WHEN FIRE ALARM PANEL IS SILENCED, THE INTERIOR AND EXTERIOR STROBES WILL CONTINUE UNTIL FIRE ALARM PANEL IS RESET.
- ALL CONTROL VALVE(S) WITHIN THE RISER ROOM MUST BE ACCESSIBLE, 2007 NFPA SECTION 8.16.1.1.7.
- PRESSURE GAUGES ARE REQUIRED ON THE SYSTEM SIDE OF THE MAIN VALVE AND ON THE SUPPLY SIDE OF THE BACKFLOW PREVENTOR.
- BOTH NEW AND EXISTING FIRE SPRINKLER SYSTEMS MUST EQUIPPED WITH APPROVED KNOX CAPS.
- THE FIRE DEPARTMENT CONNECTION(S) MUST BE LOCATED IN THE AREA SHOWN ON THE APPROVED SITE PLAN.
- THE FIRE DEPARTMENT CONNECTION MUST BE LOCATED NOT LESS THAN 18 IN. AND NOT MORE THAN 4 FT ABOVE THE LEVEL OF THE ADJACENT GRADE OR ACCESS LEVEL. 2007 NFPA 13, SECTION A.8.17.2.
- ALL FIRE LINES AND COMMERCIAL WATER SERVICE LINES WILL REQUIRE REDUCED PRESSURE BACK FLOW PREVENTER OR DOUBLE CHECK VALVES AS REQUIRED BY THE CITY OF AURORA UTILITY DEPARTMENT. CONTACT THE BUILDING DIVISION AT 303-739-7420 TO SCHEDULE FLOW TEST FOR PRIVATE FIRE LINES PRIOR TO THE ISSUANCE OF A CERTIFICATE OF OCCUPANCY.
- ALL FIRE SERVICE LINES SHALL BE INSTALLED, IN THEIR ENTIRETY, BY A STATE LICENSED CONTRACTOR. LICENSING CAN BE OBTAINED FROM THE COLORADO DIVISION OF FIRE SAFETY LOCATED AT 690 KIPLING STREET, LAKEWOOD, CO 80215 (303-239-4600). IN ADDITION, APPROVED CIVIL PLANS FROM THE CITY OF AURORA WATER DEPARTMENT ARE REQUIRED FOR ALL FIRE SERVICE LINE CONNECTIONS. THE CONTRACTOR MUST PRESENT LICENSE AND APPROVED CIVIL PLANS TO THE PUBLIC IMPROVEMENTS DIVISION OF THE PUBLIC WORKS DEPARTMENT BEFORE PERMITS ARE ISSUED. ONCE THE PERMIT HAS BEEN ISSUED CONTACT THE CITY OF AURORA BUILDING CODES DIVISION AT 303-739-7420 TO SCHEDULE A FLUSH INSPECTION WITH A LIFE SAFETY INSPECTOR. FIRE SERVICE LINES SHALL BE RESTRAINED FOR THEIR ENTIRE LENGTH. REFER TO THE CITY OF AURORA PUBLIC UTILITY IMPROVEMENTS RULES AND REGULATIONS REGARDING STANDARDS AND SPECIFICATIONS, SECTION 15.00.

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

2015 2013

NFPA 13 Sprinkler System Acceptance Inspection

~~2009~~ IFC and ~~2007~~ NFPA 13

Date of Inspection: _____ Permit Number: 2016 1116232 000 00 CT

Business/Building Name: MCOA Renovation Phase III Area B Address of Project: 1501 S POTOMAC ST AREA B

Contractor: FRONTIER FIRE Contractor's Phone: (303) 629-0221

Reference numbers following worksheet statements represent an NFPA code section unless otherwise specified.

	Pass	Fail	NA	
1.	____	____	____	Approved drawing and above-ground piping certification documents are on site.
2.	____	____	____	Underground supply testing and flushing is witnessed and underground piping certification is provided. Flushing requirements shall be 880 GPM for 6 in., 1,560 GPM for 8 in., 2,440 GPM for 10 in., 3,520 for 12 in., have them pitot and calculate that flow and confirm the velocity is at least 10 ft/sec.
3.	____	____	____	Hydrostatic test: wet system, 200 PSI for 2 hours and it should include the FDC piping.
4.	____	____	____	Hydrostatic test: dry and double interlock system: 200 PSI for 2 hours and a 40 PSI air leak test for 24 hours with less than 1.5 PSI loss, 24.2.2.
5.	____	____	____	Back flow prevention device is installed in accordance with the approved set of plans and forward flow tested, 24.2.5.
6.	____	____	____	Systems subject to pressures greater than 150 PSI shall be hydrostatically tested at 50 PSI above system working pressure, 24.2.1.2.
7.	____	____	____	Operational test of the dry-pipe valve is performed and the quick opening device (500+ gallon systems) is tested, 750+ gallon system must trip within 60 seconds.
8.	____	____	____	Pressure reducing valves are tested at maximum and normal inlet pressures or as specified by the manufacturer, the supply pressure is recorded on the certificate, a relief valve is on the discharge side and gauges on each side of the valve, 24.2.4.
Riser				
9.	____	____	____	The main drain is routed to the exterior with a turned down elbow or an inside drain capable of handling the water flow. A flow test is performed. The main drain pipe is ¾ in. or greater for a riser up to 2 in., 1¼ in. or greater for a riser 2½ in. to 3½ in., 2 in. for a riser 4 in. or greater, 8.16.2.4.2, 24.2.3.4.
10.	____	____	____	Water control valves and flow switches are electronically supervised and tested, IFC 903.4.
11.	____	____	____	Paddle-type water flow is not allowed for dry, preaction or deluge systems.
12.	____	____	____	24-hour monitoring service agency or remote supervising station or proprietary supervising station received signals, 903.4.1.
13.	____	____	____	Water flow alarm is tested and initiates an alarm within 5 minutes, located in accordance with the approved set of plans, and it is properly signed, 24.2.3.1.
14.	____	____	____	High-rise: each floor system shall have water flow device with a test connection and be connected to the fire alarm system.
15.	____	____	____	Permanent system identification signs for each control valve and what portion of the building each valve serves is provided, 6.7.4.
16.	____	____	____	A permanent hydraulic nameplate is attached to the riser, 24.5.1. A general information sign that indicates the design capabilities and limitations of the automatic sprinkler system shall be provided at each system riser, antifreeze loop and auxiliary system control valve. The sign shall contain the required information specified in Sections 24.6.2, 24.6.1
17.	____	____	____	Riser is supported by hanger or attachment, for multistory at the lowest level, each alternate level, above and below offsets, and at the top, 9.2.5.4.
18.	____	____	____	Gauges are above and below riser check valve, 7.1.1.2.
FDC				
19.	____	____	____	FDC capped and permanently signed with system type, the required pressure to support the system if the pressure demand is equal to or greater than 150 PSI, and area or building served, 8.17.2.4.7.
20.	____	____	____	FDC has check valve and drip valve, 8.17.2.5.
21.	____	____	____	FDC for wet single riser system connects to the system side, 8.17.2.4.
22.	____	____	____	FDC for wet multiriser system connects after the main system shut off valve, 8.17.2.4.

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

23. ____ |_____| ____ FDC for dry system connects between the indicating and dry-pipe valves.
24. ____ |_____| ____ FDC pipe complies with the size indicated on the plans, 18 in. to 48 in. above grade, and properly supported, 8.17.2, A.8.17.2. Ensure that the minimum clearance to the sides, front, and height is provided in accordance with IFC 912.3.2.

Sprinklers

25. ____ |_____| ____ Spare sprinklers – Provide at least 6 spare sprinklers for systems designed with 300 or less sprinklers; 12 spare sprinklers for systems designed using 300 to 1,000 sprinklers, and 24 spare sprinklers for systems designed using more than 1,000 sprinklers, 6.2.9.
26. ____ |_____| ____ Replacement wrench(s) are provided, 6.2.9.
27. ____ |_____| ____ Sprinklers shall be a minimum of 4 in. from the wall and be properly spaced, 8.6.3.3.
28. ____ |_____| ____ Sprinkler heads have a guard if subject to damage.
29. ____ |_____| ____ Sprinkler heads are not painted or covered.
30. ____ |_____| ____ ESFR upright deflectors are a minimum 7 in. above the top of the pipe, 8.12.5.3.2.1.
31. ____ |_____| ____ EFSR sprinklers are at least 1 ft. horizontally from the bottom edge of bar joist or open truss and at least 3 ft. above the top of the storage level, 8.12.6.
32. ____ |_____| ____ Proper type and temperature sprinklers are used and match plans.
33. ____ |_____| ____ Escutcheon plates are installed.
34. ____ |_____| ____ Sprinklers are not obstructed, 8.5.5-8.12.5.

Pipe: Hangers, Seismic, and Penetrations

35. ____ |_____| ____ Piping layout and size are the same as on the approved set of plans.
36. ____ |_____| ____ Pipe penetrations have proper clearance 2 in. for pipe 1 in. to 3½ in., 4 in. for pipe 4 in. and larger, 9.3.
37. ____ |_____| ____ When flexible couplings are used in risers, above and below floor penetrations of multistory structures, near penetrations of concrete or masonry walls, and near expansion joints, their location is in accordance with Sections 9.3.2.1– 9.3.2.4
38. ____ |_____| ____ Minimum clearance around pipes penetrating construction elements listed in 9.3.4.1 is in accordance with 9.3.4.2 unless the requirements of 9.3.4.3 – 9.3.4.7 are met.
39. ____ |_____| ____ A seismic separation assembly is provided at building seismic joints, 9.3.3.
40. ____ |_____| ____ Lateral sway bracing is provided and spaced in accordance with the approved set of plans for all mains, cross mains, and branch lines 2½ in. and larger.
41. ____ |_____| ____ Longitudinal sway bracing is provided and spaced in accordance with the approved set of plans for feed mains and cross mains, 9.3.5.4.
42. ____ |_____| ____ A 4-way sway brace is provided at least every 25 ft. and at the top of each riser, 9.3.5.5.
43. ____ |_____| ____ Longitudinal and lateral bracing is provided for each run of pipe between the change of pipe direction unless the pipe run is less than 12 ft., 9.3.5.11.3.
44. ____ |_____| ____ Riser nipples greater than 4 ft. are restrained from lateral movement, 9.3.6.6.
45. ____ |_____| ____ Seismic bracing wire, wrap-around u-hooks, or lateral sway bracing shall not exceed 30 ft. spacing and is used to restrict sprinkler movement that could impact the building, equipment or finishing materials, 9.3.6.
46. ____ |_____| ____ Restraining straps are on all C-clamps and the strap is bolted through if there is not a lip on the beam, 9.3.7.1.
47. ____ |_____| ____ Branch lines have one hanger per section of pipe, 9.2.3.2.
48. ____ |_____| ____ Mains and cross mains have one hanger between each branch line and at the end of the main, 9.2.4.
49. ____ |_____| ____ The maximum distance between the end sprinkler and hanger is 36 in. for 1 in. pipe, 48 in. for 1¼ in., and 60 in. for 1½ in. pipe and greater, 9.2.3.4.
50. ____ |_____| ____ Risers in multistory buildings have supports at the lowest level, at each alternate level, below offsets, and at the top, 9.2.5.4.
51. ____ |_____| ____ Hangers are not within 3 in. of upright sprinklers, 9.2.3.3.

Dry and Preaction Systems

52. ____ |_____| ____ Dry system compressor, fill line, pressure gauges, check valve and shutoff valve and relief valve are installed in accordance with the approved set of plans and 7.2.6.2. The system must pressurize the sprinkler pipe within 30 minutes, 7.2.6.2.2.
53. ____ |_____| ____ Preaction and deluge systems operate upon activation of the detection system.
54. ____ |_____| ____ Riser room is heated, 7.2.5.
55. ____ |_____| ____ Air pressure is set according to the manufacturer's instructions or at least 20 PSI above the trip pressure, 16.2.2.

56. ____|____ | ____ Dry and preaction systems are supervised and water reaches furthest point within the time period provided on the plans or water delivery calculations in accordance with Table 7.2.3.6.1.

57. ____|____ | ____ Preaction systems exceeding 20 sprinklers automatically supervise (constant monitoring) pipe pressure (maintain at least 7 PSI) and detection devices, 7.3.2.4.

Additional Comments:

Inspection Date: _____ Approved or Disapproved FD Inspector: _____

Inspection Date: _____ Approved or Disapproved FD Inspector: _____

Inspection Date: _____ Approved or Disapproved FD Inspector: _____

NFPA 13 Sprinkler Installation Certification

Permit #: 2016 1116232 000 00 CT Date: _____

	Property Protected	System Installer	System Supplier
Business Name:	MCOA Renovation	FRONTIER FIRE	
Address:	Phase III Area B		
Representative:			
Telephone:			

Location of Plans: _____

Location of Owner's Manual: _____

1. Certification of System Installation: Complete this section after system is installed, but prior to conducting operational acceptance tests.

This system installation was inspected and found to comply with the installation requirements of:

_____ NFPA 13
_____ IFC and IBC
_____ Manufacturer's Instructions
_____ Other (specify: FM, UL, etc.) _____

Print Name: _____

Signed: _____ Date: _____

Organization: _____

2. Certification of System Operation: All operational features and functions of this system were tested and found to be operating properly in accordance with the requirements of:

_____ NFPA 13
_____ IFC and IBC
_____ Manufacturer's Instructions
_____ Other (specify) _____

Print Name: _____

Signed: _____ Date: _____

Organization: _____

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

Frontier Fire

AUTOMATIC FIRE SPRINKLER SYSTEM

EQUIPMENT SUBMITTALS

FOR

MCOA RENOVATION

1501 S POTOMAC STREET

AURORA, COLORADO 80012

VIKING®


TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE PENDENT SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

1. DESCRIPTION

Viking Microfast® and MicrofastHP® Quick Response Pendent Sprinklers are small, thermosensitive, glass-bulb spray sprinklers available in several different finishes and temperature ratings and K-Factors to meet design requirements. The special Polyester,Polytetrafluoroethylene (PTFE), and Electroless Nickel PTFE (ENT) coatings can be used in decorative applications where colors are desired. In addition, these coatings have been investigated for installation in corrosive atmospheres and are listed/approved as corrosion resistant as indicated in the Approval Charts. (Note: **FM Global approves ENT finish as corrosion resistant.** FM Global has no approval classification for PTFE and Polyester coatings as corrosion resistant.)

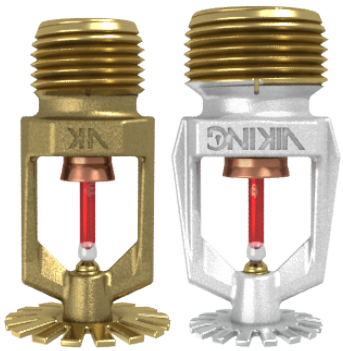

PN 12979 **PN 06666B**

2. LISTINGS AND APPROVALS

cULus Listed: Category VNIV
FM Approved: Classes 2001, 2002, 2015, and 2017
NYC Approved: Calendar Number 219-76-SA and MEA 89-92-E, Volume 16
ABS Certified: Certificate 04-HS407984C-PDA
VdS Approved: Certificates G4040095, G4040097, G4060056, G4060057, G4880045, G4930038, and G4980021
LPC Approved: Ref. Nos. 096e/03 and 096e/04
CE Certified: Standard EN 12259-1, EC-certificates of conformity 0786-CPD-40130, 0786-CPD-40170 and 0786-CPD-40279, 0832-CPD-2001, and 0832-CPD-2003
MED Certified: Standard EN 12259-1, EC-certificate of conformity 0832-MED-1003 and 0832-MED-1008
NOTE: Other International approval certificates are available upon request.

Refer to Approval Chart 1 and Design Criteria on page 41d for cULus Listing requirements and refer to Approval Chart 2 and Design Criteria on page 41f for FM Approval requirements that must be followed.

3. TECHNICAL DATA

Specifications:
Available since 1987.
Minimum Operating Pressure: 7 psi (0.5 bar)*
Maximum Working Pressure: Sprinklers 12282 and 12290 are rated for use with water working pressures ranging from the minimum 7 psi (0.5 bar) up to 250 psi (17 bar) for high-pressure systems. High-pressure (HP) sprinklers can be identified by locating "250" stamped on the deflector. All other Part Nos. not mentioned above are rated to a maximum 175 psi (12 bar) wwp.
Factory tested hydrostatically to 500 psi (34.5 bar)
Thread size: Refer to the Approval Charts
Nominal K-Factor: Refer to the Approval Charts
Glass-bulb fluid temperature rated to -65 °F (-55 °C)
Overall Length: Refer to the Approval Charts

Viking Technical Data may be found on The Viking Corporation's Web site at http://www.vikinggroupinc.com. The Web site may include a more recent edition of this Technical Data Page.

*cULus Listing, FM Approval, and NFPA 13 installs require a minimum of 7 psi (0.5 bar). The minimum operating pressure for LPCB and CE Approvals ONLY is 5 psi (0.35 bar).

Material Standards:
Frame Casting: Brass UNS-C84400 or QM Brass for Sprinklers 12979 and 12282. Brass UNS-C84400 for all other sprinklers.
Deflector: Phosphor Bronze UNS-C51000 or Copper UNS-C19500 for Sprinklers 12979, 06666B, and 06765B. Copper UNS-C19500 for Sprinkler 12282. Phosphor Bronze UNS-C51000, Copper UNS-C19500 or Brass UNS-C26000 for Sprinkler 06720B. Brass UNS-C26000 for all other Sprinklers.
Bushing (for Sprinklers 06718B, 06720B, and 12290): Brass UNS-C36000
Bulb: Glass, nominal 3 mm diameter
Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with PTFE Tape
Screw: Brass UNS-C36000
Pip Cap and Insert Assembly: Copper UNS-C11000 and Stainless Steel UNS-S30400
For PTFE Coated Sprinklers: Belleville Spring-Exposed, Screw-Nickel Plated, Pip Cap-PTFE Coated
For Polyester Coated Sprinklers: Belleville Spring-Exposed
For ENT Coated Sprinklers: Belleville Spring-Exposed, Screw and Pipcap - ENT coated.

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

VIKING®

TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE PENDENT SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Ordering Information: (Also refer to the current Viking price list.)
Order Microfast® and MicrofastHP® Quick Response Pendent Sprinklers by first adding the appropriate suffix for the sprinkler finish and then the appropriate suffix for the temperature rating to the sprinkler base part number.
Finish Suffix: Brass = A, Chrome = F, White Polyester = M-/W, Black Polyester = M-/B, Black PTFE = N, and ENT = JN
Temperature Suffix: 135 °F (57 °C) = A, 155 °F (68 °C) = B, 175 °F (79 °C) = D, 200 °F (93 °C) = E, and 286 °F (141 °C) = G
For example, sprinkler VK302 with a 1/2" thread, Brass finish and a 155 °F (68 °C) temperature rating = Part No. 12979AB

Available Finishes And Temperature Ratings:

Refer to Table 1.

Accessories: (Also refer to the "Sprinkler Accessories" section of the Viking data book.)

Sprinkler Wrenches:

A. Standard Wrench: Part No. 10896W/B (available since 2000).
B. Wrench for Recessed Pendent Sprinklers: Part No. 16036W/B* (available since 2011)
C. Optional Protective Sprinkler Cap Remover/Escutcheon Installer Tool** Part No. 15915 (available since 2010.)
*A ½" ratchet is required (not available from Viking).
**Allows use from the floor by attaching a length of 1" diameter CPVC tubing to the tool. Ideal for sprinkler cabinets. Refer to Bulletin F_051808.

Sprinkler Cabinets:

A. Six-head capacity: Part No. 01724A (available since 1971)
B. Twelve-head capacity: Part No. 01725A (available since 1971)

4. INSTALLATION

Refer to appropriate NFPA Installation Standards.

5. OPERATION

During fire conditions, the heat-sensitive liquid in the glass bulb expands, causing the glass to shatter, releasing the pip cap and sealing spring assembly. Water flowing through the sprinkler orifice strikes the sprinkler deflector, forming a uniform spray pattern to extinguish or control the fire.

6. INSPECTIONS, TESTS AND MAINTENANCE

Refer to NFPA 25 for Inspection, Testing and Maintenance requirements.

7. AVAILABILITY

The Viking Microfast® and MicrofastHP® Quick Response Pendent Sprinklers are available through a network of domestic and international distributors. See The Viking Corporation web site for the closest distributor or contact The Viking Corporation.

8. GUARANTEE

For details of warranty, refer to Viking's current list price schedule or contact Viking directly.

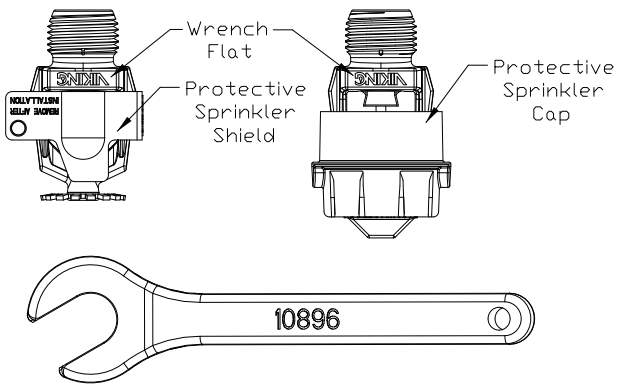


Figure 1: Standard Sprinkler Wrench 10896W/B

MICROFAST® AND MicrofastHP® QUICK RESPONSE PENDENT SPRINKLERS

TECHNICAL DATA

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

TABLE 1: AVAILABLE SPRINKLER TEMPERATURE RATINGS AND FINISHES

Sprinkler Temperature Classification	Sprinkler Nominal Temperature Rating[1]	Maximum Ambient Ceiling Temperature[2]	Bulb Color
Ordinary	135 °F (57 °C)	100 °F (38 °C)	Orange
Ordinary	155 °F (68 °C)	100 °F (38 °C)	Red
Intermediate	175 °F (79 °C)	150 °F (65 °C)	Yellow
Intermediate	200 °F (93 °C)	150 °F (65 °C)	Green
High	286 °F (141 °C)	225 °F (107 °C)	Blue

Sprinkler Finishes: Brass, Chrome, White Polyester, Black Polyester, Black PTFE, and ENT

Corrosion-Resistant Coatings[3]: White Polyester, Black Polyester, and Black PTFE. ENT in all temperature ratings except 135 °F (57 °C).

Footnotes

[1] The sprinkler temperature rating is stamped on the deflector.

[2] Based on NFPA-13. Other limits may apply, depending on fire loading, sprinkler location, and other requirements of the Authority Having Jurisdiction. Refer to specific installation standards.

[3] The corrosion-resistant coatings have passed the standard corrosion test required by the approving agencies indicated in the Approval Charts. These tests cannot and do not represent all possible corrosive environments. Prior to installation, verify through the end-user that the coatings are compatible with or suitable for the proposed environment. For automatic sprinklers, the coatings indicated are applied to the exposed exterior surfaces only. Note that the spring is exposed on sprinklers with Polyester, PTFE, and ENT coatings. For ENT coated automatic sprinklers, the waterway is coated.

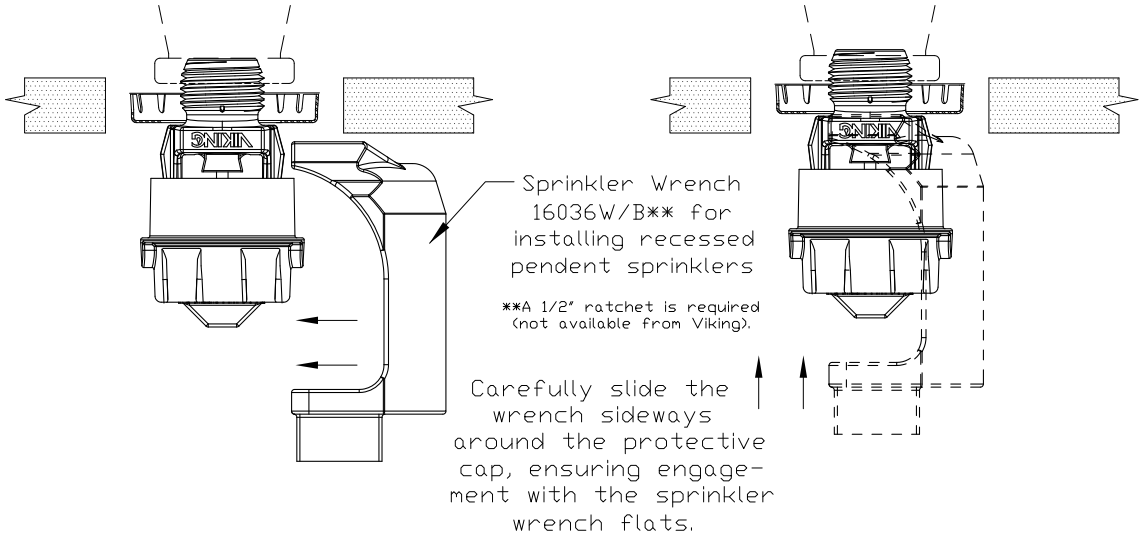


Figure 2: Wrench 16036W/B for Recessed Pendent Sprinklers

VIKING®

TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE PENDENT SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 1 (UL)

Microfast® and MicrofastHP® Quick Response Pendent Sprinklers
Maximum 175 PSI (12 bar) WWP

KEY: A1X — Temperature, Finish, Escutcheon (if applicable)

Sprinkler Base Part No.[1]	SIN	Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals[3] (Refer also to Design Criteria on page 41e.)					
		NPT	BSP	U.S.	metric[2]	Inches	mm	cULus[4]	NYC[5]	VdS	LPCB	CE	
Standard Orifice													
12979	VK302	1/2”	15 mm	5.6	80.6	2-1/4”	57	A1X, B1Y, C4, E4Z	A1X, B1Y	--	--	--	--
18021	VK302	1/2”	15 mm	5.6	80.6	2-1/4”	58	A1X, B1Y	A1X, B1Y	A2	A2X, B2Y	C2X, E2Y[11]	C2X, E2Y[14]
Large Orifice													
06666B	VK352	3/4”	20 mm	8.0	115.2	2-3/8”	60	A1X, B1Y, C4, E4Z	A1X, B1Y	A2	A2X	C2[11]	--
06765B[15]	VK352	1/2”	15 mm	8.0	115.2	2-3/8”	60	A1X, B1Y, C4, E4Z	A1X, B1Y	A2	--	A2[12]	--
Small Orifice[8]													
06718B[9]	VK329	1/2”	15 mm	2.8	40.3	2-3/16”	56	A1X, B1Y	A1X, B1Y	--	--	--	--
06720B[9]	VK331	1/2”	15 mm	4.2	57	2-1/4”	58	A1X, B1Y	A1X, B1Y	--	--	--	--
06932B	VK331	--	10 mm	4.2	57	2-3/8”	60	--	--	A2	--	G3[13]	--

Maximum 250 PSI (17 bar) WWP
Standard Orifice

Sprinkler Base Part No[1]	SIN	Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals[3] (Refer also to Design Criteria on page 41e.)					
		NPT	BSP	U.S.	metric[2]	Inches	mm	cULus[4]	NYC[10]	VdS	LPCB	CE	
12282	VK317	1/2”	15 mm	5.6	80.6	2-1/4”	58	A1X, B1Y	A1X	--	--	--	--
Maximum 250 PSI (17 bar) WWP Small Orifice[9]													
12290[10]	VK342	1/2”	15 mm	2.8	40.3	2-3/16”	56	A1X, B1Y	A1X	--	--	--	--

Approved Temperature Ratings

A - 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141 °C)
B - 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), and 200 °F (93 °C)
C - 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141 °C)
D - 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), and 286 °F (141 °C)
E - 155 °F (68 °C), 175 °F (79 °C), and 200 °F (93 °C)
F - 155 °F (68 °C), 175 °F (79 °C), and 286 °F (141 °C)
G - 155 °F (68 °C)

Approved Finishes

1 - Brass, Chrome, White Polyester[6,7], Black Polyester[6,7], and Black PTFE[6]
2 - Brass, Chrome, White Polyester[7], and Black Polyester[7]
3 - Brass and Chrome
4 - ENT[6]

Approved Escutcheons

X - Standard surface-mounted escutcheon or the Viking Microfast® Model F-1 Adjustable Escutcheon
Y - Standard surface-mounted escutcheon or the Viking Microfast® Model F-1 Adjustable Escutcheon **or** recessed with the Viking Micromatic® Model E-1, E-2, or E-3 Recessed Escutcheon
Z - Standard surface-mounted escutcheon or recessed with the Viking Micromatic® Model E-1

Footnotes

[1] Base part number is shown. For complete part number, refer to Viking’s current price schedule.
[2] Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.
[3] This table shows the listings and approvals available at the time of printing. Check with the manufacturer for any additional approvals.
[4] Listed by Underwriters Laboratories Inc. for use in the U.S. and Canada.
[5] Accepted for use, City of New York Board of Standards and Appeals, Calendar Number 219-76-SA.
[6] cULus Listed as corrosion resistant.
[7] Other colors are available on request with the same Listings and Approvals as the standard colors.
[8] Listings and Approvals limited to Light Hazard Occupancies where allowed by the installation standards being applied, with hydraulically calculated wet systems only. **Exception:** 4.2K sprinklers may be installed on hydraulically calculated dry pipe systems where piping is corrosion resistant or internally galvanized.
[9] The sprinkler orifice is bushed.
[10] Accepted for use, City of New York Department of Buildings, MEA Number 89-92-E, Vol. 16.
[11] CE Certified, Standard EN 12259-1, EC-certificates of conformity 0832-CPD-2001 and 0832-CPD-2003.
[12] CE Certified, Standard EN 12259-1, EC-certificate of conformity 0786-CPD-40279.
[13] CE Certified, Standard EN 12259-1, EC-certificate of conformity 0786-CPD-40130 and 0786-CPD-40170.
[14] MED Certified, Standard EN 12259-1, EC-certificates of conformity 0832-MED-1003 and 0832-MED-1008.
[15] The 1/2” NPT Large Orifice Sprinkler is Listed and Approved for retrofit only.

VIKING®

TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE PENDENT SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

DESIGN CRITERIA - UL

(Also refer to Approval Chart 1 on page 41d)

cULus Listing Requirements:

Microfast® and MicrofastHP® Quick Response Pendent Sprinklers are cULus Listed as indicated in the Approval Chart for installation in accordance with the latest edition of NFPA 13 for standard spray sprinklers.

- Designed for use in Light and Ordinary Hazard occupancies *(exception: small orifice sprinklers are limited to Light Hazard where allowed by the installation standards being applied, with hydraulically calculated wet systems only).*
- The sprinkler installation rules contained in NFPA 13 for standard spray pendent sprinklers must be followed.

IMPORTANT: Always refer to Bulletin Form No. F_091699 - Care and Handling of Sprinklers. Also refer to page QR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

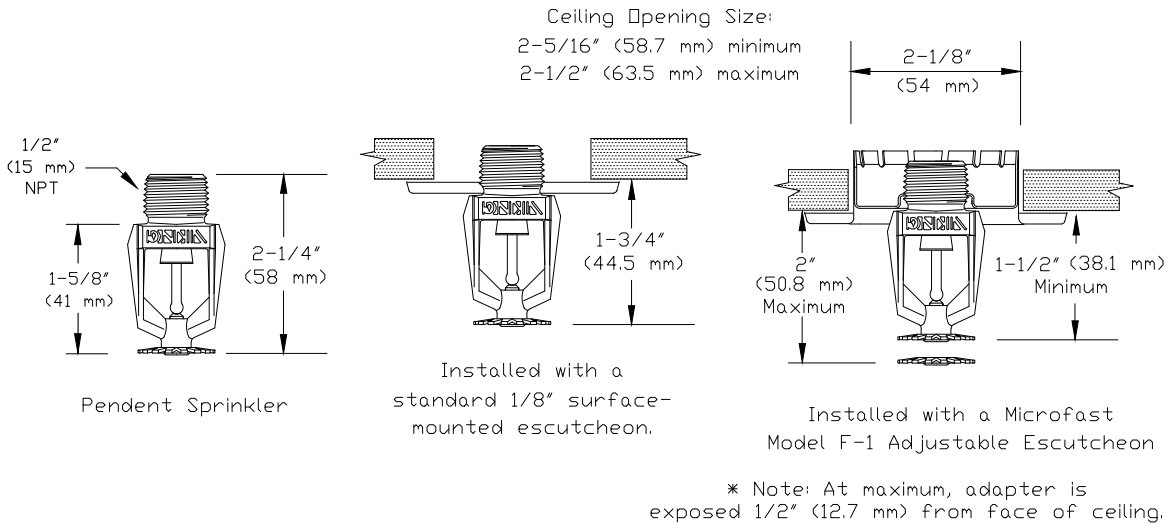


Figure 3: Sprinkler VK302 Dimensions with a Standard Escutcheon and the Model F-1 Adjustable Escutcheon

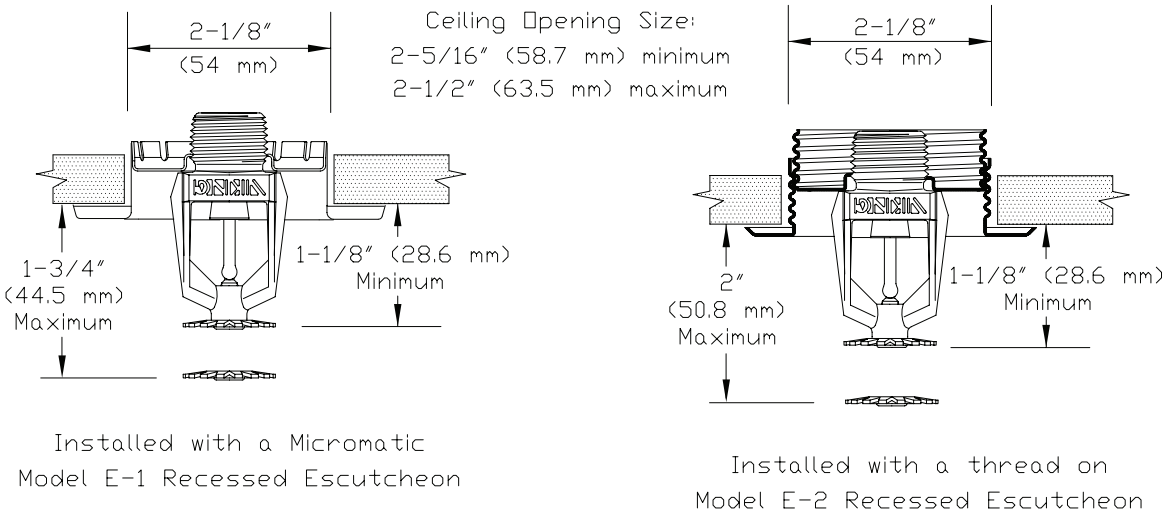


Figure 4: Sprinkler VK302 Dimensions with the Model E-1 and E-2 Recessed Escutcheons

VIKING®


TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE PENDENT SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 2 (FM)

Microfast® Quick Response Pendent Sprinklers
Maximum 175 PSI (12 bar) WWP



Sprinkler Base Part No.[1]	SIN	Thread Size		Nominal K-Factor		Overall Length		FM Approvals[3] (Refer also to Design Criteria below.)
		NPT	BSP	U.S.	metric[2]	Inches	mm	
Standard Orifice								
12979	VK302	1/2”	15 mm	5.6	80.6	2-1/4”	57	A2X, B2Y, C3, D3Z
18021	VK302	1/2”	15 mm	5.6	80.6	2-1/4”	58	A2X, B2Y
Large Orifice								
06666B	VK352	3/4”	20 mm	8.0	115.2	2-3/8”	60	A2X, B2Y, C3, D3Z
06765B[7]	VK352	1/2”	15 mm	8.0	115.2	2-3/8”	60	A2X, B2Y, C3, D3Z
Small Orifice[4]								
06718B[6]	VK329	1/2”	15 mm	2.8	40.3	2-3/16”	56	A1X

Approved Temperature Ratings

A - 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141 °C)
B - 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), and 200 °F (93 °C)
C- 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141 °C)
D - 155 °F (68 °C), 175 °F (79 °C), and 200 °F (93 °C)

Approved Finishes

1 - Brass and Chrome
2 - Brass, Chrome, White Polyester[5], and Black Polyester[5]
3 - ENT[8]

Approved Escutcheons

X - Standard surface-mounted escutcheon or the Viking Microfast® Model F-1 Adjustable Escutcheon
Y - Standard surface-mounted escutcheon or the Viking Microfast® Model F-1 Adjustable Escutcheon **or** recessed with the Viking Micromatic® Model E-1, E-2, or E-3 Recessed Escutcheon
Z - Standard surface-mounted escutcheon or recessed with the Viking Micromatic® Model E-1

Footnotes

[1] Base part number is shown. For complete part number, refer to Viking’s current price schedule.
[2] Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.
[3] This table shows the listings and approvals available at the time of printing. Check with the manufacturer for any additional approvals.
[4] FM Approved as quick response control mode standard spray **Non-storage** sprinklers. For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheet 2-0).
[5] Other colors are available on request with the same Listings and Approvals as the standard colors.
[6] The sprinkler orifice is bushed.
[7] The 1/2” NPT Large Orifice Sprinkler is Listed and Approved for retrofit only.
[8] FM approved as corrosion resistant.

DESIGN CRITERIA - FM

(Also refer to Approval Chart 2 above.)

FM Approval Requirements:

The sprinklers indicated in Approval Chart 2 are FM Approved as quick response **Non-storage** standard spray pendent sprinklers as indicated in the FM Approval Guide†. For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheets 2-0 and 8-9). FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.

NOTE: The FM installation guidelines may differ from cULus and/or NFPA criteria.

†Sprinklers VK302 and VK352 are also FM Approved as quick response **Rack Storage** standard spray pendent sprinklers. Refer to technical data page 131a-e for Intermediate Level In-Rack Sprinklers.

IMPORTANT: Always refer to Bulletin Form No. F_091699 - Care and Handling of Sprinklers. Also refer to page QR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

VIKING®

TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE UPRIGHT AND CONVENTIONAL SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

1. DESCRIPTION



Viking Microfast® and MicrofastHP® Quick Response Upright and Conventional (Old Style) Sprinklers are small, thermosensitive, glass-bulb spray sprinklers available in several different finishes, temperature ratings, and K-Factors to meet design requirements. The special Polyester, Polytetrafluoroethylene (PTFE), and Electroless Nickel PTFE (ENT) coatings can be used in decorative applications where colors are desired. In addition, these coatings have been investigated for installation in corrosive atmospheres and are cULus listed as corrosion resistant as indicated in Approval Chart 1. (Note: FM Global has no approval classification for PTFE and Polyester coatings as corrosion resistant.)

2. LISTINGS AND APPROVALS

cULus Listed: Category VNIV

FM Approved: Classes 2002 and 2020

NYC Approved: Calendar Number 219-76-SA and MEA 89-92-E, Volume 16

ABS Certified: Certificate 04-HS407984B-PDA

VdS Approved: Certificates G4060054, G4060056, G4880046, G4930039, and G4980020

LPC Approved: Ref. No. 096e/03, TE30401, and TE30872

CE Certified: Standard EN 12259-1, EC-certificate of conformity 0832-CPD-2001, 0832-CPD-2003, 0786-CPD-40131, 0786-CPD-40171, and 0786-CPD-40278

MED Certified: Standard EN 12259-1, EC-certificate of conformity 0832-MED-1003 and 0832-MED-1008

NOTE: Other International approval certificates are available upon request.

Refer to Approval Chart 1 and Design Criteria on pages 51c-d for cULus Listing requirements, and refer to Approval Chart 2 and Design Criteria on page 51e for FM Approval requirements that must be followed.

3. TECHNICAL DATA

Specifications:

Available since 1987.

Minimum Operating Pressure: 7 psi (0.5 bar)*

Maximum Working Pressure: Sprinklers VK315 and VK340 are rated for use with water working pressures ranging from the minimum 7 psi (0.5 bar) up to 250 psi (17 bar) for high-pressure systems. High-pressure (HP) sprinklers can be identified by locating "250" stamped on the deflector. All other Part Nos. not mentioned above are rated to a maximum 175 psi (12 bar) wwp.

Factory tested hydrostatically to 500 psi (34.5 bar)

Testing: U.S.A. Patent No. 4,831,870

Thread size: Refer to the Approval Charts

Nominal K-Factor: Refer to the Approval Charts

Glass-bulb fluid temperature rated to -65 °F (-55 °C)

Overall Length: Refer to the Approval Charts

*cULus Listing, FM Approval, and NFPA 13 installs require a minimum of 7 psi (0.5 bar). The minimum operating pressure for LPCB and CE Approvals ONLY is 5 psi (0.35 bar).

Viking Technical Data may be found on The Viking Corporation's Web site at http://www.vikinggroupinc.com. The Web site may include a more recent edition of this Technical Data Page.

Material Standards:

Frame Casting: Brass UNS-C84400 or QM Brass for Sprinklers 12978, 06766B, 07060, and 12281. Brass UNS-C84400 for all other sprinklers.

Deflector: Brass UNS-C23000 or Copper UNS-C19500 for Sprinklers 12978, 06764B, and 12281. Copper UNS-C19500 for Sprinklers 06665B, 07060, and 14817. Brass UNS-C26000 for all other Sprinklers.

Bushing (for Sprinklers 06719B, 06717B, and 12286): Brass UNS-C36000

Bulb: Glass, nominal 3 mm diameter

Replaces page 51a-e, dated July 12, 2012. (Added Electroless Nickel PTFE Coating)

VIKING®

TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE UPRIGHT AND CONVENTIONAL SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with PTFE Tape
Screw: Brass UNS-C36000
Pip Cap and Insert Assembly: Copper UNS-C11000 and Stainless Steel UNS-S30400
For PTFE Coated Sprinklers: Belleville Spring-Exposed, Screw-Nickel Plated, Pip Cap-PTFE Coated
For Polyester Coated Sprinklers: Belleville Spring-Exposed
For ENT Coated Sprinklers: Belleville Spring-Exposed, Screw and Pipcap - ENT plated.

Ordering Information: (Also refer to the current Viking price list.)
Order Microfast® and MicrofastHP® Quick Response Upright and Conventional Sprinklers by first adding the appropriate suffix for the sprinkler finish and then the appropriate suffix for the temperature rating to the sprinkler base part number.
Finish Suffix: Brass = A, Chrome = F, White Polyester = M-/W, Black Polyester = M-/B, and Black PTFE = N, ENT = JN
Temperature Suffix (°F/°C): 135°/57° = A, 155°/68° = B, 175°/79° = D, 200°/93° = E, and 286°/141° = G
For example, sprinkler VK300 with a 1/2" thread, Brass finish and a 155 °F/68 °C temperature rating = Part No. 12978AB

Available Finishes And Temperature Ratings: Refer to Table 1.

Accessories: (Also refer to the "Sprinkler Accessories" section of the Viking data book.)

Sprinkler Wrench: Standard Wrench: Part No. 10896W/B (available since 2000)

Sprinkler Cabinets:
A. Six-head capacity: Part No. 01724A (available since 1971)
B. Twelve-head capacity: Part No. 01725A (available since 1971)

4. INSTALLATION

Refer to appropriate NFPA Installation Standards.

5. OPERATION

During fire conditions, the heat-sensitive liquid in the glass bulb expands, causing the glass to shatter, releasing the pip cap and sealing spring assembly. Water flowing through the sprinkler orifice strikes the sprinkler deflector, forming a uniform spray pattern to extinguish or control the fire.

6. INSPECTIONS, TESTS AND MAINTENANCE

Refer to NFPA 25 for Inspection, Testing and Maintenance requirements.

7. AVAILABILITY

The Viking Microfast® and MicrofastHP® Quick Response Upright and Conventional Sprinklers are available through a network of domestic and international distributors. See The Viking Corporation web site for the closest distributor or contact The Viking Corporation.

8. GUARANTEE

For details of warranty, refer to Viking's current list price schedule or contact Viking directly.

TABLE 1: AVAILABLE SPRINKLER TEMPERATURE RATINGS AND FINISHES

Sprinkler Temperature Classification	Sprinkler Nominal Temperature Rating[1]	Maximum Ambient Ceiling Temperature[2]	Bulb Color
Ordinary	135 °F (57 °C)	100 °F (38 °C)	Orange
Ordinary	155 °F (68 °C)	100 °F (38 °C)	Red
Intermediate	175 °F (79 °C)	150 °F (65 °C)	Yellow
Intermediate	200 °F (93 °C)	150 °F (65 °C)	Green
High	286 °F (141 °C)	225 °F (107 °C)	Blue

Sprinkler Finishes: Brass, Chrome, White Polyester, Black Polyester, Black PTFE, and ENT
Corrosion-Resistant Coatings[3]: White Polyester, Black Polyester, and Black PTFE. ENT in all temperature ratings except 135 °F (57 °C)

Footnotes

[1] The sprinkler temperature rating is stamped on the deflector.
[2] Based on NFPA-13. Other limits may apply, depending on fire loading, sprinkler location, and other requirements of the Authority Having Jurisdiction. Refer to specific installation standards.
[3] The corrosion-resistant coatings have passed the standard corrosion test required by the approving agencies indicated on pages 51c-e. These tests cannot and do not represent all possible corrosive environments. Prior to installation, verify through the end-user that the coatings are compatible with or suitable for the proposed environment. For automatic sprinklers, the coatings indicated are applied to the exposed exterior surfaces only. Note that the spring is exposed on sprinklers with Polyester, ENT, and PTFE coatings. For ENT coated automatic sprinklers, the waterway is coated.

VIKING®

TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE UPRIGHT AND CONVENTIONAL SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 1 (UL)

Microfast® and MicrofastHP® Quick Response Upright and Conventional Sprinklers Maximum 175 PSI (12 bar) WWP

KEY: A1X — Temperature, Finish, Escutcheon (if applicable)

Base Part Number[1]	SIN	Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals[3] (Refer also to Design Criteria on page 51d.)					
		NPT	BSP	U.S.	metric[2]	Inches	mm	cULus[4]	NYC[8]	VdS	LPCB	CE	⚙
Upright-Standard Orifice													
12978	VK300	1/2”	15 mm	5.6	80.6	2-3/16	56	A1, B4	See Footnote 7.	--	--	--	--
07060	VK345	--	15 mm	5.6	80.6	2-3/16	56	--	--	A2	A2	B2[12]	B2[15]
Conventional-Standard Orifice													
06766B	VK310	1/2”	15 mm	5.6	80.6	2-3/16	56	A2	A2	--	A2	B2[12]	B2[15]
Upright-Large Orifice													
06665B	VK350	3/4”	--	8.0	115.2	2-5/16	59	A1, B4	A1	A2	A2	B2[12]	--
14817	VK350	--	20 mm	8.0	115.2	2-5/16	59	A1, B4	A1	A2	A2	B2[12]	--
06764B	VK350	1/2”	15 mm	8.0	115.2	2-5/16	59	A1, B4	A1	A2	--	A2[13]	--
Conventional-Large Orifice													
06768B	VK354	3/4”	20 mm	8.0	115.2	2-5/16	59	A1	A2	--	A2	B2[12]	--
Upright-Small Orifice[11]													
06717B[11]	VK325	1/2”	15 mm	2.8	40.3	2-3/16	56	A1	A1	--	--	--	--
06719B[11]	VK327	1/2”	15 mm	4.2	57	2-3/16	56	A1	A1	--	--	--	--
06931B[11]	VK327	--	10 mm	4.2	57	2-3/16	56	--	--	A2	--	C3[14]	--

Maximum 250 PSI (17 bar) WWP Upright-Standard Orifice

Base Part Number[1]	SIN	Thread Size		Nominal K-Factor		Overall Length		Listings and Approvals[3] (Refer also to Design Criteria on page 51d.)					
		NPT	BSP	U.S.	metric[2]	Inches	mm	cULus[4]	NYC[9]	VdS	LPCB	CE	⚙
12281	VK315	1/2”	15 mm	5.6	80.6	2-3/16	56	A1	A1	--	--	--	--
Upright-Small Orifice[10]													
12286[11]	VK340	1/2”	15 mm	2.8	40.3	2-3/16	56	A1	A1	--	--	--	--

Approved Temperature Ratings

A - 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141°C)
B - 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141°C)
C - 155 °F (68 °C)

Approved Finishes

1 - Brass, Chrome, White Polyester[5,6], Black Polyester[5,6], and Black PTFE[5]
2 - Brass, Chrome, White Polyester[5,6], and Black Polyester[5,6]
3 - Brass and Chrome
4 - ENT[5]

Footnotes

[1] Base part number is shown. For complete part number, refer to Viking’s current price schedule.
[2] Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.
[3] This table shows the listings and approvals available at the time of printing. Check with the manufacturer for any additional approvals.
[4] Listed by Underwriters Laboratories Inc. for use in the U.S. and Canada.
[5] cULus Listed as corrosion resistant.
[6] Other colors are available on request with the same Listings and Approvals as the standard colors.
[7] Meets New York City requirements, effective July 1, 2008.
[8] Accepted for use, City of New York Board of Standards and Appeals, Calendar Number 219-76-SA.
[9] Accepted for use, City of New York Department of Buildings, MEA 89-92-E, Vol. 16.
[10] Listings and Approvals limited to Light Hazard Occupancies where allowed by the installation standards being applied, with hydraulically calculated wet systems only. **Exception:** 4.2K sprinklers may be installed on hydraulically calculated dry pipe systems where piping is corrosion resistant or internally galvanized.
[11] The sprinkler orifice is bushed.
[12] CE Certified, Standard EN 12259-1, EC-certificate of conformity 0832-CPD-2001 and 0832-CPD-2003.
[13] CE Certified, Standard EN 12259-1, EC-certificate of conformity 0786-CPD-40278.
[14] CE Certified, Standard EN 12259-1, EC-certificate of conformity 0786-CPD-40131.
[15] ⚙ MED Certified, Standard EN 12259-1, EC-certificate of conformity 0832-MED-1003 and 0832-MED-1008.

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE UPRIGHT AND CONVENTIONAL SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

DESIGN CRITERIA - UL

(Also refer to Approval Chart 1 on page 51c)

cULus Listing Requirements:

Microfast® and MicrofastHP® Quick Response Upright and Conventional Sprinklers are cULus Listed as indicated in Approval Chart 1 for installation in accordance with the latest edition of NFPA 13 for standard spray sprinklers, or old style (conventional) sprinklers.

- Designed for use in Light and Ordinary Hazard occupancies *(exception: small orifice sprinklers are limited to Light Hazard where allowed by the installation standards being applied, with hydraulically calculated wet systems only).*
- The sprinkler installation rules contained in NFPA 13 for standard spray upright sprinklers must be followed. For conventional sprinklers, refer to the installation guidelines for old style (conventional) sprinklers.

IMPORTANT: Always refer to Bulletin Form No. F_091699 - Care and Handling of Sprinklers. Also refer to page QR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

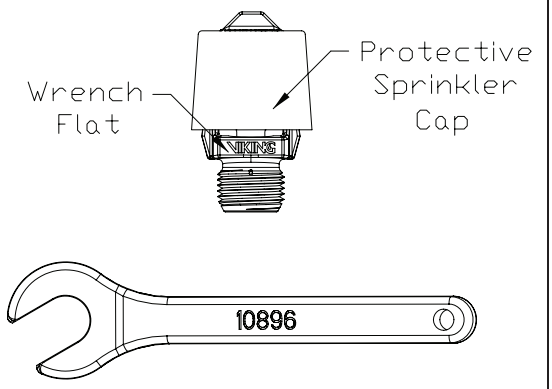


Figure 1:
Standard Sprinkler Wrench 10896W/B

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

VIKING®


TECHNICAL DATA

MICROFAST® AND MicrofastHP® QUICK RESPONSE UPRIGHT AND CONVENTIONAL SPRINKLERS

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 2 (FM)

Microfast® Quick Response Upright Sprinklers
Maximum 175 PSI (12 bar) WWP



Base Part Number[1]	SIN	Thread Size		Nominal K-Factor		Overall Length		FM Approvals[3] (Refer also to Design Criteria below.)
		NPT	BSP	U.S.	metric[2]	Inches	mm	
Standard Orifice								
12978	VK300	1/2”	15 mm	5.6	80.6	2-3/16	56	A2, B3
07060	VK345	--	15 mm	5.6	80.6	2-3/16	56	A2
Large Orifice								
06665B	VK350	3/4”	--	8.0	115.2	2-5/16	59	A2, B3
14817	VK350	--	20 mm	8.0	115.2	2-5/16	59	A2, B3
06764B	VK350	1/2”	15 mm	8.0	115.2	2-5/16	59	A2, B3
Small Orifice[4]								
06717B[6]	VK325	1/2”	15 mm	2.8	40.3	2-3/16	56	A1

Approved Temperature Ratings

A - 135 °F (57 °C), 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141°C)
B - 155 °F (68 °C), 175 °F (79 °C), 200 °F (93 °C), and 286 °F (141°C)

Approved Finishes

1 - Brass and Chrome
2 - Brass, Chrome, White Polyester[5], and Black Polyester[5]
3 - ENT

Footnotes

[1] Base part number is shown. For complete part number, refer to Viking’s current price schedule.

[2] Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

[3] This table shows the FM Approvals available at the time of printing. Check with the manufacturer for any additional approvals.

[4] FM Approved as quick response **Non-Storage** pendent sprinklers. For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheet 2-0).

[5] Other colors are available on request with the same Approvals as the standard colors.

[6] The sprinkler orifice is bushed.

DESIGN CRITERIA - FM

(Also refer to Approval Chart 2 above.)

FM Approval Requirements:

The sprinklers indicated in Approval Chart 2 are FM Approved as quick response **Non-Storage** upright sprinklers as indicated in the FM Approval Guide. For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheet 2-0). FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.

NOTE: The FM installation guidelines may differ from cULus and/or NFPA criteria.

IMPORTANT: Always refer to Bulletin Form No. F_091699 - Care and Handling of Sprinklers. Also refer to page QR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

THIS PAGE INTENTIONALLY LEFT BLANK

Replaces page 51a-e, dated July 12, 2012. (Added Electroless Nickel PTFE Coating)


RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

MIRAGE® STANDARD AND QR CONCEALED PENDENT SPRINKLER VK462 AND HP SPRINKLER VK463 (K5.6)

TECHNICAL DATA

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

1. DESCRIPTION

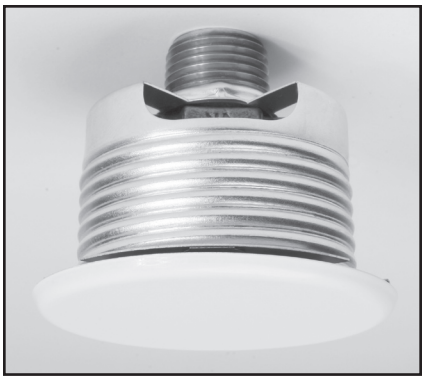

Viking Mirage® Standard and Quick Response Concealed Pendent Sprinkler VK462 and HP Sprinkler VK463 are thermosensitive glass-bulb spray sprinklers designed for installation on concealed pipe systems where the appearance of a smooth ceiling is desired.

The sprinkler is pre-assembled with a threaded adapter for installation with a low-profile cover assembly that provides up to ½" (12.7 mm) of vertical adjustment. The two-piece design allows installation and testing of the sprinkler prior to installation of the cover plate. The "push-on", "thread-off" design of the concealed cover plate assembly allows easy installation of the cover plate after the system has been tested and the ceiling finish has been applied. The cover assembly can be removed and reinstalled, allowing temporary removal of ceiling panels without taking the sprinkler system out of service or removing the sprinkler.

2. LISTINGS AND APPROVALS

cULus Listed: Category VNIV

FM Approval: Class 2015

NYC Approved: MEA 89-92-E, Volume 32

VdS Approved: Certificate G4080021

LPCB Approved: Ref. No. 096e/12

CE Certified: Standard EN 12259-1, EC-certificate of conformity 0832-CPD-2032

Refer to Approval Chart 1 on page 54c and Design Criteria on page 54d for cULus Listing requirements, and refer to Approval Chart 2 and Design Criteria on page 54e for FM Approval requirements that must be followed.

3. TECHNICAL DATA

Specifications:

Available since 2006.

Minimum Operating Pressure: 7 psi (0.5 bar)*

Maximum Working Pressure: Sprinkler VK463 is rated for use with water working pressures ranging from the minimum 7 psi (0.5 bar) up to 250 psi (17.2 bar) for high-pressure systems. High-pressure (HP) sprinklers can be identified by locating "250" stamped on the deflector. Sprinkler VK462 is rated to a maximum 175 psi (12 bar) wwp.

Factory tested hydrostatically to 500 psi (34.5 bar)

Thread size: 1/2" (15 mm) NPT

Nominal K-Factor: 5.6 U.S. (80.6 metric†)

Glass-bulb fluid temperature rated to -65°F (-55°C)

Patents Pending

*cULus Listing, FM Approval, and NFPA 13 installs require a minimum of 7 psi (0.5 bar). The minimum operating pressure for LPCB and CE Approvals ONLY is 5 psi (0.35 bar).

†Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

Material Standards:

Sprinkler Body: Brass UNS-C84400

Deflector: Copper UNS-C19500 for Sprinkler VK462
Phosphor Bronze UNS-C51000 for Sprinkler VK463

Deflector Pins: Stainless Steel Alloy

Bulb: Glass, nominal 3 mm diameter

Pip Cap and Insert Assembly: Copper UNS-C11000 and Stainless Steel UNS-S30400

Button: Brass UNS-C36000

Screws: 18-8 Stainless Steel

Belleville Spring Sealing Assembly: Nickel Alloy, coated on both sides with Teflon Tape

Yoke: Phosphor Bronze UNS-C51000

Cover Adapter: Cold Rolled Steel UNS-G10080, Finish: Clear Chromate over Zinc Plating

Viking Technical Data may be found on The Viking Corporation's Web site at http://www.vikinggroupinc.com. The Web site may include a more recent edition of this Technical Data Page.

VIKING®

TECHNICAL DATA

MIRAGE® STANDARD AND QR CONCEALED PENDENT SPRINKLER VK462 AND HP SPRINKLER VK463 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Cover Assembly Materials:
Cover: Copper UNS-C11000
Base: Brass UNS-C26000 or UNS-C26800
Springs: Nickel Alloy
Solder: Eutectic

Ordering Information: (Also refer to the current Viking price list.)
Viking Mirage® Standard and Quick Response Concealed Pendent Sprinklers and Cover Plate Assemblies must be ordered separately:
Sprinkler: Base Part No. 13503A or HP Base Part No. 13667A
Specify sprinkler temperature rating by adding the appropriate suffix for the temperature rating to the base part number:
Temperature Suffix: 155 °F (68 °C) = B, 175 °F (79 °C) = D, 200 °F (93 °C) = E
For example, sprinkler VK463 with a 155 °F (68 °C) temperature rating = 13667AB.
Cover Plate Assembly: Base Part No. 13504 (2-3/4" diameter), Base Part No. 13642 (3-5/16" diameter), or Base Part No. 15394 (square cover plate, 3-5/16" diameter)
Specify finish and temperature rating of the cover plate assembly by adding the appropriate suffixes for the finish and the cover temperature rating to the base part number:
Finish Suffix: Polished Chrome = F, Brushed Chrome = F-/B, Bright Brass = B, Antique Brass = B-/A, Brushed Brass = B-/B, Brushed Copper = E-/B, Painted White = M-/W, Painted Ivory = M-/I, Painted Black = M-/B
Temperature Suffix: 135 °F (57 °C) UL (139 °F (59 °C) FM and LPCB) = A, 165 °F (74 °C) = C
For example, cover 13504 with a Polished Chrome finish and a 165 °F (74 °C) temperature rating = 13504FC.

Note: Square cover plate 15394 cULus Listing is for the 135 °F (57 °C) temperature rated cover plate only. Refer to the Approval Chart.

Available Finishes And Temperature Ratings: Refer to Table 1.

Accessories: (Also refer to the "Sprinkler Accessories" section of the Viking data book.)
Sprinkler Wrenches:**
A. Heavy Duty Wrench Part No. 14047W/B (available since 2006), or
B. Head Cabinet Wrench Part No. 14031*** (available since 2006)
C. Optional Concealed Cover Plate Installer Tool Part No. 14412 for cover 13504, or Part No. 14867 for the large diameter cover (available since 2007)

**Requires a ½" ratchet (not available from Viking). ***Optional for removal of the protective cap. Ideal for sprinkler cabinets.

Sprinkler Cabinet: Part No. 01731A (available since 1971)

4. INSTALLATION
Refer to appropriate NFPA Installation Standards.

5. OPERATION
During fire conditions, when the temperature around the sprinkler approaches its operating temperature, the cover plate detaches. Continued heating of the exposed sprinkler causes the heat-sensitive liquid in the glass bulb to expand and the bulb to shatter, releasing the yoke, pip-cap and sealing spring assembly. Water flowing through the sprinkler orifice strikes the sprinkler deflector, forming a uniform spray pattern to extinguish or control the fire.

6. INSPECTIONS, TESTS AND MAINTENANCE
Refer to NFPA 25 for Inspection, Testing and Maintenance requirements.

7. AVAILABILITY
Viking Sprinklers VK462 and VK463 are available through a network of domestic and international distributors. See The Viking Corporation web site for the closest distributor or contact The Viking Corporation.

8. GUARANTEE
For details of warranty, refer to Viking's current list price schedule or contact Viking directly.

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

VIKING®

TECHNICAL DATA

MIRAGE® STANDARD AND QR CONCEALED PENDENT SPRINKLER VK462 AND HP SPRINKLER VK463 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

TABLE 1: AVAILABLE SPRINKLER TEMPERATURE RATINGS AND FINISHES

Sprinkler Temperature Classification	Sprinkler Nominal Temperature Rating[1]	Maximum Ambient Ceiling Temperature[2]	Temperature Rating of Cover Assembly (Required)	Bulb Color
Ordinary	155 °F (68° C)	100 °F (38 °C)	135 °F (57 °C) cULus 139 °F (59 °C) FM and LPCB	Red
Intermediate	175 °F (79 °C)	150 °F (65 °C)	165 °F (74 °C)	Yellow
Intermediate	200 °F (93 °C)	150 °F (65 °C)	165 °F (74 °C)	Green

Cover Plate Finishes: Polished Chrome, Brushed Chrome, Bright Brass, Antique Brass, Brushed Brass, Brushed Copper, Painted White, Painted Ivory, or Painted Black

Footnotes

[1] The sprinkler temperature rating is stamped on the sprinkler deflector.

[2] Based on NFPA-13. Other limits may apply, depending on fire loading, sprinkler location, and other requirements of the Authority Having Jurisdiction. Refer to specific installation standards.

Approval Chart 1 (UL)

Mirage® Concealed Pendent Sprinklers VK462 and VK463

Sprinkler Temperature Rating
Cover Plate Temperature Rating
AW1 Cover Plate Finish KEY

Sprinkler Base Part No.[1]	SIN	NPT Thread Size		Nominal K-Factor		Maximum Water Working Pressure	Listings and Approvals[4] (Refer also to Design Criteria on page 54d.)				
		Inch	mm	U.S.	metric[2]		cULus[5]	NYC	VdS[7]	LPCB	CE
Standard Response Applications											
13503A	VK462	1/2"	15	5.6	80.6	175 psi (12 bar)	--	--	AY1, CZ1	AY1, BZ1	AY1, CZ1[8]
Quick Response Applications											
13503A	VK462	1/2"	15	5.6	80.6	175 psi (12 bar)	AV1, BX1	AV1, BW1[6]	–	–	--
13667A	VK463	1/2"	15	5.6	80.6	250 psi (17.2 bar)[3]	AV1, BX1	AV1, BW1[6]	--	--	--

Sprinkler Temperature Ratings

A - 155 °F (68 °C)
B - 175 °F (79 °C) and 200 °F (93 °C)
C - 200 °F (93 °C)

Cover Plate Assembly Temperature Ratings[9]

V - **135 °F (57 °C) cULus Listed cover 13504**[1], 13642[1] (large diameter), or 15394[1] (square cover plate)
W - 165 °F (74 °C) cover 13504[1] or 13642[1] (large diameter)
X - **165 °F (74 °C) cover 13504**[1], or 13642[1] (large diameter)
Y - 135 °F (57 °C) cover 13504[1] *LPCB Approved as 139 °F (59 °C)*
Z - 165 °F (74 °C) cover 13504[1]

Cover Plate Assembly Finishes[10]

1 - Polished Chrome, Brushed Chrome, Bright Brass, Antique Brass, Brushed Brass, Brushed Copper, Painted White, Painted Ivory, or Painted Black

Footnotes

[1] Part number shown is the base part number. For complete part number, refer to current Viking price list schedule.

[2] Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

[3] The Water Working Pressure rating is stamped on the deflector.

[4] This chart shows the listings and approvals available at the time of printing. Other approvals may be in process. Check with the manufacturer for any additional approvals.

[5] Listed by Underwriter's Laboratories for use in the U.S. and Canada.

[6] Accepted for use, City of New York Department of Buildings, MEA Number 89-92-E, Vol. 32.

[7] VdS Approved, standards VdS 2344:2005-12, VdS 2100-25:2008-01, and EN 12259-1:1999 + A1:2001 + A2:2004 + A3:2006, Certificate G4080021.

[8] CE Certified, Standard EN 12259-1, EC-certificate of conformity 0832-CPD-2032.

[9] The 135/139 °F cover has an orange label. The 165 °F (74 °C) cover has a white label.

[10] Painted finish consists of Polyester Baked Enamel. Other paint colors are available on request with the same listings as the standard paint colors. Listings and approvals apply for any paint manufacturer. Contact Viking for additional information.

NOTE: Custom colors are indicated on a label inside the cover assembly. Refer to Figure 1.

MIRAGE® STANDARD AND QR CONCEALED PENDENT SPRINKLER VK462 AND HP SPRINKLER VK463 (K5.6)

TECHNICAL DATA

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

DESIGN CRITERIA - UL

(Also refer to Approval Chart 1 on page 54c.)

cULus Listing Requirements:

Mirage® Concealed Pendent Sprinklers VK462 and VK463 are cULus Listed as quick response for installation in accordance with the latest edition of NFPA 13 for standard coverage pendent spray sprinklers as indicated below.

- For hazard occupancies up to and including Ordinary Hazard, Group II.
- Protection areas and maximum spacing shall be in accordance with the tables provided in NFPA 13. Maximum spacing allowed is 15 ft. (4.6 m).
- Minimum spacing allowed is 6 ft. (1.8 m) unless baffles are installed in accordance with NFPA 13.
- Minimum distance from walls is 4 in. (102 mm).
- Maximum distance from walls shall be no more than one-half of the allowable distance between sprinklers. The distance shall be measured perpendicular to the wall.
- The sprinkler obstruction rules contained in NFPA 13 for standard coverage pendent spray sprinklers must be followed.

NOTE: Concealed sprinklers must be installed in neutral or negative pressure plenums only.

VdS Approval Requirements:

a) The sprinkler can be installed in a concrete ceiling (massive ceiling) or in a false ceiling made of light materials.

b) This sprinkler is deflector fixed type and can be only activated by heat. The housing is not tight.

c) Follow installation guidelines of current standards, CEA4001VdS and EN12845. These sprinklers can only be installed in LH and OH occupancies, except in OH4.

NOTES: Due to the design the sprinkler type 'Domed-CCP' shall not be installed in false ceilings in which the false ceiling space is protected by a water extinguishing system.

Due to the design the sprinkler type 'Domed-CCP' shall not be installed in false ceilings in which during a fire the pressure above the false ceiling may be assumed to be higher than the pressure below the false ceiling.

The criterion for the dropping of the cover relevant for this approval is heat.

Steps of installation:

1. Prepare the sprinkler key.
2. Remove the plastic cover.
3. Hold the sprinkler with the wrench and fasten it.
4. Replace the plastic cover and do not remove until the cover is installed.

IMPORTANT: Always refer to Bulletin Form No. F_091699 - Care and Handling of Sprinklers. Also refer to page SR1-3 or QR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.



Identification of Custom Paint Color:
All custom color painted cover plates will have an identifying label affixed to the inside of the cover that indicates custom color and will have a representative sample (a paint dot) of the paint on the label.

Figure 1: Identification of Custom Paint Color for Concealed Covers

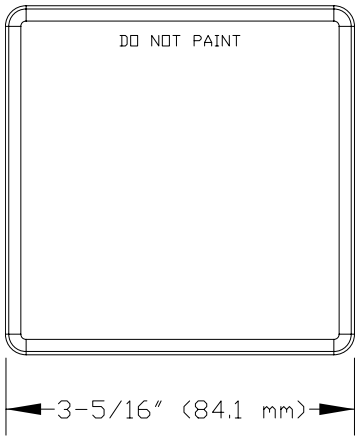


Figure 2: Square Cover Assembly 15394

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

VIKING®


TECHNICAL DATA

MIRAGE® STANDARD AND QR CONCEALED PENDENT SPRINKLER VK462 AND HP SPRINKLER VK463 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

Approval Chart 2 (FM)

Mirage® Standard Response Concealed Pendent Sprinkler VK462



Sprinkler Base Part No.[1]	SIN	NPT Thread Size		Nominal K-Factor		Maximum Water Working Pressure	FM Approvals[3] (Refer also to Design Criteria below.)
		Inch	mm	U.S.	metric[2]		
13503A	VK462	1/2”	15	5.6	80.6	175 psi (12 bar)	AW1, BX1

Sprinkler Temperature Ratings

A - 155 °F (68 °C)

B - 175 °F (79 °C) and 200 °F (93 °C)

Cover Plate Assembly Temperature Ratings[4]

W - 139 °F (59 °C) cover 13504[1], 13642[1] (large diameter), or 15394[1] (square cover plate)

X - 165 °F (74 °C) cover 13504[1], 13642[1] (large diameter), or 15394[1] (square cover plate)

Cover Plate Assembly Finishes[5]

1 - Polished Chrome, Brushed Chrome, Bright Brass, Antique Brass, Brushed Brass, Brushed Copper, Painted White, Painted Ivory, or Painted Black

Footnotes

[1] Part number shown is the base part number. For complete part number, refer to current Viking price list schedule.

[2] Metric K-factor measurement shown is when pressure is measured in Bar. When pressure is measured in kPa, divide the metric K-factor shown by 10.0.

[3] This chart shows the FM Approvals available at the time of printing. Other approvals may be in process. Check with the manufacturer for any additional approvals.

[4] The 139 °F (59 °C) cover has an orange label. The 165 °F (74 °C) cover has a white label.

[5] Painted finish consists of Polyester Baked Enamel. Other paint colors are available on request with the same listings as the standard paint colors. Listings and approvals apply for any paint manufacturer. Contact Viking for additional information.

NOTE: Custom colors are indicated on a label inside the cover assembly. Refer to Figure 1.

DESIGN CRITERIA - FM

(Also refer to Approval Chart 2 above.)

FM Approval Requirements:

Viking Concealed Pendent Sprinkler VK462 is FM Approved as a standard response **Non-Storage** concealed pendent sprinkler as indicated in the FM Approval Guide. For specific application and installation requirements, reference the latest applicable FM Loss Prevention Data Sheets (including Data Sheet 2-0). FM Global Loss Prevention Data Sheets contain guidelines relating to, but not limited to: minimum water supply requirements, hydraulic design, ceiling slope and obstructions, minimum and maximum allowable spacing, and deflector distance below the ceiling.

NOTE: The FM installation guidelines may differ from cULus and/or NFPA criteria.

IMPORTANT: Always refer to Bulletin Form No. F_091699 - Care and Handling of Sprinklers. Also refer to page SR1-3 for general care, installation, and maintenance information. Viking sprinklers are to be installed in accordance with the latest edition of Viking technical data, the appropriate standards of NFPA, FM Global, LPCB, APSAD, VdS or other similar organizations, and also with the provisions of governmental codes, ordinances, and standards, whenever applicable.

VIKING®

TECHNICAL DATA

MIRAGE® STANDARD AND QR CONCEALED PENDENT SPRINKLER VK462 AND HP SPRINKLER VK463 (K5.6)

The Viking Corporation, 210 N Industrial Park Drive, Hastings MI 49058
Telephone: 269-945-9501 Technical Services: 877-384-5464 Fax: 269-818-1680 Email: techsvcs@vikingcorp.com

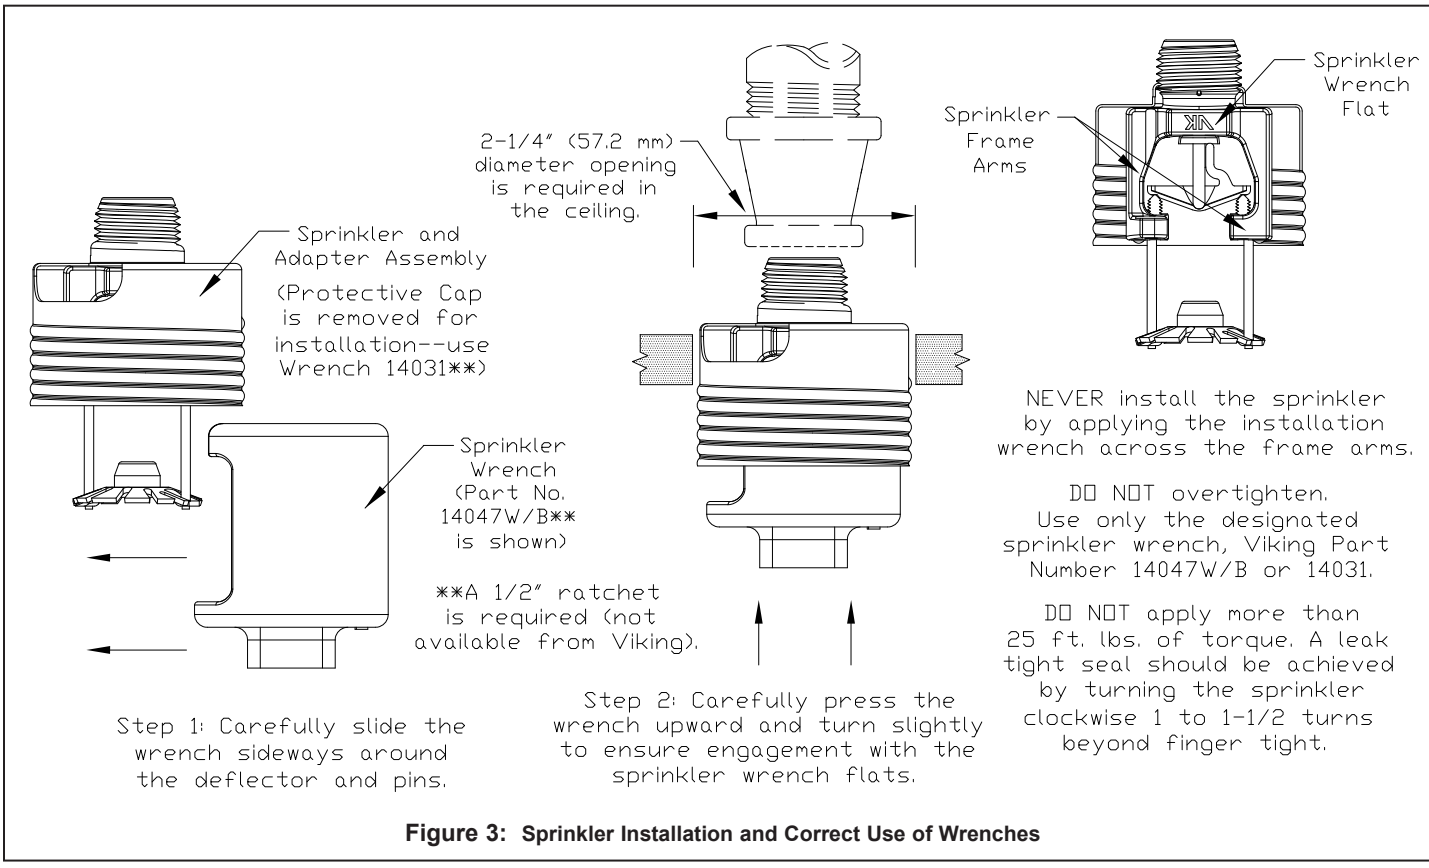


Figure 3: Sprinkler Installation and Correct Use of Wrenches


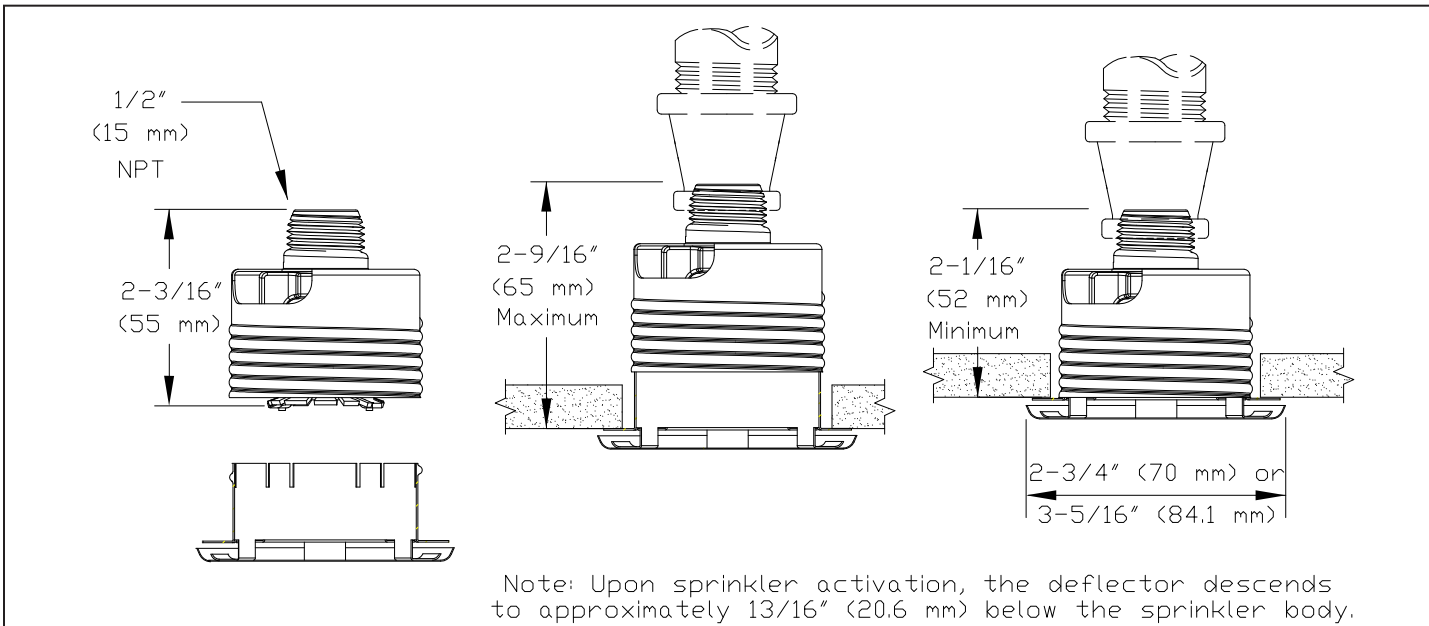


Figure 4: Sprinkler Dimensions and Cover Installation

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

STEEL FIRE SPRINKLER PIPE

Schedule 10 and Schedule 40

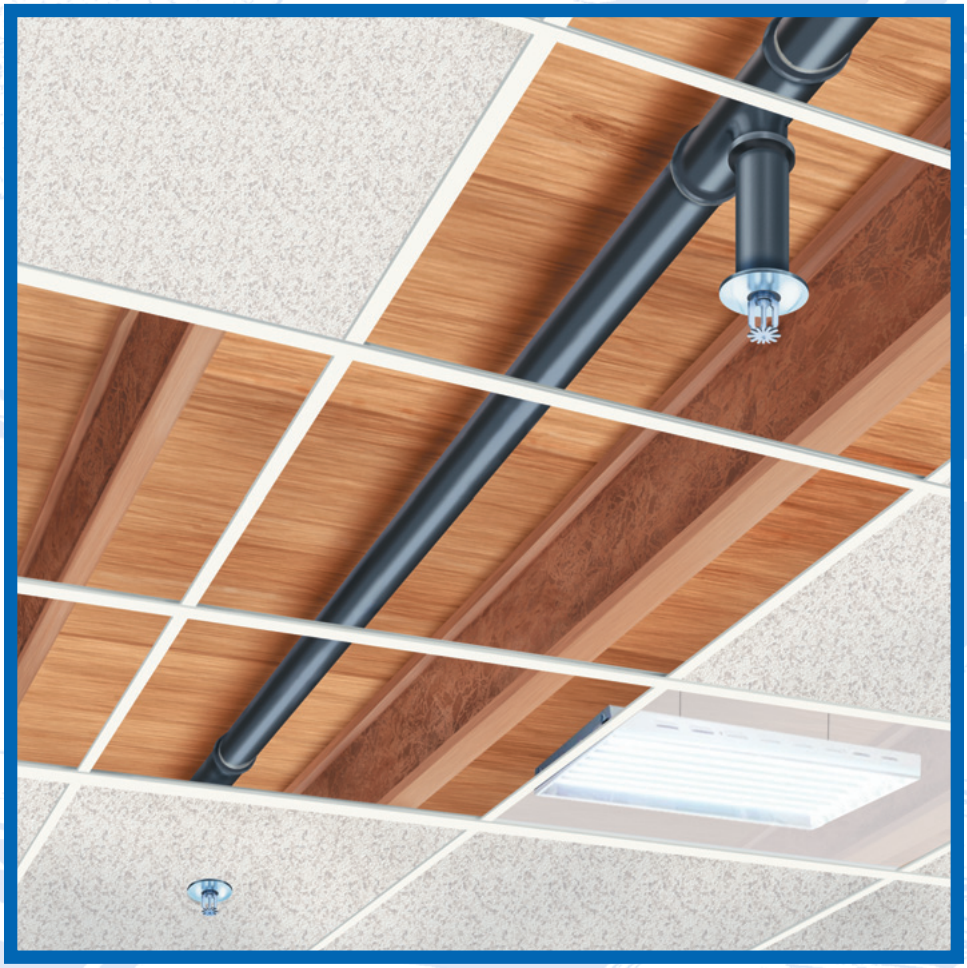

Wheatland Tube
JMC STEEL GROUP

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

High Quality, High Performance, Long-Lasting

Wheatland's Schedule 10 and Schedule 40 steel fire sprinkler pipe have set the industry's standards for years. Both products are subjected to the toughest possible testing to assure the highest possible quality and reliable, long-lasting performance.


Each is coated with Wheatland's proprietary mill coating to assure a clean, corrosion- and heat-resistant surface that outperforms and outlasts standard lacquer coatings. The coating also allows the pipe to be easily painted, without special preparation.

You can order Schedule 10 or Schedule 40 in black, or with hot-dip galvanizing, to meet FM requirements for dry systems to meet the zinc coating specifications of ASTM A795 or A53.

Both Schedule 10 and 40 are UL and FM listed and meet NFPA 13 standards. We coat all of our black products up to 6" with our patented MIC Shield™ coating, which helps protect against the onset of microbial corrosion (MIC). Our MIC Shield was the first coating to be approved by FM as compatible with hybrid sprinkler systems that include CPVC plastic pipe in mixed use occupancies. MIC Shield is also chemically compatible with Flow Guard Gold®, Blaze Master® and Corizan® CPVC.

Why Wheatland?

- Experience: We've manufactured fire sprinkler pipe since 1955
- We product the most complete line of products in the industry
- We offer a number of proprietary products and unique benefits
- We provide a complete line of coatings:
  - in-house, hot dip galvanizing
  - black sprinkler pipe
  - MIC shield™, the first FM global approved factory applied, anti-microbial coating for use with CPVC plastic pipe systems
  - proprietary mill coatings that provide corrosion and heat resistant properties
  - proprietary mill coatings that extend shelf life

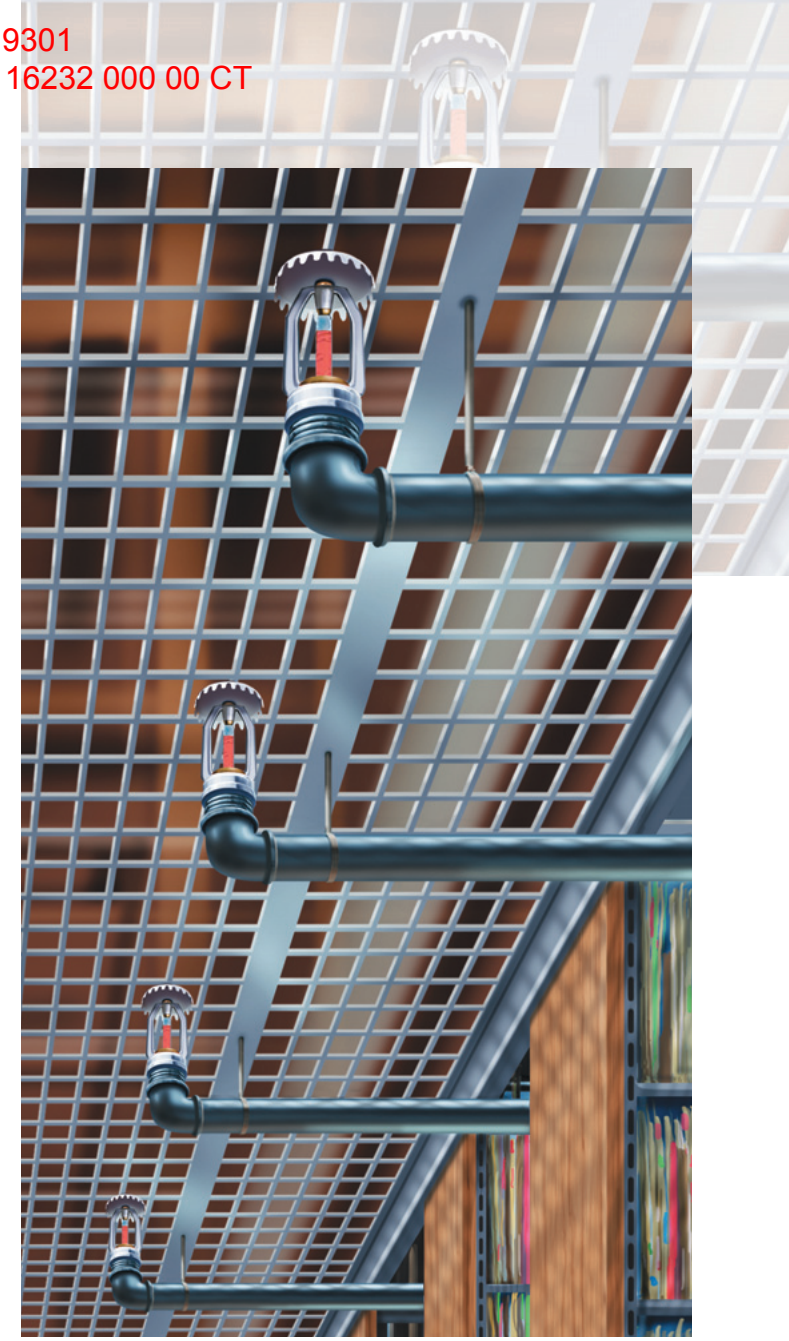

Schedule 10 and 40 Meet or Exceed These Standards

- UL & C-UL Listed
- FM Approved
- ASTM A135, Grade A (Schedule 10)
- ASTM A795, type E, Grade A (Schedule 40)

Green: The steel used to produce Wheatland's sprinkler pipe contains recycled steel and is virtually totally recyclable.

Seismic/Sway Bracing: Wheatland sprinkler pipe data tables are available for determining the forces for piping used as a sway brace component or in Seismic applications.

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

Schedule 10 and Schedule 40 Charts

Schedule 10 Specifications

NPS	Nominal O.D.		Nominal I.D.		Nominal Wall		Nominal Weight		UL	Pieces
	in.	mm	in.	mm	in.	mm	lbs./ft.	kg/m	CRR*	Lift
1 1/4	1.660	42.2	1.442	36.6	.109	2.77	1.81	2.69	7.3	61
1 1/2	1.900	48.3	1.682	42.7	.109	2.77	2.09	3.11	5.8	61
2	2.375	60.3	2.157	54.8	.109	2.77	2.64	3.93	4.7	37
2 1/2	2.875	73.0	2.635	66.9	.120	3.05	3.53	5.26	3.5	30
3	3.500	88.9	3.260	82.8	.120	3.05	4.34	6.46	2.6	19
4	4.500	114.3	4.260	108.2	.120	3.05	5.62	8.37	1.6	19
5	5.563	141.3	5.295	134.5	.134	3.40	7.78	11.58	1.5	13
6	6.625	168.3	6.357	161.5	.134	3.40	9.30	13.85	1.0	10

* Calculated using Standard UL CRR formula, UL Fire Protection Directory, Category VIZY
* The CRR is a ratio value used to measure the ability of a pipe to withstand corrosion. Threaded Schedule 40 steel pipe is used as the benchmark (value of 1.0).

Schedule 40 Specifications

NPS	Nominal O.D.		Nominal I.D.		Nominal Wall		Nominal Weight		UL	Pieces
	in.	mm	in.	mm	in.	mm	lbs./ft.	kg/m	CRR*	Lift
1″	1.315	33.4	1.049	26.6	.133	3.38	1.68	2.50	1.00	70
1 1/4″	1.660	42.2	1.380	35.1	.140	3.56	2.27	3.39	1.00	51
1 1/2″	1.900	48.3	1.610	40.9	.145	3.68	2.72	4.05	1.00	44
2″	2.375	60.3	2.067	52.5	.154	3.91	3.66	5.45	1.00	30

* Calculated using Standard UL CRR formula, UL Fire Protection Directory, Category VIZY
* The CRR is a ratio value used to measure the ability of a pipe to withstand corrosion. Threaded Schedule 40 steel pipe is used as the benchmark (value of 1.0).

Weights/Dimensions Black Plain End

Nominal Size	O.D. Inches	Sch. 40		Sch. 80	
		Wall Inches	Wt. Lb./Ft.	Wall Inches	Wt. Lb./Ft.
1/8″	.405	.068	.24	.095	.31
1/4″	.540	.088	.43	.119	.54
3/8″	.675	.091	.57	.126	.74
1/2″	.840	.109	.85	.147	1.09
3/4″	1.050	.113	1.13	.154	1.48
1″	1.315	.133	1.68	.179	2.17
1-1/4″	1.660	.140	2.27	.191	3.00
1-1/2″	1.900	.145	2.72	.200	3.63
2″	2.375	.154	3.66	.218	5.03
2-1/2″	2.875	.203	5.80	.276	7.67
3″	3.500	.216	7.58	.300	10.26
3-1/2″	4.000	.226	9.12	.318	12.52
4″	4.500	.237	10.80	.337	15.00

Technical Data Charts

PRODUCT NPS	NOM. I.D.	WT/FT LBS	WT/FT H_2O FILLED	PCS/ LIFT	WT/LIFT 21'	WT/LIFT 24'	WT/LIFT 25'
Schedule 10							
1 1/4"	1.442	1.807	2.514	61	2,315	2,645	2,756
1 1/2"	1.682	2.087	3.049	61	2,673	3,055	3,183
2"	2.157	2.640	4.222	37	2,051	2,344	2,442
2 1/2"	2.635	3.534	5.895	30	2,226	2,544	2,651
3"	3.260	4.336	7.949	19	1,730	1,977	2,060
4"	4.260	5.619	11.789	19	2,242	2,562	2,669
5"	5.295	7.780	17.309	13	2,124	2,427	2,529
6"	6.357	9.298	23.038	10	1,953	2,232	2,325
Schedule 40							
1"	1.049	1.681	2.055	70	2,471	2,824	2,942
1 1/4"	1.380	2.275	2.922	51	2,437	2,785	2,901
1 1/2"	1.610	2.720	3.602	44	2,513	2,872	2,992
2"	2.067	3.656	5.109	30	2,303	2,632	2,742

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

SMITH-COOPER®
INTERNATIONAL

Ductile Iron Threaded Fittings

Specifications

- SCI Branded Ductile Iron Threaded Fittings are UL Listed and FM Approved at 500 psi
- Rated to 300 WSP
- Ductile Iron Castings conform to ASTM A536
- Fitting dimensions conform to ASME B16.3
- Bushings and Plugs conform to ASME B16.14
- Fittings are 100% air tested
- NPT threads on all fittings conform to ASME B1.20.1
- Independent lab verification that fittings meet applicable chemical & physical properties
- Manufacturing facilities are ISO 9001:2008 and ISO 14001

c UL us LISTED

FM APPROVED

Temperature Degrees F	Working Pressure, Nonshock psiG 300# Class Threaded Fittings
-20 to 100	500
150	500
200	480
250	460
300	440
350	420
400	400
450	380
500	360
550	340
600	320
650	300

RSN 1119301
PERMONO 20161 FM23203 0313 CT

c UL us LISTED FM APPROVED

Fig. 35E 3 – 90° Elbow



Size IN	Part Number	List Price	Packing	Weight LB
1/2	35E 3004	$8.88	100/200	0.2317
3/4	35E 3006	$9.30	70/140	0.3681
1	35E 3010	$10.69	40/80	0.5361
1-1/4	35E 3012	$16.85	25/50	0.8516
1-1/2	35E 3014	$24.35	18/36	1.1312
2	35E 3020	$36.83	10/20	1.8344
2-1/2	35E 3024	$80.65	4/8	3.3755

Fig. 35RE3 – 90° Reducing Elbow



Size IN	Part Number	List Price	Packing	Weight LB
3/4 x 1/2	35RE3006004	$17.45	80/160	0.3071
1 x 1/2	35RE3010004	$13.23	70/140	0.4242
1 x 3/4	35RE3010006	$14.20	50/100	0.5038
1-1/4 x 1/2	35RE3012004	$23.60	35/70	0.5509
1-1/4 x 3/4	35RE3012006	$25.06	35/70	0.6455
1-1/4 x 1	35RE3012010	$20.95	30/60	0.7680
1-1/2 x 1/2	35RE3014004	$40.24	30/60	0.6351
1-1/2 x 3/4	35RE3014006	$32.46	25/50	0.7726
1-1/2 x 1	35RE3014010	$29.16	20/40	0.8991
1-1/2 x 1-1/4	35RE3014012	$29.16	18/36	0.9962
2 x 1/2	35RE3020004	$68.26	18/36	0.9680
2 x 3/4	35RE3020006	$48.92	18/36	1.0782
2 x 1	35RE3020010	$47.57	16/32	1.2214
2 x 1-1/4	35RE3020012	$63.72	12/24	1.3961
2 x 1-1/2	35RE3020014	$47.57	10/20	1.5233
2-1/2 x 1-1/2	35RE3024014	$125.03	6/12	2.2376
2-1/2 x 2	35RE3024020	$110.79	6/12	2.6699

Fig. 35F 3 – 45° Elbow



Size IN	Part Number	List Price	Packing	Weight LB
1/2	35F 3004	$14.02	150/300	0.2009
3/4	35F 3006	$14.16	80/160	0.3287
1	35F 3010	$16.63	40/80	0.5443
1-1/4	35F 3012	$22.09	25/50	0.7874
1-1/2	35F 3014	$36.83	20/40	1.0303
2	35F 3020	$42.55	10/20	1.6687
2-1/2	35F 3024	$108.29	4/8	2.9223

Fig. 35T 3 – Tee



Size IN	Part Number	List Price	Packing	Weight LB
1/2	35T 3004	$14.28	80/160	0.3032
3/4	35T 3006	$16.68	30/60	0.5161
1	35T 3010	$15.23	25/50	0.7522
1-1/4	35T 3012	$28.24	10/20	1.1891
1-1/2	35T 3014	$35.75	10/20	1.5682
2	35T 3020	$50.49	6/12	2.4411
2-1/2	35T 3024	$127.49	4/8	4.2968

Fig. 35BT3 – Bull Head Tee



Size IN	Part Number	List Price	Packing	Weight LB
3/4 x 1	35BT3006010	$27.32	30/60	0.6283
1 x 1-1/4	35BT3010012	$27.97	20/40	0.9966
1 x 1-1/2	35BT3010014	$49.73	15/30	1.1229
1-1/4 x 1 x 1-1/2	35BT3012010014	$35.96	15/30	1.2729
1-1/4 x 1-1/2	35BT3012014	$49.63	15/30	1.3847
1-1/4 x 2	35BT3012020	$75.06	10/20	1.6500
1-1/2 x 1-1/4 x 2	35BT3014012020	$75.06	10/20	1.8445
1-1/2 x 2	35BT3014020	$73.49	8/16	1.9329
2 x 2-1/2	35BT3020024	$134.02	4/8	3.2545

Fig. 35RT3 – Reducing Tee



Size IN	Part Number	List Price	Packing	Weight LB
3/4 x 1/2	35RT3006004	$23.51	60/120	0.4303
1 x 1/2	35RT3010004	$17.23	30/60	0.6514
1 x 1/2 x 1	35RT3010004010	$18.41	30/60	0.6912
1 x 3/4	35RT3010006	$20.74	25/50	0.7262
1 x 3/4 x 3/4	35RT3010006006	$27.97	35/70	0.6206
1 x 3/4 x 1	35RT3010006010	$21.87	25/50	0.7487
1-1/4 x 1/2	35RT3012004	$26.84	20/40	0.8837
1-1/4 x 1/2 x 1-1/4	35RT3012004012	$41.39	25/50	0.9871
1-1/4 x 3/4	35RT3012006	$30.08	15/30	0.9689
1-1/4 x 3/4 x 1-1/4	35RT3012006012	$38.59	20/40	1.0019
1-1/4 x 1	35RT3012010	$27.54	15/30	1.0703
1-1/4 x 1 x 1/2	35RT3012010004	$27.97	25/50	0.7744
1-1/4 x 1 x 3/4	35RT3012010006	$31.64	20/40	0.8589
1-1/4 x 1 x 1	35RT3012010010	$27.97	20/40	0.9869
1-1/4 x 1 x 1-1/4	35RT3012010012	$27.97	15/30	1.1295
1-1/2 x 1/2	35RT3014004	$35.05	16/32	1.0723
1-1/2 x 1/2 x 1-1/4	35RT3014004012	$61.54	18/36	1.1462
1-1/2 x 1/2 x 1-1/2	35RT3014004014	$54.14	12/24	1.2731
1-1/2 x 3/4	35RT3014006	$38.93	16/32	1.1772
1-1/2 x 3/4 x 1-1/4	35RT3014006012	$61.54	20/40	1.2162
1-1/2 x 3/4 x 1-1/2	35RT3014006014	$54.14	18/36	1.2852
1-1/2 x 1	35RT3014010	$35.05	12/24	1.3270
1-1/2 x 1 x 1/2	35RT3014010004	$56.21	20/40	0.9220
1-1/2 x 1 x 3/4	35RT3014010006	$52.60	16/32	0.9860
1-1/2 x 1 x 1	35RT3014010010	$49.63	16/32	1.1220
1-1/2 x 1 x 1-1/4	35RT3014010012	$62.59	12/24	1.2837
1-1/2 x 1 x 1-1/2	35RT3014010014	$35.96	12/24	1.4247
1-1/2 x 1-1/4	35RT3014012	$50.06	12/24	1.4414
1-1/2 x 1-1/4 x 1/2	35RT3014012004	$38.93	16/32	1.0039
1-1/2 x 1-1/4 x 3/4	35RT3014012006	$38.93	16/32	1.0861
1-1/2 x 1-1/4 x 1	35RT3014012010	$35.75	16/32	1.2210
1-1/2 x 1-1/4 x 1-1/4	35RT3014012012	$49.66	14/28	1.3798
1-1/2 x 1-1/4 x 1-1/2	35RT3014012014	$49.66	14/28	1.5642
2 x 1/2	35RT3020004	$50.76	10/20	1.5580
2 x 3/4	35RT3020006	$50.76	10/20	1.6570
2 x 1	35RT3020010	$50.76	8/16	1.8273
2 x 1 x 2	35RT3020010020	$50.76	8/16	2.0788
2 x 1-1/4	35RT3020012	$55.08	8/16	1.9969
2 x 1-1/4 x 2	35RT3020012020	$55.08	8/16	2.1542
2 x 1-1/2	35RT3020014	$58.27	8/16	2.1450
2 x 1-1/2 x 1/2	35RT3020014004	$57.56	10/20	1.3941
2 x 1-1/2 x 3/4	35RT3020014006	$57.56	10/20	1.4784
2 x 1-1/2 x 1	35RT3020014010	$50.98	8/16	1.6139
2 x 1-1/2 x 1-1/4	35RT3020014012	$77.60	8/16	1.7340
2 x 1-1/2 x 1-1/2	35RT3020014014	$75.06	8/16	1.9415
2 x 1-1/2 x 2	35RT3020014020	$57.56	8/16	2.2684

RSN 1119301
PERMIT NO. 2016-1-1623-03000 CT

c UL us LISTED FM APPROVED

Fig. 35CP3 – Straight Coupling with Ribs



Size IN	Part Number	List Price	Packing	Weight LB
1/2	35CP3004	$5.72	200/400	0.1459
3/4	35CP3006	$7.52	100/200	0.2453
1	35CP3010	$9.34	60/120	0.3520
1-1/4	35CP3012	$13.93	35/70	0.5542
1-1/2	35CP3014	$19.33	25/50	0.7674
2	35CP3020	$28.89	15/30	1.1686
2-1/2	35CP3024	$61.38	9/18	2.1487

Fig. 35RC3 – Hex Reducing Coupling



Size IN	Part Number	List Price	Packing	Weight LB
1 x 1/2	35RC3010004	$9.56	80/160	0.3584
1 x 3/4	35RC3010006	$12.74	60/120	0.4494
1-1/4 x 3/4	35RC3012006	$25.53	40/80	0.6633
2 x 1 (not hex)	35RC3020010	$68.86	20/40	1.0723

Fig. 35HB3 – Hex Bushing



Size IN	Part Number	List Price	Packing	Weight LB
1 x 1/2	35HB3010004	$10.26	180/360	0.2075
1 x 3/4	35HB3010006	$10.26	180/360	0.1712
1-1/4 x 1	35HB3012010	$11.61	90/180	0.3001
1-1/2 x 1	35HB3014010	$13.23	75/150	0.4891
1-1/2 x 1-1/4	35HB3014012	$13.23	75/150	0.3027
2 x 1	35HB3020010	$18.52	40/80	0.6149
2 x 1-1/4	35HB3020012	$18.52	40/80	0.7300
2 x 1-1/2	35HB3020014	$19.17	40/80	0.6154

Fig. 35SP3 – Square Head Plug



Size IN	Part Number	List Price	Packing	Weight LB
1/2	35SP3004	$3.26	600/1200	0.0809
3/4	35SP3006	$4.27	360/720	0.1234
1	35SP3010	$5.37	200/400	0.1914
1-1/4	35SP3012	$7.28	100/200	0.3137
1-1/2	35SP3014	$8.86	80/160	0.4151
2	35SP3020	$12.98	45/90	0.6428

Fig. 35U 3 – Union with Brass Seat



Size IN	Part Number	List Price	Packing	Weight LB
1	35U 3010	$50.84	20/40	0.7498
1-1/4	35U 3012	$70.48	15/30	1.1465
1-1/2	35U 3014	$93.04	10/20	1.6031
2	35U 3020	$117.33	6/12	2.1732

Fig. 35X 3 – Cross



Size IN	Part Number	List Price	Packing	Weight LB
1	35X 3010	$45.04	20/40	0.9845
1-1/4	35X 3012	$63.45	12/24	1.4645
1-1/2	35X 3014	$82.13	8/16	1.9309
2	35X 3020	$116.48	6/12	2.9225

Fig. 35RX3 – Reducing Cross



Size IN	Part Number	List Price	Packing	Weight LB
1-1/4 x 1	35RX3012010	$56.43	15/30	1.2586
1-1/2 x 1	35RX3014010	$82.13	12/24	1.4751
2 x 1	35RX3020010	$118.31	8/16	1.8988

Fig. 35C 3 – Cap



Size IN	Part Number	List Price	Packing	Weight LB
1/2	35C 3004	$6.23	300/600	0.1115
3/4	35C 3006	$7.41	200/400	0.1769
1	35C 3010	$11.61	110/220	0.3131
1-1/4	35C 3012	$15.71	70/140	0.4486
1-1/2	35C 3014	$20.95	50/100	0.5427
2	35C 3020	$28.24	25/50	0.8771
2-1/2	35C 3024	$78.39	18/36	1.5453

Fig. 35BC3 – Beam Clamp



Size IN	Part Number	List Price	Packing	Weight LB
3/8	35BC3003	$7.41	100/200	0.2941
1/2	35BC3004	$10.94	80/160	0.5012

Fig. 200 - "Trimline" Adjustable Band Hanger

Size Range — 1/2" thru 8" pipe

Material — Carbon Steel, Mil. Galvanized to G90 specifications

Function — For fire sprinkler and other general piping purposes. Knurled swivel nut design permits hanger adjustment after installation.

Features —


- (1/2" thru 2") Flared edges ease installation for all pipe types and protect CPVC plastic pipe from abrasion. Captured design keeps adjusting nut from separating with hanger. Hanger is easily installed around pipe.
- (2 1/2" thru 8" Spring tension on nut holds it securely in hanger before installation. Adjusting nut is easily removed.

Approvals — Underwriters' Laboratories listed (1/2" thru 8") in the USA **(UL)** and Canada **(cUL)** for steel and CPVC plastic pipe and Factory Mutual Engineering Approved (3/4" thru 8"). Conforms to Federal Specifications WW-H-171E, Type 10 and Manufacturers Standardization Society SP-69, Type 10.


Maximum Temperature — 650°F

Finish — Mil. Galvanized. For Stainless Steel materials, order TOLCO™ Fig. 200WON.


Order By — Figure number and pipe size

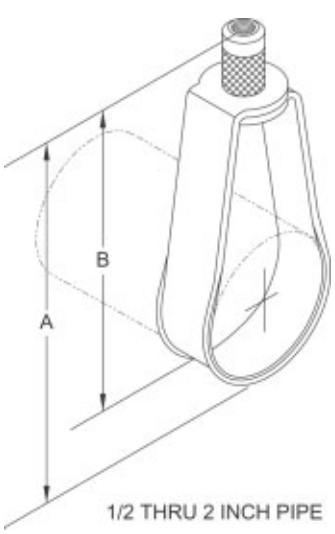

1/2 THRU 2 INCH PIPE

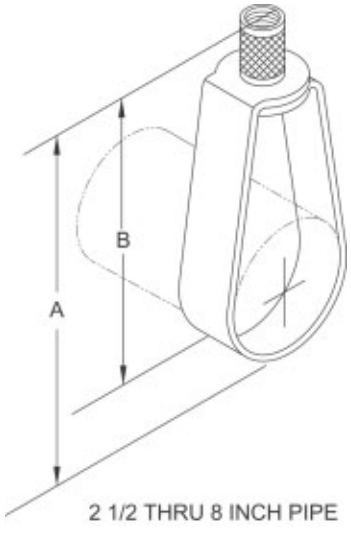

2 1/2 THRU 8 INCH PIPE

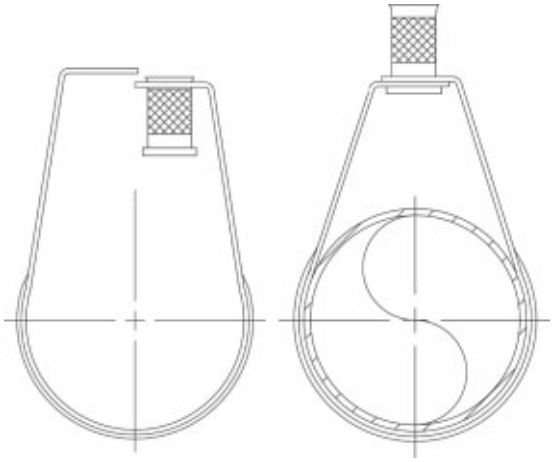

Dimensions • Weights


Pipe Size	Rod Size Inch	Rod Size Metric	A	B	Max. Rec. Load Lbs.	Approx. Length
1/2	3/8	8mm or 10mm	3 1/8	2 5/8	400	11
3/4	3/8	8mm or 10mm	3 1/8	2 1/2	400	11
1	3/8	8mm or 10mm	3 3/8	2 5/8	400	12
1 1/4	3/8	8mm or 10mm	3 3/4	2 7/8	400	13
1 1/2	3/8	8mm or 10mm	3 7/8	2 7/8	400	14
2	3/8	8mm or 10mm	4 1/2	3	400	15
2 1/2	3/8	10mm	5 5/8	4 1/8	600	27
3	3/8	10mm	5 7/8	4	600	29
3 1/2	3/8	10mm	7 3/8	5 1/4	600	34
4	3/8	10mm	7 3/8	5	1000	35
5	1/2	12mm	9 1/8	6 1/4	1250	66
6	1/2	12mm	10 1/8	6 3/4	1250	73
8	1/2	12mm	13 1/8	8 3/4	1250	136

Main Office/Manufacturing Facility • 1375 Sampson Ave. • Corona, CA 92879 • Ph: 909.737.5599 • Fax: 909.737.0330
Customer Service • 800.786.5266
www.tolco.com

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

4.3.8 HDI & HDI-L Drop-In Anchor

4.3.8.1 Product Description
4.3.8.2 Material Specifications
4.3.8.3 Technical Data
4.3.8.4 Installation Instructions
4.3.8.5 Ordering Information

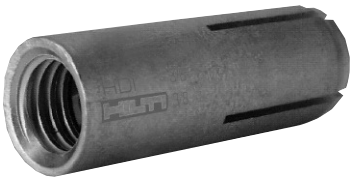



Listings/Approvals

ICC-ES (International Code Council)
ER-2895 (HDI Only)

COLA (City of Los Angeles)
Research Report No. 23709 (HDI Only)

FM (Factory Mutual)
Pipe Hanger Components for Automatic Sprinkler Systems (3/8" - 3/4") (HDI and HDI-L)

UL (Underwriters Laboratories)
UL 203 Pipe Hanger Equipment for Fire Protection Services (3/8" - 3/4")

4.3.8.1 Product Description

The Hilti HDI/HDI-L Drop-In anchor is an internally threaded, flush mounted expansion anchor for use in concrete.

Product Features

HDI

- Anchor, setting tool and Hilti drill bit form a matched tolerance system to provide reliable fastenings
- Below surface setting for easy patchwork
- Allows shallow embedment without sacrificing performance
- Lip provides flush installation, consistent anchor depth, and easy rod alignment (HDI-L)
- Lip allows accurate flush surface setting, independent of hole depth (HDI-L)
- Ideal for repetitive fastenings with threaded rods of equal length
- Intelligent expansion section adapts to the base material and reduces number of hammer blows up to 50% (HDI-L)

Guide Specifications

Expansion Anchor Expansion anchors shall be flush or shell type and zinc plated in accordance with ASTM B 633, SC 1, Type III. Anchors shall be Hilti HDI/HDI-L anchors as supplied by Hilti.

Installation Install shell or flush type anchors in holes drilled with Hilti carbide tipped drill bits. Install anchors as per manufacturer's recommendations.

4.3.8.2 Material Specifications

HDI/HDI-L, 1/4", 3/8", 1/2", and HDI 5/8" and 3/4" are manufactured from mild carbon steel which is plated with a zinc finish for corrosion protection in accordance with ASTM B 633, SC 1, Type III

HDI Stainless Steel material meets the requirements of AISI 303

4.3.8.3 Technical Data

HDI/HDI-L Specification Table

Details		Anchor Size in. (mm)	HDI/HDI-L 1/4 (6.4)	HDI/HDI-L 3/8 (9.5)	HDI/HDI-L 1/2 (12.7)	HDI 5/8 (15.9)	HDI 3/4 (19.1)
d_{bit}	Bit diameter[1]	in.	3/8	1/2	5/8	27/32	1
h_{nom} ℓ h_1	Std. depth of embed. Anchor length Hole depth	in. (mm)	1 (25)	1-9/16 (40)	2 (51)	2-9/16 (65)	3-3/16 (81)
ℓ_{th}	Useable thread length	in. (mm)	7/16 (11)	5/8 (15)	11/16 (17)	7/8 (22)	1-3/8 (34)
	Threads per inch		20	16	13	11	10
h	min. base material thickness	in. (mm)	3 (76)	3-1/8 (79)	4 (102)	5-1/8 (130)	6-3/8 (162)
T_{max}	max. tightening torque	ft-lb (Nm)	4 (5.4)	11 (14.9)	22 (29.8)	37 (50.2)	80 (108.5)

1 For Hilti matched tolerance carbide tipped drill bits, see section 8.4.1.

Combined Shear and Tension Loading

$$\left(\frac{N_d}{N_{rec}}\right)^{5/3} + \left(\frac{V_d}{V_{rec}}\right)^{5/3} \leq 1.0 \quad \text{(Ref. Section 4.1.2.7)}$$

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

HDI & HDI-L Drop-In Anchor 4.3.8

Carbon Steel HDI Allowable Loads in Concrete

Anchor size in. (mm)	2000 psi (13.8 MPa)				4000 psi (27.6 MPa)				6000 psi (41.4 MPa)			
	Tension lb (kN)		Shear lb (kN)		Tension lb (kN)		Shear lb (kN)		Tension lb (kN)		Shear lb (kN)	
	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L
1/4 (6.4)	500 (2.2)	500 (2.2)	450 (8.0)	450 (8.0)	570 (2.5)	570 (2.5)	625 (2.8)	625 (2.8)	790 (3.5)	790 (3.5)	700 (3.1)	700 (3.1)
3/8 (9.5)	890 (4.0)	890 (4.0)	965 (4.3)	965 (4.3)	1115 (5.0)	1115 (5.0)	1250 (5.6)	1250 (5.6)	1360 (6.0)	1360 (6.0)	1500 (6.7)	1500 (6.7)
1/2 (12.7)	1120 (5.0)	1120 (5.0)	1500 (6.7)	1500 (6.7)	1785 (7.9)	1785 (7.9)	2125 (9.5)	1940 (8.6)	2345 (10.4)	2345 (10.4)	2500 (11.1)	2500 (11.1)
5/8 (15.9)	1875 (8.3)	–	2500 (11.1)	–	2920 (13.0)	–	3250 (14.5)	–	3715 (16.5)	–	3750 (16.7)	–
3/4 (19.1)	2500 (11.1)	–	3875 (17.2)	–	4065 (18.1)	–	5000 (22.2)	–	5565 (24.8)	–	5500 (24.5)	–

Note: The ultimate shear and allowable shear values are based on the use of SAE Grade 5 bolts, (f_y = 85 ksi, F_{ult} = 120 ksi) with the exception of the 1/4" HDI/HDI-L in f'_c = 6000 psi concrete which is based upon the use of a SAE Grade 8 bolt (f_y = 120 ksi, F_{ult} = 150 ksi).

Carbon Steel HDI Ultimate Loads in Concrete

Anchor size in. (mm)	2000 psi (13.8 MPa)				4000 psi (27.6 MPa)				6000 psi (41.4 MPa)			
	Tension lb (kN)		Shear lb (kN)		Tension lb (kN)		Shear lb (kN)		Tension lb (kN)		Shear lb (kN)	
	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L	HDI	HDI-L
1/4 (6.4)	1995 (8.9)	1995 (8.9)	1800 (8.0)	1800 (8.0)	2270 (10.1)	2270 (10.1)	2500 (11.1)	2500 (11.1)	3150 (14.0)	3150 (14.0)	2800 (12.5)	2800 (12.5)
3/8 (9.5)	3555 (15.8)	3555 (15.8)	3850 (17.1)	3850 (17.1)	4460 (19.8)	4460 (19.8)	5000 (22.2)	5000 (22.2)	5430 (24.2)	5430 (24.2)	6000 (26.7)	6000 (26.7)
1/2 (12.7)	4470 (19.9)	4470 (19.9)	6000 (26.7)	6000 (26.7)	7140 (31.8)	7140 (31.8)	8500 (37.8)	7750 (34.4)	9375 (41.7)	9375 (41.7)	10000 (44.5)	10000 (44.5)
5/8 (15.9)	7500 (33.4)	–	10000 (44.5)	–	11685 (52.0)	–	13000 (57.8)	–	14865 (66.1)	–	15000 (66.7)	–
3/4 (19.1)	10000 (44.5)	–	15500 (69.0)	–	16260 (72.3)	–	20000 (89.0)	–	22250 (99.0)	–	22000 (97.9)	–

Carbon Steel HDI Allowable Loads in Lightweight Concrete and Lightweight Concrete over Metal Deck[1, 2]

Anchor Size in. (mm)	Anchor Installed in 3000 psi (20.7 MPa) Lt. Wt. Concrete[3]		Anchor Installed Through Steel Deck Upper Flute Into 3000 psi (20.7 MPa) Lt. Wt. Concrete[4]		Anchor Installed Through Steel Deck Lower Flute Into 3000 psi (20.7 MPa) Lt. Wt. Concrete[4]	
	Tension, lb (kN)	Shear, lb (kN)	Tension, lb (kN)	Shear, lb (kN)	Tension, lb (kN)	Shear, lb (kN)
1/4 (6.4)	465 (2.1)	340 (1.5)	530 (2.4)	335 (1.5)	375 (1.7)	250 (1.1)
3/8 (9.5)	755 (3.4)	940 (4.2)	880 (3.9)	1010 (4.5)	500 (2.2)	500 (2.2)
1/2 (12.7)	1135 (5.0)	1700 (7.6)	1105 (4.9)	1755 (7.8)	625 (2.8)	750 (3.3)
5/8 (15.9)	1465 (6.5)	2835 (12.6)	–	–	875 (3.9)	875 (3.9)
3/4 (19.1)	2075 (9.2)	3680 (16.4)	–	–	1250 (5.5)	1000 (4.4)

1 The allowable values are based on the use of SAE Grade 2 bolts installed in the anchors.

2 Based on using a safety factor of 4.0.

3 The tabulated shear and tensile values are for anchors installed in structural lightweight concrete having the designated ultimate compressive strength at the time of installation. The concrete must comply with ASTM C 330-77.

4 The tabulated shear and tensile values are for anchors installed through 20 gauge intermediate decking into structural lightweight concrete having the designated ultimate strength at the time of installation. The concrete must comply with ASTM C 330-77.

Stainless Steel HDI Allowable Loads in Concrete

Anchor size in. (mm)	4000 psi (27.6 MPa)		6000 psi (41.4 MPa)	
	Tension lb (kN)	Shear lb (kN)	Tension lb (kN)	Shear lb (kN)
SS HDI – 1/4 (6.4)	480 (2.1)	600 (2.7)	740 (3.3)	600 (2.7)
SS HDI – 3/8 (9.5)	1040 (4.6)	1230 (5.5)	1460 (6.5)	1230 (5.5)
SS HDI – 1/2 (12.7)	1840 (8.2)	2760 (12.4)	2410 (10.7)	2760 (12.3)
SS HDI – 5/8 (15.9)	2630 (11.7)	4510 (20.1)	3770 (16.8)	4510 (20.1)
SS HDI – 3/4 (19.1)	3830 (17.0)	5580 (24.8)	5030 (22.4)	5580 (24.8)

Note: The ultimate and allowable shear values are based on the use of Type 18-8 bolts.

Stainless Steel HDI Ultimate Loads in Concrete

Anchor size in. (mm)	4000 psi (27.6 MPa)		6000 psi (41.4 MPa)	
	Tension lb (kN)	Shear lb (kN)	Tension lb (kN)	Shear lb (kN)
SS HDI – 1/4 (6.4)	1930 (8.6)	2400 (10.7)	2950 (13.1)	2400 (10.7)
SS HDI – 3/8 (9.5)	4170 (18.5)	4920 (21.9)	5850 (26.0)	4920 (21.9)
SS HDI – 1/2 (12.7)	7350 (32.7)	11040 (49.1)	9630 (42.8)	11040 (49.1)
SS HDI – 5/8 (15.9)	10540 (46.9)	18040 (80.2)	15100 (67.2)	18040 (80.2)
SS HDI – 3/4 (19.1)	15340 (68.2)	22320 (99.3)	20130 (89.5)	22320 (99.3)

RSN 1119301
PERMIT NO. 2016 1116232 000 00 CT

4.3.8 HDI & HDI-L Drop-In Anchor

Anchor Spacing and Edge Distance Guidelines (See Anchoring Technology Section 4.1.3)

Anchor Spacing Adjustment Factors

s = Actual Spacing

s_{min} = 2.0 h_{nom}


s_{cr} = 3.5 h_{nom}


Edge Distance Adjustment Factors


c = Actual edge distance

c_{min} = 2.0 h_{nom}

c_{cr} = 3.0 h_{nom}

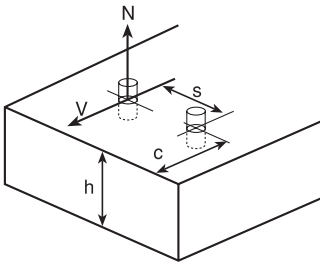

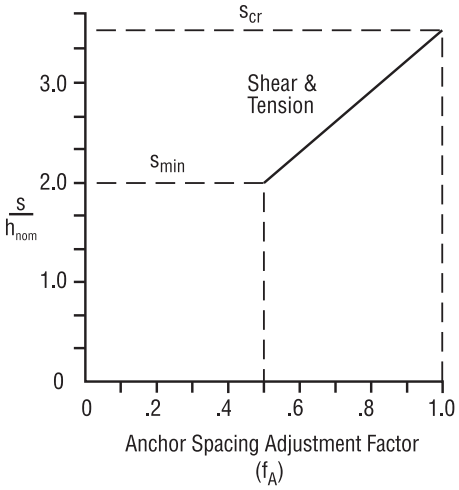

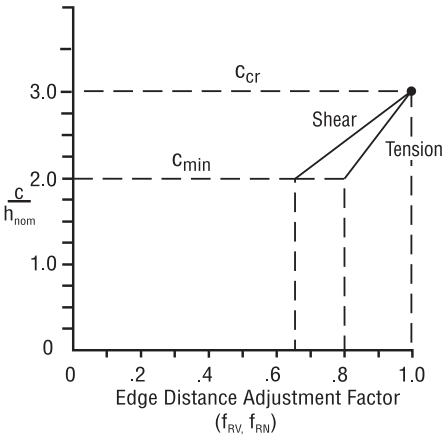

Influence of Anchor Spacing & Edge Distance f_A, f_R

Anchor Size in. (mm)	h_{nom} in. (mm)
1/4 (6.4)	**1** (25)
3/8 (9.5)	**1-9/16** (40)
1/2 (12.7)	**2** (51)
5/8 (15.8)	**2-9/16** (65)
3/4 (19.1)	**3-3/16** (81)

h_{nom} = standard embedment depth

Load Adjustment Factors (Anchor Spacing) f_A						Load Adjustment Factors (Edge Distance) f_R										
Tension/Shear Loads						Tension, f_{RN}						Shear, f_{RV}				
Spacing s in. (mm)	Anchor Diameter					Edge Distance c in. (mm)	Anchor Diameter					Anchor Diameter				
	1/4	3/8	1/2	5/8	3/4		1/4	3/8	1/2	5/8	3/4	1/4	3/8	1/2	5/8	3/4
2 (51)	.50					**2** (51)	.80					.65				
2-1/2 (64)	.67					**2-1/2** (64)	.90					.83				
3 (76)	.83	.50				**3** (76)	1.0	.80				1.0	.65			
3-1/2 (89)	1.0	.58				**3-1/2** (89)		.85					.73			
4 (102)		.69	.50			**4** (102)		.91	.80				.85	.65		
4-1/2 (114)		.79	.58			**4-1/2** (114)		.98	.85				.96	.74		
5 (127)		.90	.67	.50		**5** (127)		1.0	.90	.80			1.0	.83	.65	
5-1/2 (140)		1.0	.75	.55		**5-1/2** (140)			.95	.83				.91	.70	
6 (152)			.83	.61	.50	**6** (152)			1.0	.87				1.0	.77	
7 (178)			1.0	.74	.57	**6-1/2** (165)				.91	.80				.84	.65
8 (203)				.87	.67	**7** (178)				.95	.84				.91	.72
9 (229)				1.0	.77	**8** (203)				1.0	.90				1.0	.83
10 (254)					.88	**9** (229)					.96					.94
11 (279)					.98	**10** (254)					1.0					1.0
12 (305)					1.0											
s_{min} = 2.0 h_{nom}, s_{cr} = 3.5 h_{nom} $f_A = 0.33 \frac{s}{h_{nom}} - 0.17$ for $s_{cr} > s > s_{min}$						c_{min} = 2.0 h_{nom}, c_{cr} = 3.0 h_{nom} $f_{RN} = 0.2 \frac{c}{h_{nom}} + 0.4$ for $c_{cr} > c > c_{min}$						c_{min} = 2.0 h_{nom}, c_{cr} = 3.0 h_{nom} $f_{RV} = 0.35 \frac{c}{h_{nom}} - 0.05$ for $c_{cr} > c > c_{min}$				

Fig. 98 - Rod Stiffener

Component of State of California OSHPD Approved Seismic Restraints System

Size Range — Secures 3/8" thru 7/8" hanger rod

Material — Carbon Steel


Function — Secures channel to hanger rod for vertical seismic bracing.

Approvals — Underwriters Laboratories Listed in the USA (**UL**) and Canada (**cUL**). Included in our Seismic Restraints Catalog approved by the State of California Office of Statewide Health Planning and Development (**OSHPD**). For additional load, spacing and placement information relating to OSHPD projects, please refer to the TOLCO Seismic Restraint Systems Guidelines

Finish — Electro Galvanized

Note — Available in HDG finish or Stainless Steel materials.

Order By — Figure number

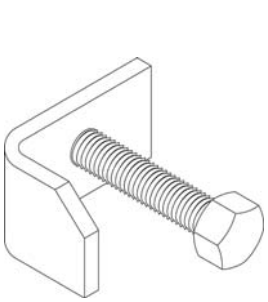

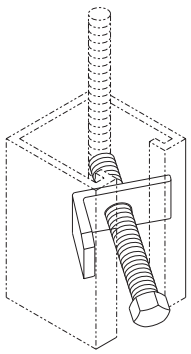


Fig. 99 - All Thread Rod Cut to Length

Size Range — Secures 3/8" thru 7/8" rod in 1" increments


Material — Carbon Steel

Maximum Temperature — 750°F

Finish — Plain

Note — Available in Electro-Galvanized and HDG finish or Stainless Steel materials.

Order By — Figure number, rod diameter, rod length and finish

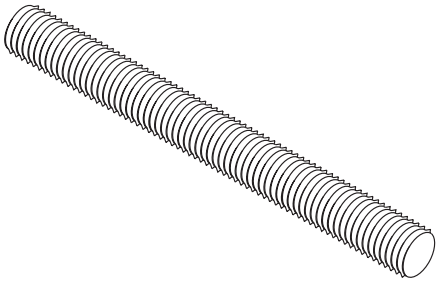

Dimensions • Weights

Rod Size	Max. Rec. Load Lbs. For Service Temps 650°F	750°F
3/8	610	540
1/2	1130	1010
5/8	1810	1610
3/4	2710	2420
7/8	3770	3360

Fig. 100 - All Thread Rod Full Lengths

Size Range — Secures 3/8" thru 7/8" rod in 10' lengths


Material — Carbon Steel

Maximum Temperature — 750°F

Finish — Plain

Note — Available in Electro-Galvanized and HDG finish or Stainless Steel materials.

Order By — Figure number, rod diameter and finish

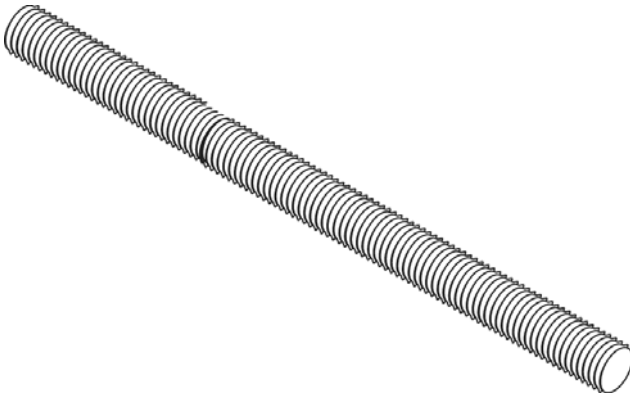

Dimensions • Weights

Rod Size	Max Rec. Load Lbs. For Service Temps 650°F	750°F	Approx. Wt./100
1/4	240	215	12
3/8	610	540	29
1/2	1130	1010	53
5/8	1810	1610	84
3/4	2710	2420	123
7/8	3770	3360	169
1	4960	4420	222
1 1/4	8000	7140	360
1 1/2	11630	10370	510

OFFICE/MANUFACTURING FACILITY • 1375 SAMPSON AVE. • CORONA, CA 92879 • PH: 951.737.5599 • FAX: 951.737.0330
CUSTOMER SERVICE • 800.786.5266
www.tolco.com