City of Aurora Public Works Department

# BUILDING PERMIT APPLICATION

Building Division • 15151 E. Alameda Parkway, Ste 2400 • Aurora, CO 80012 • 303-739-7420 • Fax: 303-739-7412
Email: **permitcounter@auroragov.org**

| | | |
|---|---|---|
| **Project Address** 1400 Potomac St | | **Unit #** 180 |
| **Project Name:** Invision Sallay Jobe | | |
| **Contractor Company Name** Fire Alarm System Technologies | **Phone** (720) 480-4647 | **Fax** (303) 794-4647 |
| **Contact Person** JP Hemming | **Phone** Same | |
| **Email** office@fastfireinc.com | | **Fax** |
| **Architect and/or Engineer Contact information for correction items** | | |
| **Architect or Engineer name** JP Hemming | **Email** office@fastfireinc.com | |
| **Phone** (720) 480-4647 | **Fax** (303) 794-4647 | |
| **Owner (Required for Certificate of Occupancy) only** | | |
| **Owner address** | | |
| **Email** | | |
| **Valuation / FDA:$** 200.00 | **Materials Cost: $** 50.00 | |

FDA = Fee Determination Assessment. (Also known as the value of project) has no relationship to the construction costs for the building which can vary greatly. Rather, The assessment is used only to determine the appropriate level of fees to fund our code compliance activities.

**Describe The Work You Will Be Doing:** Relocate 2 horn/strobes

I declare under penalty that this application has been examined by me and that the statements made herein are made in good faith pursuant to City of Aurora tax and licensing regulations; and to the best of my knowledge and belief are true, correct and complete.

**Print Name** Heather K. Hemming **Signature** [signature] **Date** 4/14/2014

**BOARD OF APPEALS:** Contractor's Appeals and Standards Board. Applicants have the right to have the board hear appeals of orders, decisions or determinations made by the building official relative to the application and interpretation of the building code. Any application for appeal to the board shall be based on a claim that the true intent of the code or the rules legally adopted there under have been incorrectly interpreted, the provisions of the building code do not fully apply or an equally good or better form of construction is proposed.

## THIS SPACE FOR OFFICE USE ONLY

Fee Determination Assessment: $ 200.00

Change of occupancy/use: ☐ Yes ☐ No

| **REVIEWS** | **INSPECTIONS** |
|---|---|
| ☐ Structural | ☐ Structural |
| ☐ Mechanical | ☐ Mechanical |
| ☐ Plumbing | ☐ Plumbing |
| ☐ Electrical | ☑ Electrical |
| ☐ Fire-Life Safety | ☒ Life Safety |
| ☐ Building Life Safety | ☐ Gate/Hazard |

Intake Date: _____

Balance Due: $ _____

**PRE APPROVAL** Initial _____ ☐ Zoning ☐ Water

Exterior changes? ☐ Yes ☐ No

Homeowner verified: ☐ Yes ☐ No

Permit Type: CT

Mid roof / Ave Bldg Height: N/A

Parent Permit RSN: 875446

Plans Examiner: [illegible]

Subtype: Alarm

RSN: 14-833336 885727

Plans Picked Up By: _____

Company Name: _____

Phone Number _____

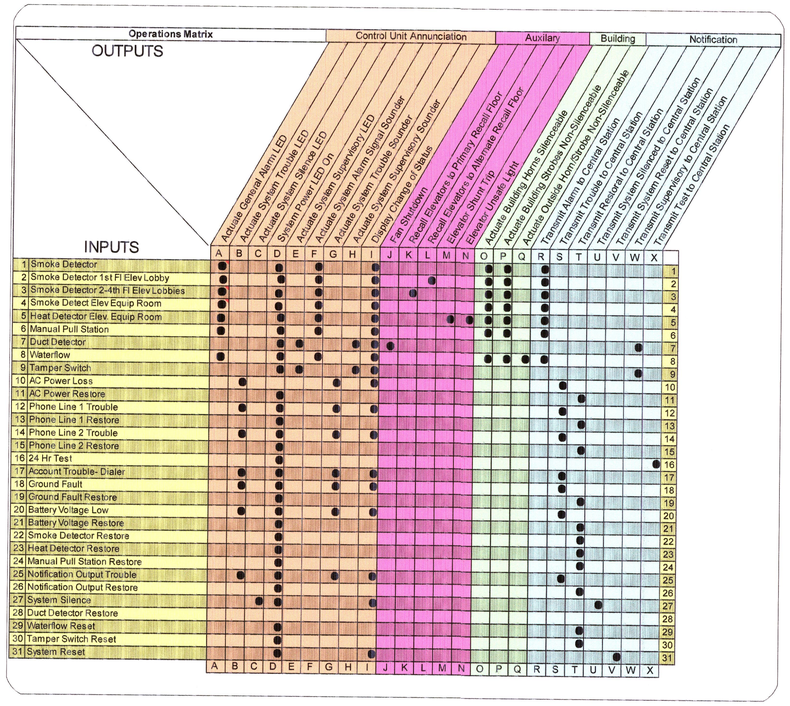


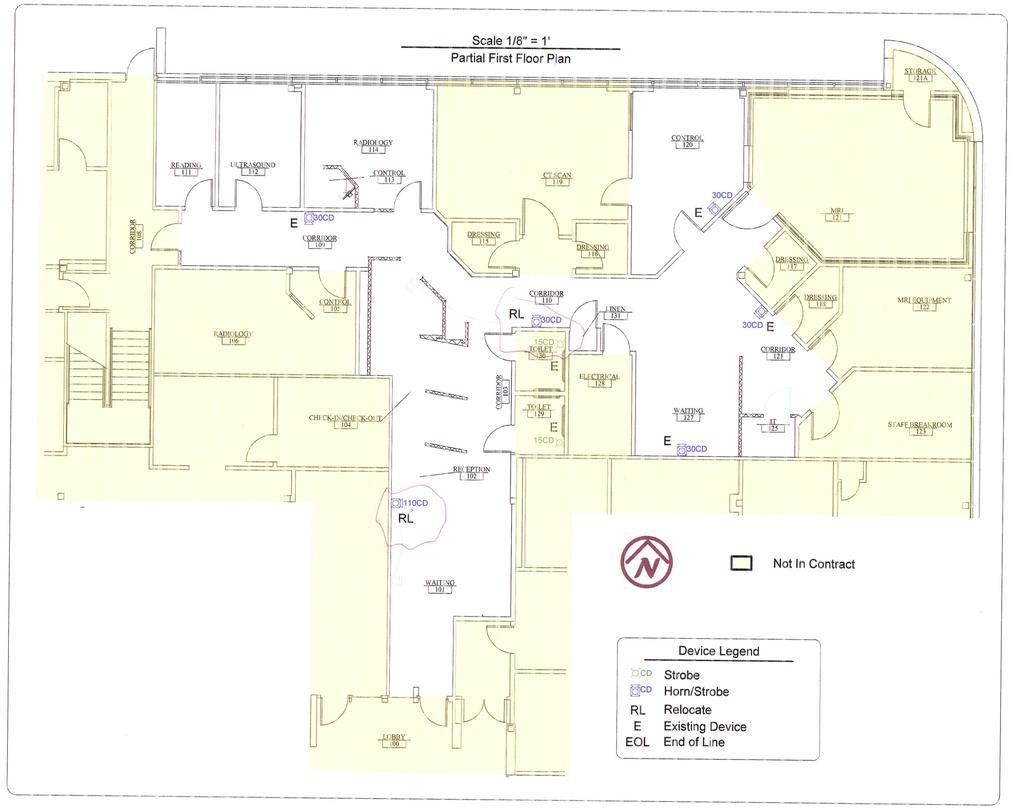


Installing Contractor

FAST Fire
Fire Alarm System Technologies, Inc.
4373 West Radcliff Ave.
Denver, CO 80236
720-480-4647

Designer
J.P. Hemming
NICET IV 100149 expires 4/1/2015
Fire Protection Engineering Technology
FAST Fire, Inc.
Fire Alarm System Technologies
4373 West Radcliff Ave.
Denver, CO 80236
720-480-4647

# Invision Sallay Jobe
1400 Potomac Street
Suite 180
Aurora, CO 80012
Fire Alarm System

## Wiring Details

HORN / STROBE




## Typical Device Mounting Heights for Wall Mounted Devices

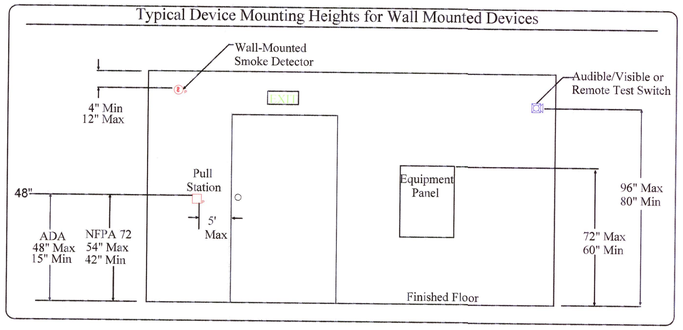


### Scope of Work

Relocate 2 horn/strobes as shown on drawings.

This is a required manual fire alarm system per IFC 2009 ed 907.2, with exception.

Ceiling flat, smooth at a height of 20' or less.

Horns are temporal III, horns and strobes are synchronous per Public Mode requirements.

### System Notes

No additional load added to initiation/ notification circuits.
No changes to existing FACP/SPCP battery loads.
EOL will be field verified to be greater than 16V.
No changes to existing one line.

### Codes and Standards

| | |
|---|---|
| Occupancy: | B |
| Occupancy Use: | Office |
| Construction Type: | (Type I FR) |
| Project Area: | 1,910 SF |
| Occupancy: | 20 |
| Number of Stories: | 4 |
| Sprinklered: | Throughout |

2009 IBC
2009 IFC
2011 NEC
2007 NFPA 72
Authority Having Jurisdiction:
Aurora Building Codes Division
15151 East Alameda Parkway
2nd Floor Permit Center
Aurora, CO 80012
(P) 303-739-7420 (F) 303-739-7551

### Wire Legend

Notification
Power Limited Plenumn Cable
Red (+), Black (-)
2C 14 Ga Class B

Initiation
Power Limited Plenumn Cable
Red (+), Black (-)
2C 18 Ga Class B

APPROVED
City of Aurora Building Division
2009 NFPA 72
Permit # 2014-833336-CT
FW 985727

Vicinity Map




### Equipment Supplier

N/A (No New Devices)

### General Contractor

Foothills Commercial Builders
7241 South Fulton Street
Centennial, CO 80112
303-755-5711

### Owner Representative

Radiology Imagin Associates
10700 East Geddes Avenue
Suite 200
Englewood, CO

### Monitoring Agency

Central Security
1117 8th Avenue
Greeley, CO 80631
970-352-3662

FA-1