City of Aurora
Building Codes Division
15151 E Alameda Pkwy
Aurora, CO 80012
(303) 739-7420

Notice

This material is subject to copyright protection pursuant to Federal Law: 17 United States Code Section 106.

Building Permit Application

Permit Center - 15151 E Alameda Pkwy ❖ Ste 2400 ❖ Aurora, CO 80012 ❖ (303)739-7420

Email buildingplans@auroragov.org

Project Address: 1501 S. Potomac Unit # Zip code:

Project Name: ICU 3RD FLOOR MEDICAL CENTER OF Aurora

Contractor Company Name: Brent Fleetwood Construction Phone: 303-210-3851 Fax: 303 467-3925

Contact Person: Brent Phone:

Email: BFC.Brent@Comcast.net Fax:

Architect and/or Engineer Contact information for correction items:

Architect or Engineer Name: The Design Plot (Tom) Email:

Phone #: 661-810-2671 Fax #:

Owner:(Required for Certificate of Occupancy) only:

Owner address:

Email:

Valuation / FDA$ $[redacted] $400,000 **Materials cost $** 200,000

FDA = Fee Determination Assessment. (Also known as the value of project. The Fee Determination Assessment, FDA has no relationship to the construction costs for the building which can vary greatly. Rather, the Assessment is used only to determine the appropriate level of fees to fund our code compliance activities.

Describe the work you will be doing:

Lay-out change, lighting change, electrical adds,

I declare under penalty that this application has been examined by me; and that the statements made herein are made in good faith pursuant to City of Aurora tax and licensing regulations; and to the best of my knowledge and belief are true, correct and complete.

Print Name: Brent Fleetwood **Signature:** [signature] **Date:** 9/23/11

BOARD OF APPEALS - Contractor's Appeals and Standards Board. Applicants have the right to have the board hear appeals of orders, decisions or determinations made by the building official relative to the application and interpretation of the building code. Any application for appeal to the board shall be based on a claim that the true intent of the code or the rules legally adopted there under have been incorrectly interpreted, the provisions of the building code do not fully apply or an equally good or better form of construction is proposed.

Sprinkler & Alarm permits are separate submittals, and the value is NOT included on main permit.

◆◆◆◆ **THIS SPACE FOR OFFICE USE ONLY** ◆◆◆◆

Change of occupancy/use: ☐ Yes ☒ No

FDA:

Reviews		Inspections	
☒	Structural	☒	Structural
☐	Mechanical	☐	Mechanical
☒	Plumbing	☒	Plumbing
☒	Electrical	☒	Electrical
☐	Fire Life Safety	☐	Life Safety
☒	Bldg Life Safety	☐	Gate/Haz.

Intake Date: 9-23-11 PE Initial SWE

Balance Due: $

Pre-approval(s): Zoning: ☒ Initials BF No Exterior

Water: ☒ 9.30

Exterior changes? ☐ Yes ☐ No

Homeowner Verified ☐ Yes

Permit Type ~~BF~~ TF

Mid roof /Avg. bldg height

Parent Permit RSN


Plans Examiner SWE

Sub Type ~~BF~~ TF

RSN: 624289

Plans Picked up by
Company Nam
Phone #

See reverse side for Fence/sign/Public Improvements application

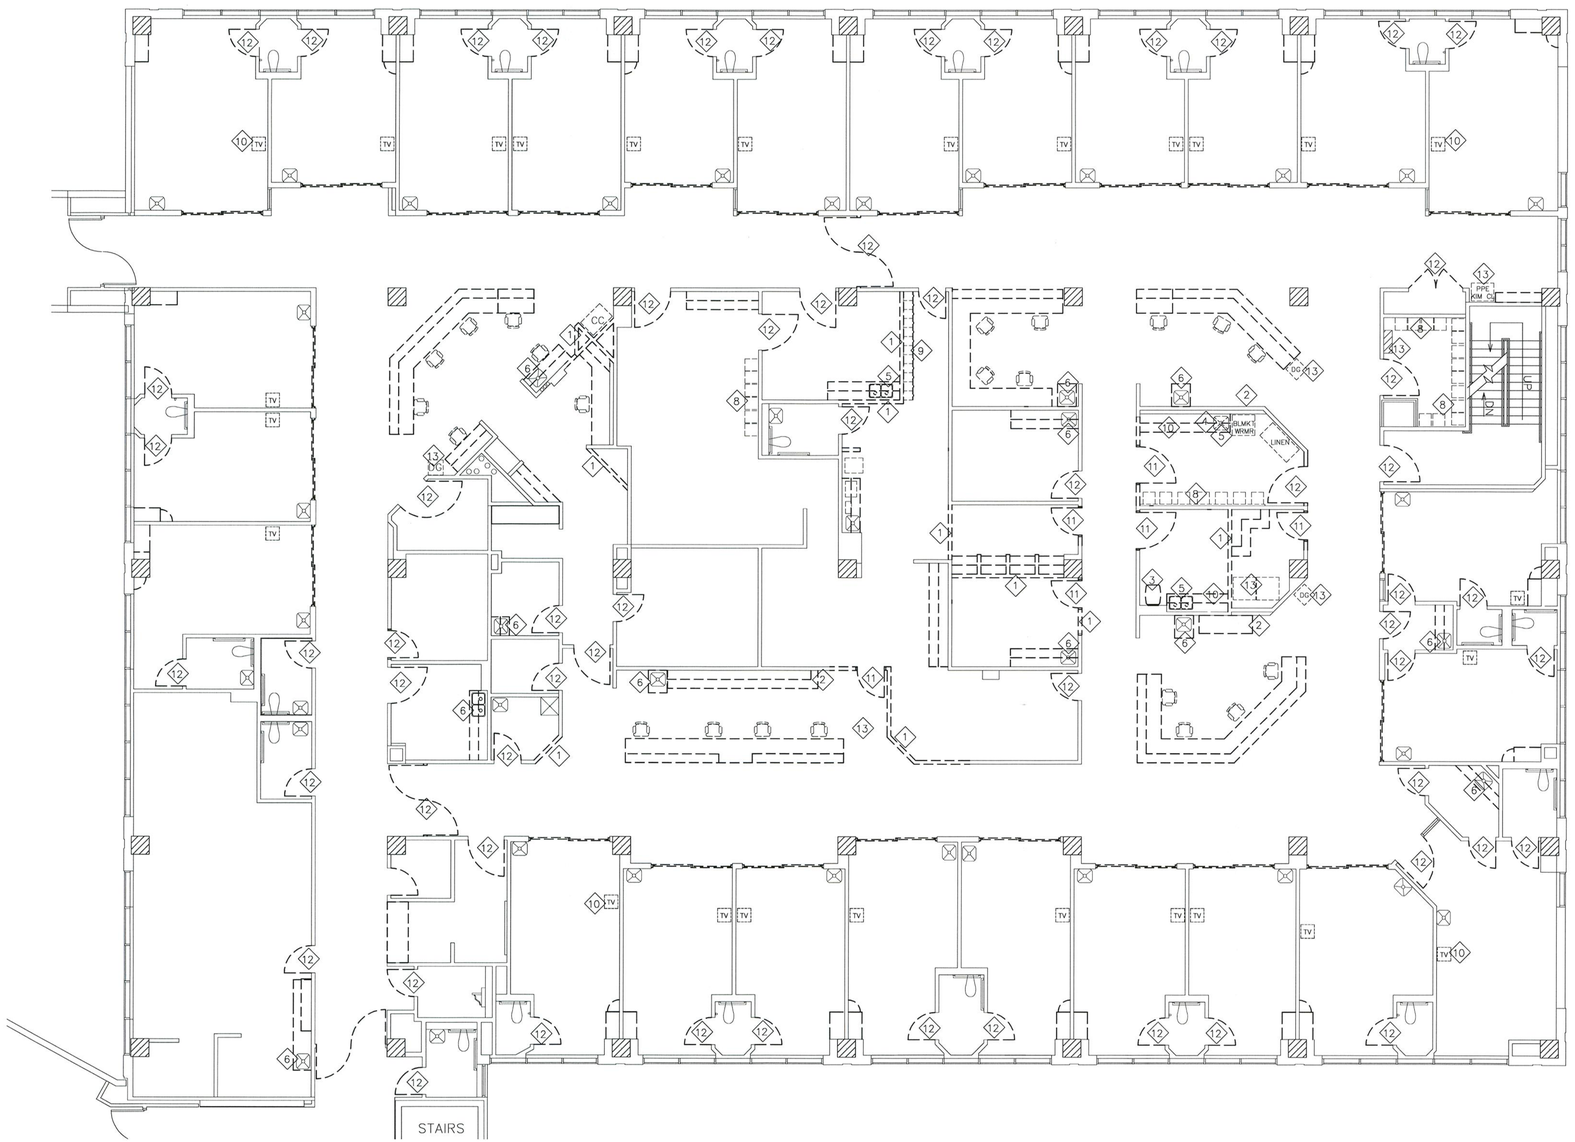

DEMOLITION PLAN
1/8" = 1'

DEMOLITION KEYNOTES:	
1	REMOVE SECTION OF WALL AS INDICATED IN DASHED LINE
2	REMOVE & DISPOSE OF WALL CABINETS
3	REMOVE & DISPOSE OF EXISTING HOPPER SINKS.
4	REMOVE PLUMBING. CAP IN FLOOR OR WALL TO ALLOW SMOOTH INSTALLATION OF NEW FINISHES.
5	REMOVE SINK: SAVE FOR REUSE
6	SINK TO REMAIN. PRESERVE PLUMBING FOR NEW CASEWORK
7	REMOVE & DISPOSE FIXTURES.
8	REMOVE WALL BINS & SUPPORTS. PREPARE WALLS FOR NEW FINISH
9	REMOVE & DISPOSE OF EXISTING LOCKERS
10	REMOVE PATIENT ROOM TELEVISIONS. INSTALL NEW BRACKET FOR NEW TV
11	REMOVE & DISPOSE OF EXISTING DOOR AND FRAME.
12	REMOVE & DISPOSE OF EXISTING DOOR. FRAME REMAINS FOR NEW DOOR
13	REMOVE EXISTING EQUIPMENT, SAVE AND STORE FOR OWNER & RELOCATION

GENERAL DEMOLITION NOTES:	
A.	SALVAGE EQUIPMENT AND SINKS/FAUCETS, ETC.
B.	WHERE SINKS ARE SHOWN BEING REMOVED, CAP BELOW FLOOR OR NEAREST WALL. INSTALL CHROME COVERPLATE AT WALL LOCATIONS TO CONSEAL ALL WALL DAMAGE AND ALLOW ACCESS TO VALVES, SHUTOFFS, ETC.
C.	REMOVE ALL DOORS, INCLUDING THOSE SHOWN AS EXISTING, AND REPLACE WITH SIMILAR SIZE AND HARWARE GROUP, AS ACROVYN DARK CHERRY DOORS TO MATCH HOSPITAL STANDARD.
D.	REMOVE CASEWORK AS INDICATED IN DASHED LINE
E.	REMOVE EXISTING SUSPENDED CEILING GRID THROUGHOUT. INSTALL NEW GRID AT SAME LOCATION. LIGHT FIXTURES, SPRINKLERS, AND MECHANICAL GRILLES SHALL BE SECURED IN ORIGINAL LOCATION (UNLESS NOTED OTHERWISE) DURING CEILING REPLACEMENT.
F.	ALL PATIENT ROOM DOORS/FRAMES TO BE REMOVED BY STANLEY DOOR TECHNICIAN AS INDICATED IN DASH LINE. DISPOSED BY STANLEY DOOR TECH.
G.	REMOVE EXISTING HANDRAILS AND BUMPERS THROUGHOUT, REPLACE WITH NEW
H.	EXISTING MEDICAL GASES TO REMAIN THROUGHOUT
I.	REMOVE FLOORING THROUGHOUT. GRIND AND PREP REMAINING FLOOR SLAB TO SMOOTH AND LEVEL FINISH.
J.	SKIM WALLS WHERE NECESSARY. PREPARE WALLS FOR NEW PAINT OR WALL TREATMENT THROUGHOUT
K.	REMOVE CURTAIN TRACKS IN PATIENT ROOMS / RESTORE & SAVE FOR REINSTALLATION.
L.	REMOVE PATIENT ROOM SINKS / PRESERVE TO REPLACE AFTER NEW WALL FINISHES.

Separate Life Safety construction documents are required for new Automatic Fire Sprinkler Systems or alterations to existing systems. Documents shall include sprinkler head locations, piping sizes, hydraulic calculations (if needed), and product cut sheets. Approval of documents is required prior to request for inspection.

Separate Life Safety construction documents are required for new Fire Alarm Systems or alterations to existing systems. Documents shall include device locations, one-line diagrams, battery calculations, and product cut sheets. Approval of documents is required prior to request for inspection.

DEMOLITION LEGEND:	
-----	REMOVE WALL AS INDICATED BY DASHED LINE
———	EXISTING WALL TO REMAIN
	EXISTING CASEWORK TO BE REMOVED/DASHED LINE
TV	EXISTING TV & MOUNTING BRACKET TO BE REMOVED

Code violations that are found during inspection are required to be corrected. Permit issuance does not grant approval of a code violation **2009 IBC 105.4**

DEMOLITION NOTES

- REMOVE EXISTING FLOOR FINISH WITHIN SCOPE OF PROJECT, PREPARE FLOORS FOR NEW FINISHES
- CONSTRUCT TEMPORARY PARTITIONS AS REQUIRED TO MINIMIZE THE SPREAD OF DUST AND NOISE. REFERENCE INFECTION CONTROL DRAWING.
- CONTRACTORS ARE RESPONSIBLE TO MAINTAIN THE FIRE RATED ASSEMBLY UPON COMPLETION OF CONSTRUCTION. ALL FIRE RATED ASSEMBLIES HAVE BEEN INSPECTED AND ARE CURRENT. REPAIR ANY CONSTRUCTION DAMAGED FIRE RATED ASSEMBLIES TO THEIR ORIGINAL SPECIFICATION.
- WHERE NEW FINISHES ARE TO BE INSTALLED ON EXISTING SURFACES, REMOVE THE EXISTING FINISH AND PREPARE SURFACE TO RECEIVE THE NEW FINISH.
- COORDINATE WITH THE OWNER ANY ITEMS TO BE STORED AND/OR RELOCATED.
- VERIFY THAT CONSTRUCTION OF EXISTING WALLS WITHIN THE AREA OF RENOVATION MEETS THE FIRE PROTECTION RATINGS DESIGNATED ON THE LIFE SAFETY PLANS. MAKE ANY REPAIRS OR MODIFICATIONS NECESSARY TO BRING EXISTING WALLS, DOORS, DUCTS, ETC. UP TO THE PROPER FIRE PROTECTION RATING. DOORS AND/OR FRAMES SHALL HAVE THE PROPER LABELING.
- VERIFY THAT EXIT EGRESS IS MAINTAINED FOR ALL OCCUPIED AREAS OF THE BUILDING THROUGHOUT CONSTRUCTION.
- DEMOLITION WORK SHALL BE EXECUTED IN CONFORMANCE WITH ALL CODES AND AS SET FORTH BY ALL GOVERNING AUTHORITIES.
- REPLACE OR REPAIR ANY EXISTING TO REMAIN FINISHES WHICH ARE DAMAGED DURING DEMOLITION (I.E. - CEILING GRID, CEILING TILE, WALL COVERING, FLOOR COVERINGS, ETC.)

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 2 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN PLOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
EAST TOWER B

SHEET DESCRIPTION
DEMOLITION PLAN


KEY PLAN



UPDATED
AUGUST 1, 2011

SCALE
1/8" = 1'

SHEET NUMBER
A-1

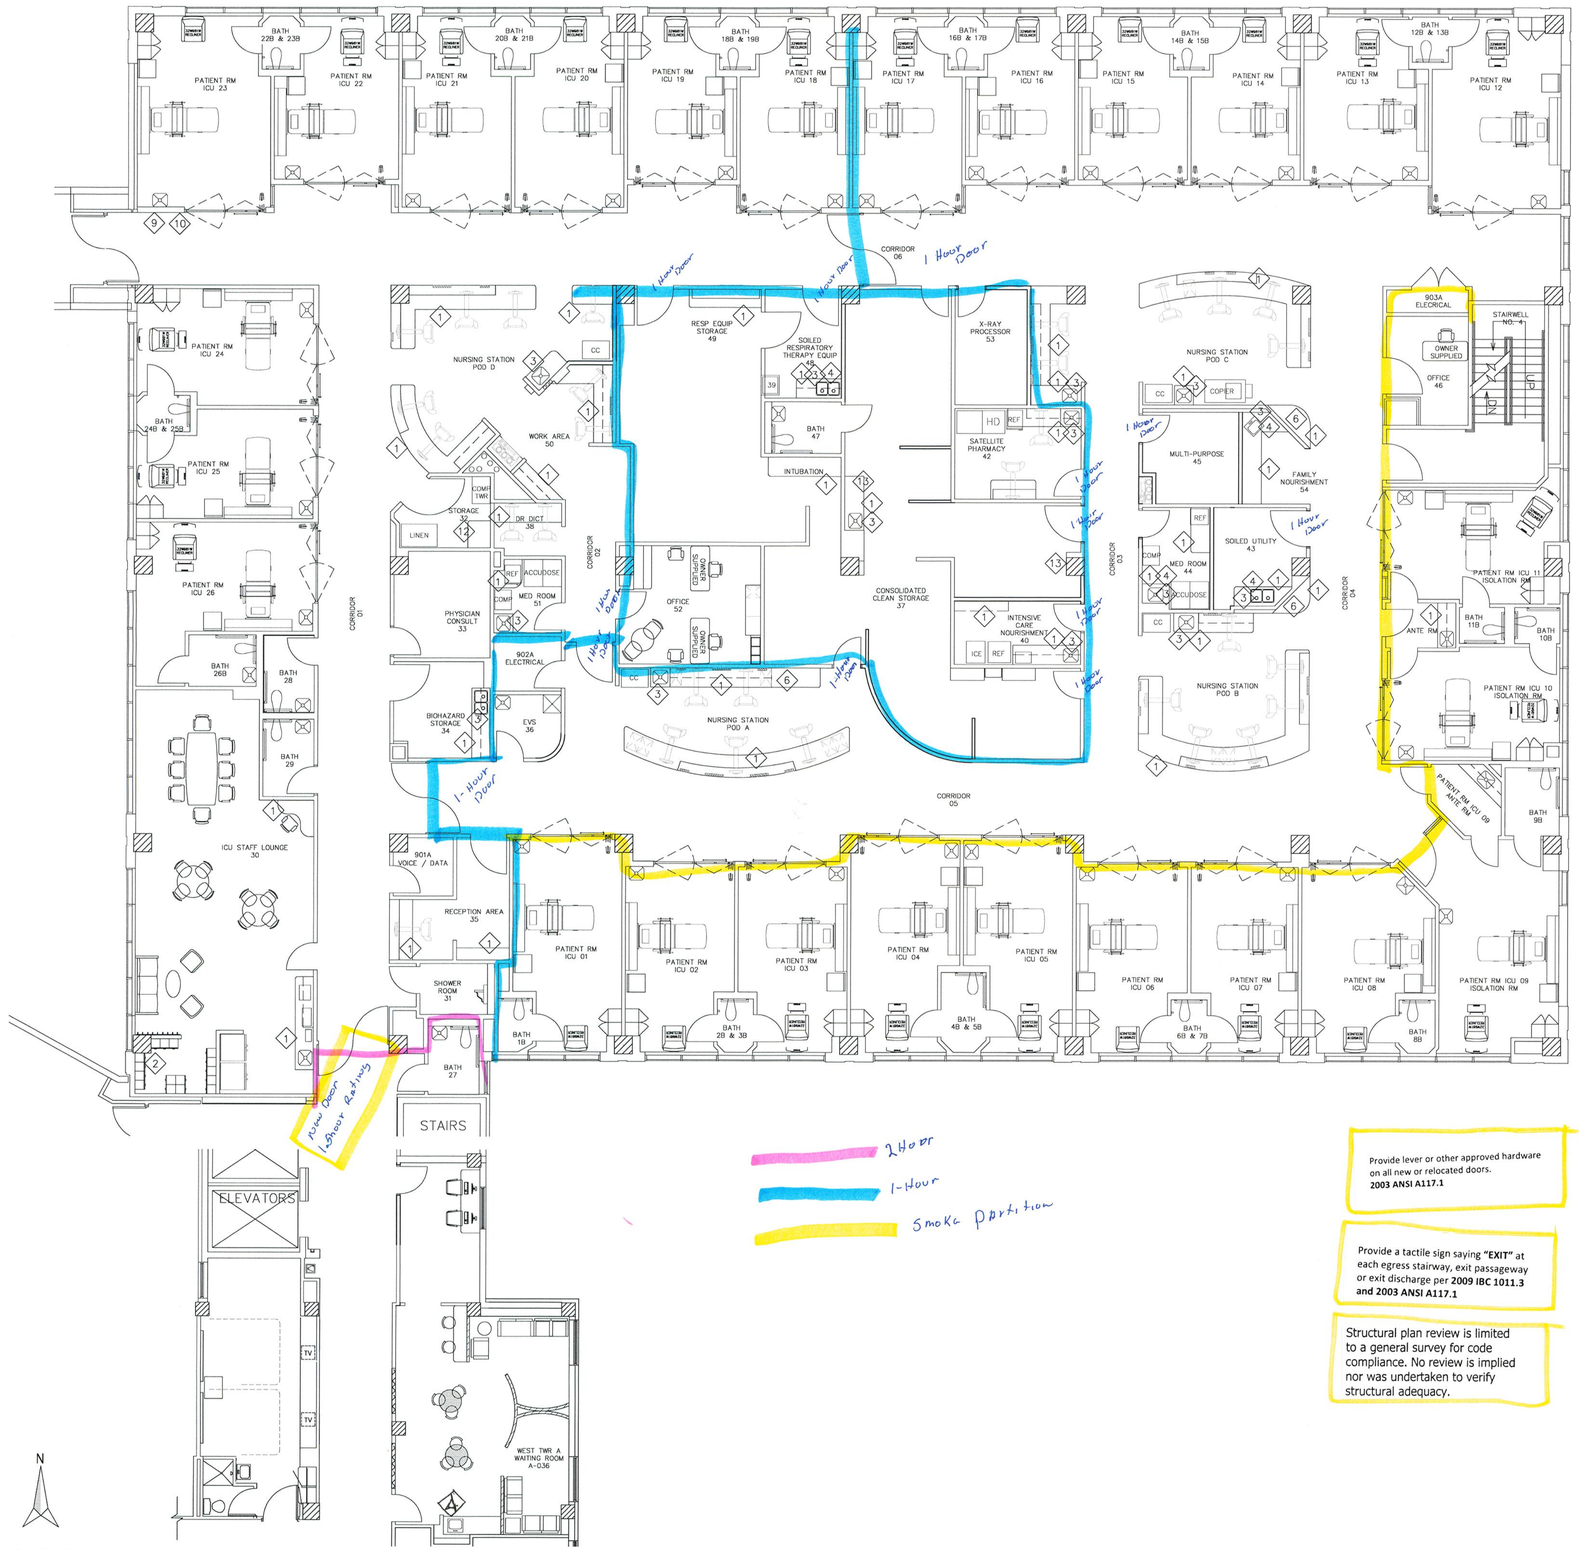

FLOOR PLAN
1/8" = 1'

FLOOR PLAN KEYNOTES:	
1	NEW CASEWORK RE: ELEVATIONS
2	NEW LOCKERS @ 12"w x 12"D x 12"H. RE: ELEVATIONS.
3	REBUILD EXISTING FAUCETS FOR SINKS TO REMAIN AND RELOCATED SINKS
4	NEW PLUMBING LOCATIONS REUSE EXISTING SINKS FROM A-1, KEYNOTE 5.
5	FREE STANDING, WIRE STORAGE RACKS. OWNER SUPPLIED
6	NEW DATA GUARD LOCATION
7	NEW DRY MARK ERASER BOARDS. OWNER SUPPLIED
8	P-LAM FOR COUNTER LOCATIONS
9	REMOVE DOUBLE DOOR PUSH PLATE / REPLACE WITH ELECTRONIC EYE SENSOR
10	APPLY SOUND BATTING INSULATION TO PATIENT ROOM/HALL WALL
11	FAMILY MESSAGE BOARDS
12	INSTALL WATER LINE FOR REFRIGERATOR/ICE MAKER
13	INVENTORY SCANNER LOCATION

GENERAL NOTES:	
A.	ALL PATIENT ROOM DOORS INSTALLED BY STANLEY DOOR VENDOR
B.	INSTALL BIN SUPPORT RACKS AS A FINAL ELEMENT TO ALLOW FOR APPROPRIATE LOCATIONS
C.	NEW CASEWORK IN EACH PATIENT ROOM. RE: ELEVATIONS
D.	INSTALL NEW WALL MOUNT BRACKET FOR FLAT SCREEN TV. (TV BY OWNER, INSTALLATION BY GC). INSTALL AT PREVIOUS TV LOCATION. FIELD VERIFY LOCATION OF PREVIOUS TELEVISION MOUNTING BRACKET.
E.	REINSTALL CUBICLE CURTAINS AND TRACK AS INDICATED BY DASHED LINE. RE: CELING PLAN
F.	ALL DOORS TO BE ACROVYN WITH STAINLESS STEEL BEVELED EDGE ON LATCH SIDE. DOOR FINISH: REAL MAHOGANY # 374.
G.	REPLACE DOOR IN EXISTING FRAME W/ SAME SIZE DOOR. COORDINATE ALL HARDWARE GROUPS WITH HOSPITAL FACILITIES DEPT.
H.	KORESEAL TRAFFIC PATTERN WALL TREATMENT TO BE APPLIED TO ALL PATIENT ROOMS, RE: ELEVATIONS. FINISH PLAN SHOWS LOCATION OF TREATMENT IN HALLWAYS. NOTE: USE COLOR MATCH CAULK AT SEAMS & CORNERS.
I.	EXISTING PATIENT ROOM SINKS TO BE REINSTALLED FROM EXISTING STOCK.
J.	ALL EXISTING DOORS WILL BE REPLACED (REUSE EXISTING HARDWARE AS IS POSSIBLE) WITH NEW ACROVYN DOORS TO MATCH HOSPITAL STANDARD.
K.	CONFIRM EXISTING WALLS SHOWN TO REMAIN MEET REQUIREMENTS OF CURRENT CODES. UPGRADE TO MEET CURRENT REQUIREMENTS. SEAL ALL PENETRATIONS WITH REQUIRED SEALANT AND ENSURE ALL WALL ASSEMBLIES ARE COMPLETE.
L.	PATIENT ROOM WINDOW TREATMENTS - OWNER SUPPLIED (MUST BE BLEACH TOLERANT)
M.	TUBE STATION EQUIPMENT IN CORRIDOR 3 - OWNER SUPPLIED
N.	ALL TELEVISIONS, TELETRACKER MONITORS, AND WAYFINDER ALONG WITH MOUNTING HARDWARE - OWNER SUPPLIED / CONTRACTOR INSTALLED.
O.	LOCKERS WILL BE FURNISHED AND INSTALLED BY OWNER

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 12 2011
11-563087

LEGEND:	
	REPRESENTS HANDRAIL & BUMPER GUARDS ACROVYN BUMPER RAIL #BCR-80E IN COLOR #380 SHAKER CHERRY ACROVYN HANDRAIL. HBR-4C PROFILE IN SHAKER CHERRY #380
	54" AFF (48" SHEETS) ACROVYN WALL PANELING -DESERT SAND.
	REPRESENTS HEADWALL IN PATIENT ROOMS
	DOORWAY HEADER 7'2" AFF
16	HALLWAY CART LOCATIONS
	LOW WALL PARTITION RE: ELEVATIONS FOR HEIGHT AND DIMENSIONS
	STORAGE BINS BY OWNER. REINSTALL SALVAGED BIN SUPPORTS AT SPECIFIED LOCATIONS. FIELD VERIFY FOR CORRECT PLACEMENT. NOTIFY PROJECT MANAGEMENT FOR ANY OBSTRUCTIONS OR CONSTRAINTS.
CR P ST	DOOR HARDWARE FOR CARD READER DOOR HARDWARE FOR PRIVACY LOCKSET DOOR HARDWARE FOR STORAGE ROOM LOCK
	SOUND DAMPING WALL
WALL PROTECTION:	
	DENOTES 48" ACROVYN CONERGUARD, APPLY TO TOP OF WALL BASE. MODEL #SSM-25-AE, COLOR #380, SHAKER CHERRY WITH TOP CAP.
	STRIP LIGHTING / UNDER COUNTER MOUNT (WITH DIMMABLE SWITCH) LAMP(s): 2-FO(17,25,32) / 841/ ECO BALLAST(s): RAPID START ELECTRONIC BALLAST, <10% THD VOLTAGE: 120 / 277 UNIVERSAL INSTALLATION: UNDERCABINET MFR: KENALL #UCSL-VIF-SB

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012

REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
EAST TOWER B


SHEET DESCRIPTION
FLOOR PLAN


KEY PLAN

UPDATED
AUGUST 1, 2011

SCALE
1/8" = 1'

SHEET NUMBER
A-2

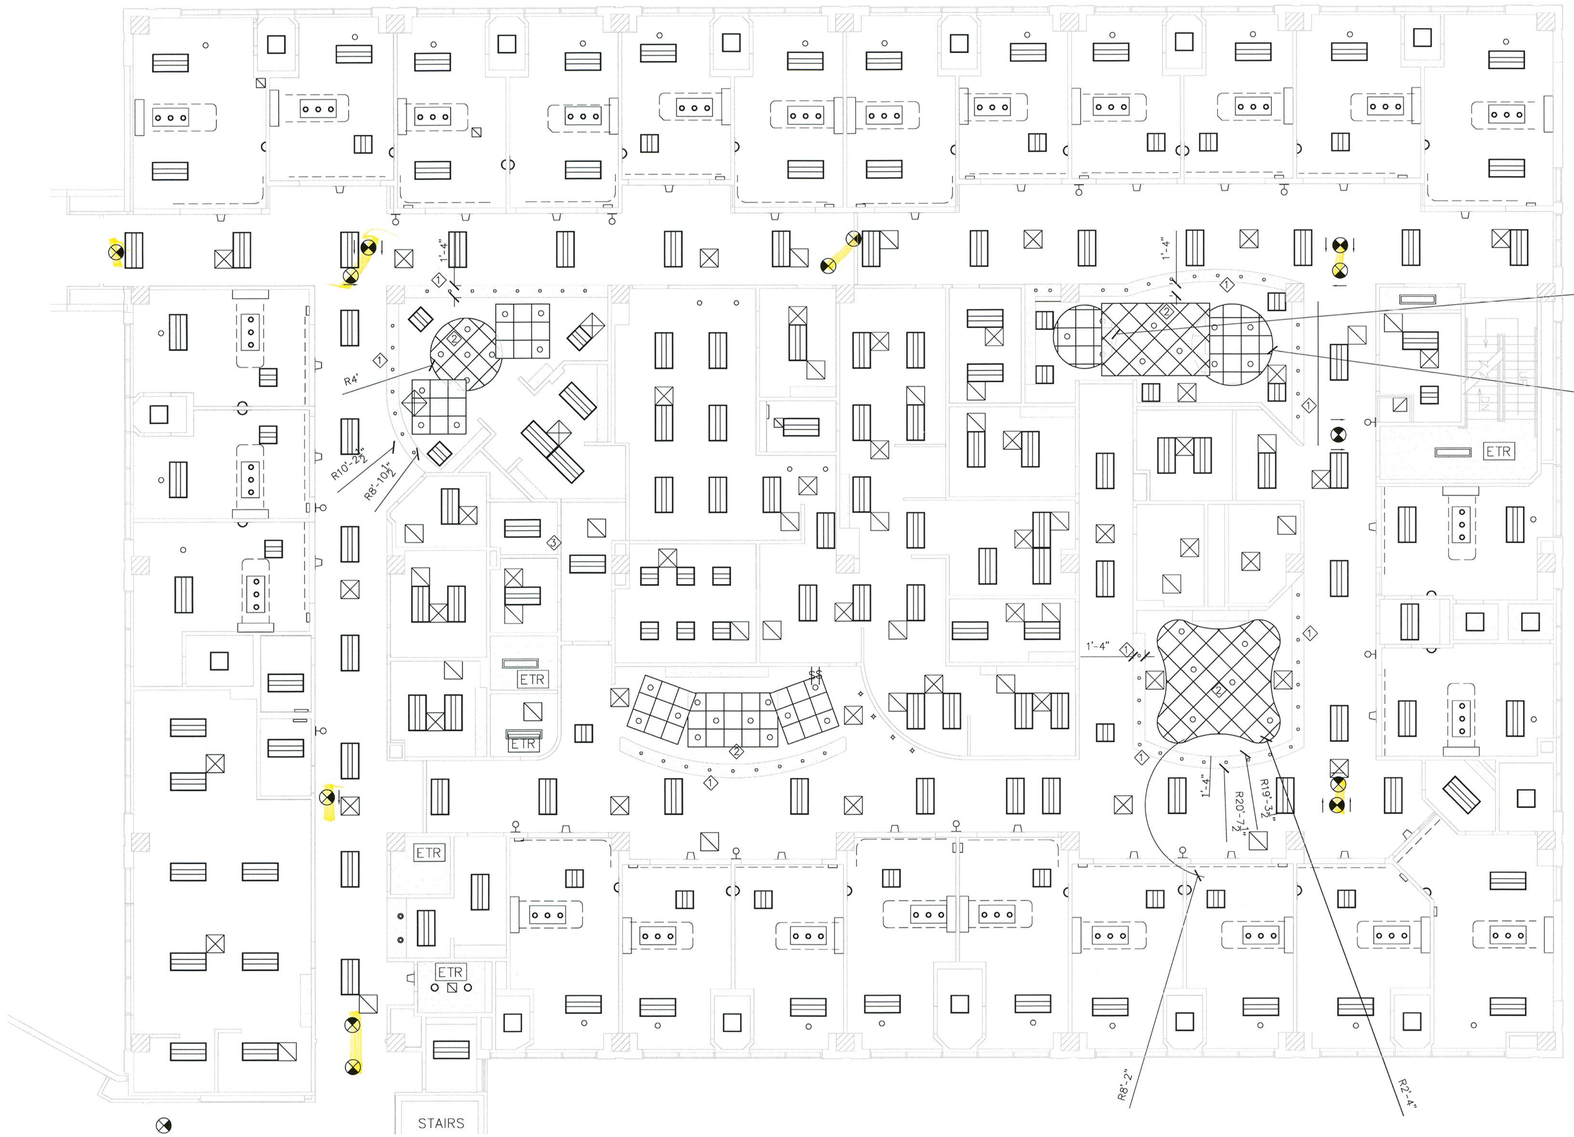

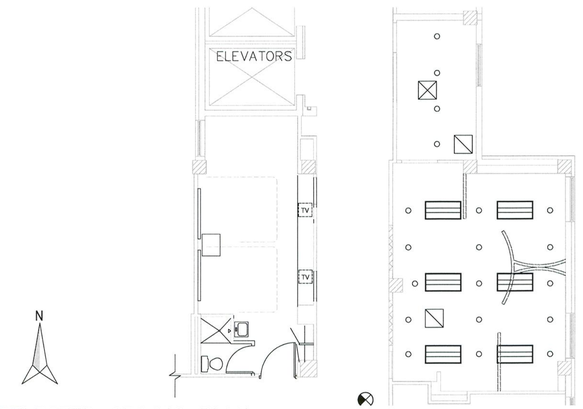

REFLECTED CEILING PLAN
1/8" = 1'

CEILING LEGEND:

SUSPENDED 2' X 4' ACOUSTICAL CEILING SYSTEM: ARMSTRONG FISSURED - ITEM #755
CEILING TILE FOR ALL RESTROOMS T.B.D.

GYPSUM BOARD CEILING OR SOFFIT TO TOP OF CABINET (OR AS NOTED) RE: ELEVATIONS.

NEW ACRYLIC LENS 2X4 FLUORESCENT FIXTURE
LAMP(s): 2-F032 / 841 / ECO
BALLAST(s): PROGRAM START ELECTRONIC BALLAST, <10% THD, U.N.O.
VOLTAGE: 120
INSTALLATION: RECESSED LAY-IN GRID (OR DRYWALL CEILING INSTALL)
MFR: FOCAL POINT #FLU-24-B-2-TB-S-XXX-G-PS-DC-WH
ACCEPT. MFR: COLUMBIA, LIGHTOLIER

NEW 2'X2' DIRECT/INDIRECT FIXTURE WITH ACRYLIC LINEAR PRISMATIC LENS, MATTE WHITE POLYESTER POWDER FINISH
LAMP(s): 2-F017 / 835 / ECO
BALLAST(s): PROGRAM START ELECTRONIC BALLAST, <10%THD
VOLTAGE: 277
INSTALLATION: RECESSED LAY-IN GRID (OR DRYWALL CEILING INSTALL)
MFR: LIGHTOLIER #19S2GLR-217-UNV-HIP
DAY-BRITE #2STG-217-DS-UNV-1 / 2EB10P-LPT850
PINNACLE #CJA-2T8-G-UNV-1C-W

PATIENT ROOM DOWNLIGHT OVER BED
LAMP(s): 10-3W LED, 5500 K
BALLAST(s): N/A, PROVIDE WITH INTEGRAL LED DRIVER
VOLTAGE: 120
INSTALLATION: 3 LED RECESSED DOWNLIGHTS IN A SINGLE 2'X4' CEILING TILE
MFR: PRESCOLITE #D6LED-120V-6D9-WT

ACRYLIC 2'X2' FLUORESCENT FIXTURE
LAMP(s): 2-F032 / 841 / ECO
BALLAST(s): PROGRAM START ELECTRONIC BALLAST, <10% THD, U.N.O.
VOLTAGE: 277
INSTALLATION: RECESSED LAY-IN GRID (OR DRYWALL CEILING INSTALL)
MFR: COLUMBIA #4PS22-232G-FAA123E120-PAF
ACCEPT MFR: METALUX, LIGHTOLIER

NEW COMPACT RECESSED LED DOWNLIGHT, 1.4" DEEP, 28 DEG ANGLE
LAMP(s): 3W LED, 3000 K
BALLAST(s): 60W WITH UNIVERSAL CONTROL DRIVER
VOLTAGE: 120
MFR: OPTOLUM #DL3-28-3500K-UC-AN
BRUCK

HEADWALL LIGHT, CONTROLLED VIA NURSE CALL PILLOW SWITCH
LAMP(s): 2-F054T5HO / 841 / ECO
BALLAST(s): PROGRAM START ELECTRONIC BALLAST, <10% THD
VOLTAGE: 120
INSTALLATION: WALL MOUNTED, RE: ELEVATIONS
MFR: DERUNGS #AMADEA WLS D13 946-000

VANITY FIXTURE OVER HANDWASH SINK
INSTALLATION: WALL MOUNTED, RE: ELEVATIONS
MFR: GEORGE KOVACS CHROME

WALL SCONCE
LAMP(s): 1-13W / PL / 841
BALLAST(s): RAPID START ELECTRONIC BALLAST, <10% THD
VOLTAGE: 120
INSTALLATION: WALL MOUNTED @ 6'-0" U.N.O.
MFR: A-19 #ANSEL-MB1 FINISH

6" FLUORESCENT DOWNLIGHT WITH VERTICAL LAMP
LAMP(s): 1-CFTR32 / GX24Q / 835
BALLAST(s): PROGRAM START ELECTRONIC BALLAST, <10% THD
VOLTAGE: 277
INSTALLATION: RECESSED LAY-IN GRID (OR DRYWALL CEILING INSTALL.
MFR: LIGHTOLIER #S6132BU-8021
OMEGA #S6-32PLT-U-T6-CS
PRESCOLITE #CFT632EB-STF602-WT

After hours inspection to verify required egress illumination may be required during field inspection. **2009 IBC 1006**

6" FLUORESCENT DOWNLIGHT AT SHOWER
LAMP(s): 1-CFTR26W / GX24Q / 841
BALLAST(s): PROGRAM START ELECTRONIC BALLAST, <10% THD
VOLTAGE: 120
INSTALLATION: RECESSED LAY-IN GRID (OR DRYWALL CEILING INSTALL)
MFR: PRESCOLITE #CFT632EB-WTF602HMFC-CL-WRL26
CALCULITE
ZUMTOBEL

NEW COMPACT RECESSED LED DOWNLIGHT, 1.4" DEEP, 60 DEG ANGLE
LAMP(s): 3W LED, 3500 K
BALLAST(s):60W WITH UNIVERSAL CONTROL DRIVER
VOLTAGE: 120
MFR: OPTOLUM #DL3-60-3500K-UC-AN BRUCK
* INSTALL @ SOFFITS / APPROX. 2'-6" ON CENTER

RECEPTION DESK PENDANT LIGHTING

NEW EMERGENCY EXIT SIGNS, EDGE LIT DUAL LITE LE SERIES OR APPROVED EQUIVALENT.

NURSE CALL DOME LIGHT. SEPARATE EXISTING NURSE CALL SYSTEM FROM REMAINING HALF OF FLOOR. PROVIDE NEW CONTROL STATION AT NURSE STATION LOCATION. INSTALL ON WALL ABOVE DOOR HEADER.

CURTAIN TRACKS, SALVAGE CURTAIN TRACK FROM DEMO. ATTACH TO GRID (TO CLEAR LIGHT FIXTURES MAINTENANCE AS REQUIRED). OFFSET TRACK 2'-2" FROM DOOR/WALL TO ALLOW DOOR SWING CLEARANCE.

EXISTING SUPPLY AIR - TO REMAIN

EXISTING RETURN AIR - TO REMAIN

SCHEDULE

Type	Qty	Mfgr	Part Number
A	157	Focal Point	FLU24B 2T8 S 120 G PS FW6 DC WH L841
B	37	Lightolier	H9S2GLR 217 UNV P2 85 YF6
CD	78	Prescolite	D6LED4HDM / 6D9LED450K 8 WT / B24
D	14	Columbia	4PS22 232U6G FAA12125M EPU SLL PAF F0841 C388
DF	2	Columbia	4PS22 232U6F FAA1215M EPU SLL PAF F0841 C388
E	1	Optolum	DL3 28 3500K UC 01 / PS30-240-1-DL3
F	26	Waldman	D14-776-000
G	26	Alko	TAB117 ASY 120 BA CL LS
H	14	A19	HASEL F200I MBI
I	76	Lightolier	8021CCDP / S6132BU / 1951
ID	70	Lightolier	8021CCDP / S6132BJUM7 / 1951
J	3	Prescolite	CFT632HEB MW26 / SRF602 HMFCCL / B24
K	26	Vista	AGVSP LED ST L C ZN WT UNIV X
X1	10	Dual-Lite	LECSRXNA
X2	4	Dual-Lite	LECDRXNA
UC1	17	Kenall	UCSL 12RS 120 SW
UC2	13	Kenall	UCSL 24RS 120 SW

CEILING KEYNOTES:

1. NEW +/- 4" GYPSUM BOARD SOFFIT (B.O. SOFFIT @ 7'-8" AFF)
2. ARMSTRONG AXIOM VECTOR TRIM AT EDGE OF DROPPED CLOUD @ 7'-6" AFF (2 PANEL LAYERS) OR 7'9" AFF (SINGLE PANEL). 2" AXIOM VECTOR PROFILE EDGE TRIM IN BRONZE FINISH. CONCEAL SUSPENSION ABOVE CLOUD. VECTOR CEILING PANELS WITH 2 HEIGHT TRANSITIONS: CHERRY TILES TO BE PLACED AT A HIGHER ELEVATION. MAPLE TILES TO BE PLACED AT THE LOWER ELEVATION.

Re Lamp Existing Fixtures Using Lower Wattage Fixtures.

RCP GENERAL NOTES
1. REUSE ALL CURTAIN TRACKS THROUGHOUT
2. CURTAINS WILL BE OWNER SUPPLIED AND INSTALLED
3. NEW CEILING GRID AND TILES @ 8' - 0" AFF FOR HALLWAYS AND COMMON AREAS
4. NEW CEILING GRID AND TILES @ 8' - 6" AFF FOR PATIENT ROOMS
5. REMOVE EXISTING 4 BULB T-12 FLUORESCENT LIGHT FIXTURES THROUGHOUT COMMON AREA & PATIENT ROOMS / REPLACE WITH NEW FIXTURES IN SAME LOCATION WITH NEW FIXTURES RE: LIGHT PACKAGE
6. REMOVE 3 INCANDESCENT OVER-BED LIGHTS / REPLACE WITH 3 LED LIGHTS IN SAME LOCATION. RE: LIGHT PACKAGE

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 19 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN PLOT

THE MEDICAL CENTER OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
EAST TOWER B

SHEET DESCRIPTION
REFLECTED CEILING PLAN


KEY PLAN



UPDATED
AUGUST 1, 2011

SCALE
1/8" = 1'


SHEET NUMBER
A-3

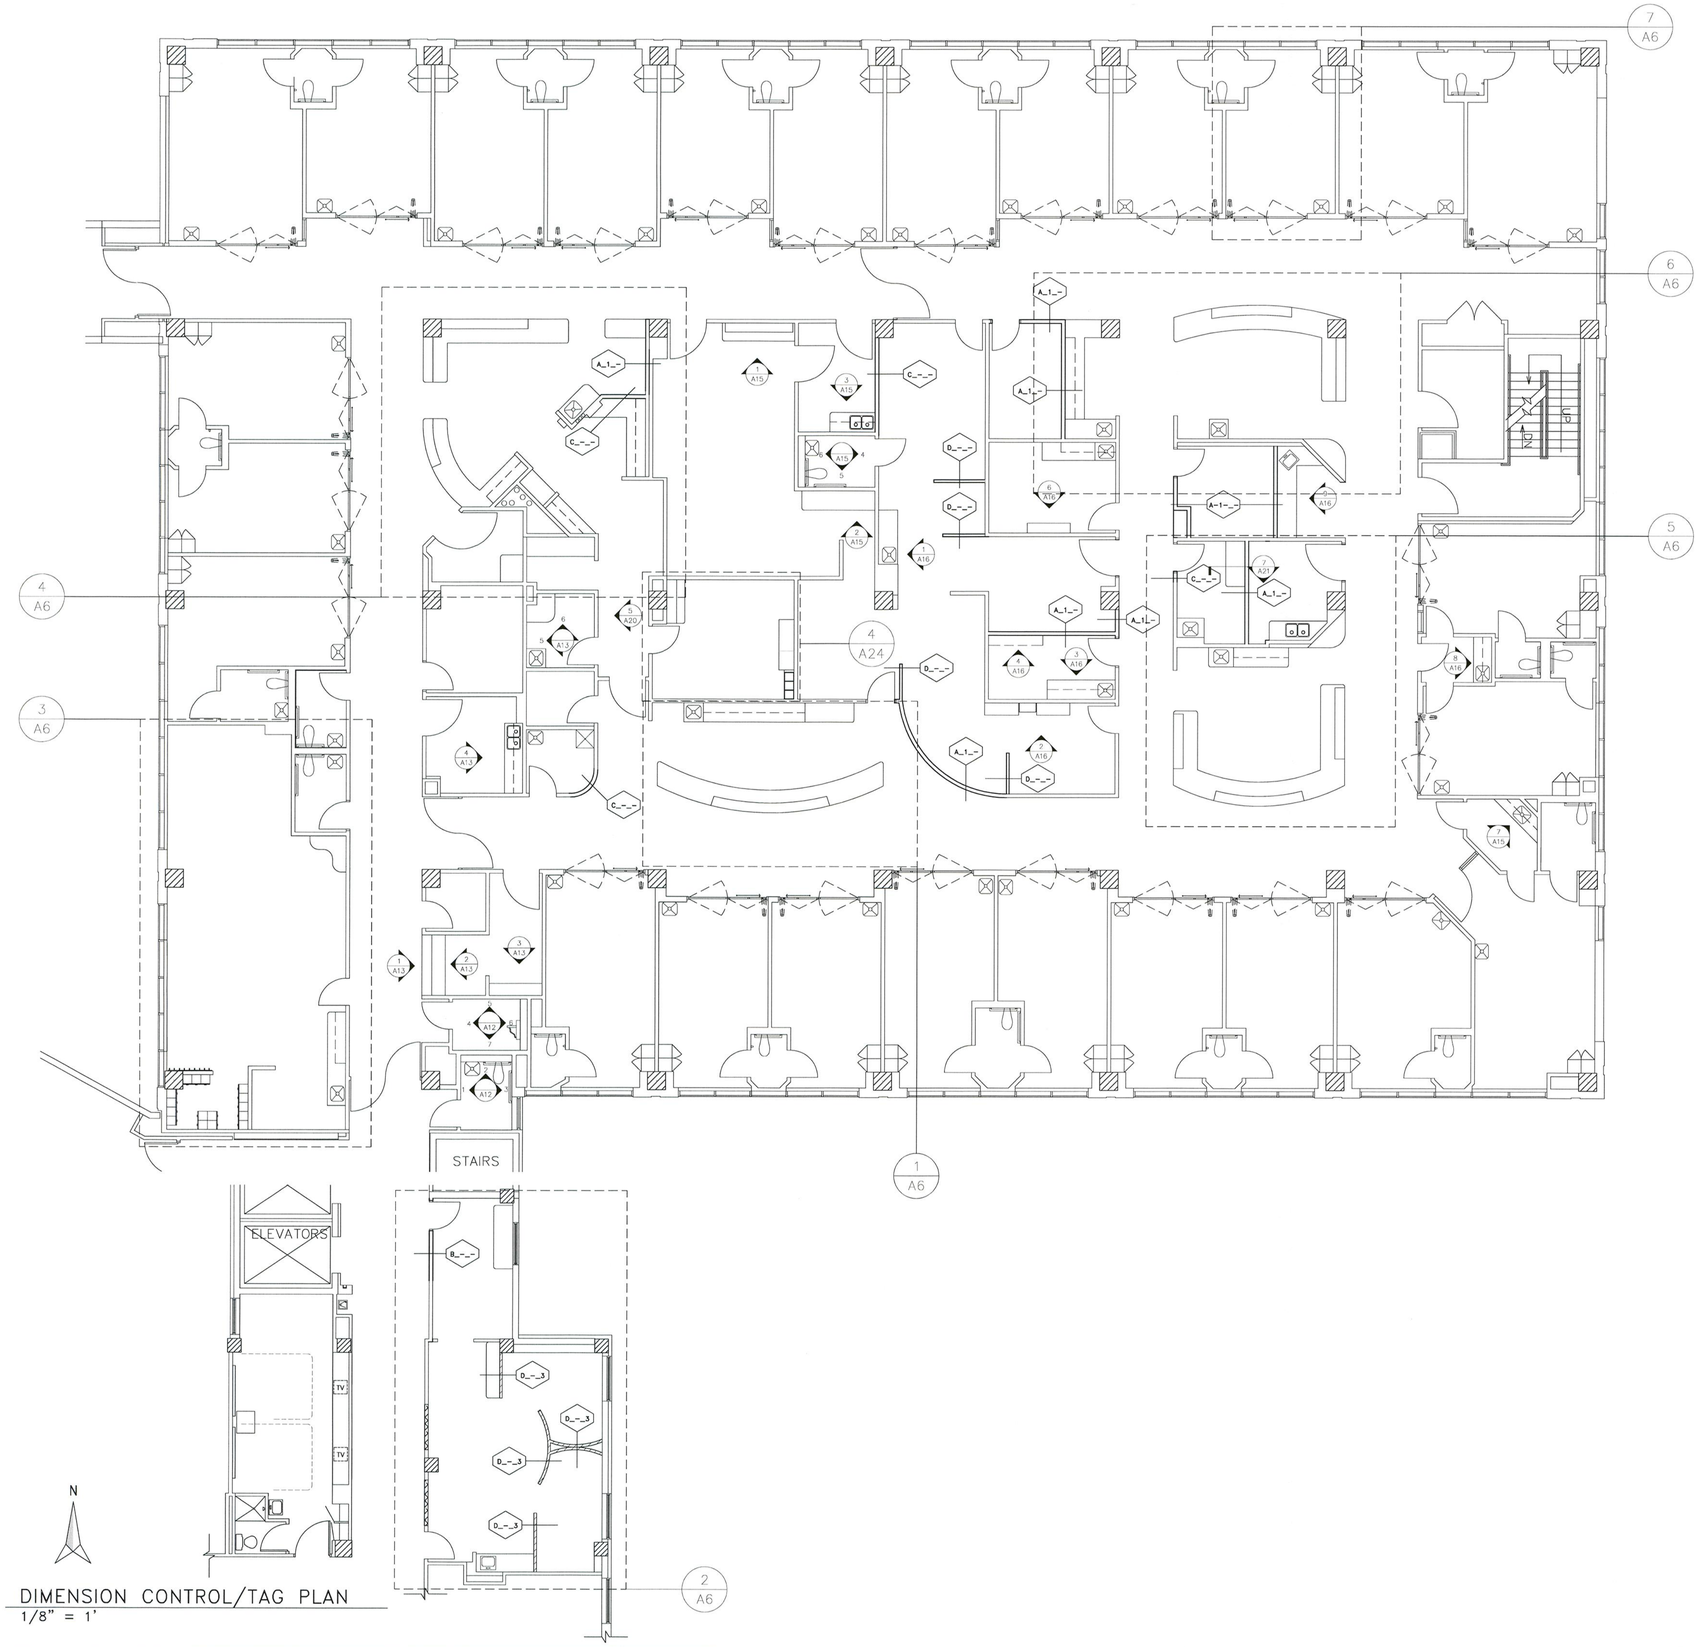

N


DIMENSION CONTROL/TAG PLAN
1/8" = 1'

SEE SHEET NUMBER A-10 FOR PARTITION TYPE AND CONSTRUCTION DETAIL

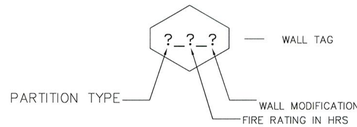

WALL MODIFICATION NOTES:

1 - ONE-SIDED, DOUBLE GYP BOARD CONSTRUCTION FOR SOUND DAMPING
2 - DOUBLE-SIDED, DOUBLE GYP BOARD CONST FOR SOUND DAMPING
3 - LIMITED WALL HEIGHT RE: ELEVATIONS



WALL PARTITION TYPES:

A - 3-5/8" STUD, FIRE RATED WALL
B - 3-5/8" STUD, SMOKE PARTITION
C - 3-5/8" STUD, NON-RATED WALL
D - 2-1/2" STUD, NON-RATED WALL
E - 1 - 5/8" STUD, NON-RATED, ONE-SIDED WALL
F - 3-5/8" STUD, NON-RATED SOUND DAMPING WALL

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 [illegible] 2011

11-563087

The Medical Center of Aurora
Health

THE DESIGN PLOT
PARKER, CO 80138

DESIGN
PLOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012

REVISION & DESCRIPTION

DRAWN BY:

TH
JM


PROJECT

3RD FLOOR
EAST TOWER B
ICU RENOVATION

SHEET DESCRIPTION

TAG PLAN

KEY PLAN



UPDATED


AUGUST 1, 2011

SCALE

1/8" = 1'

SHEET NUMBER

A-4

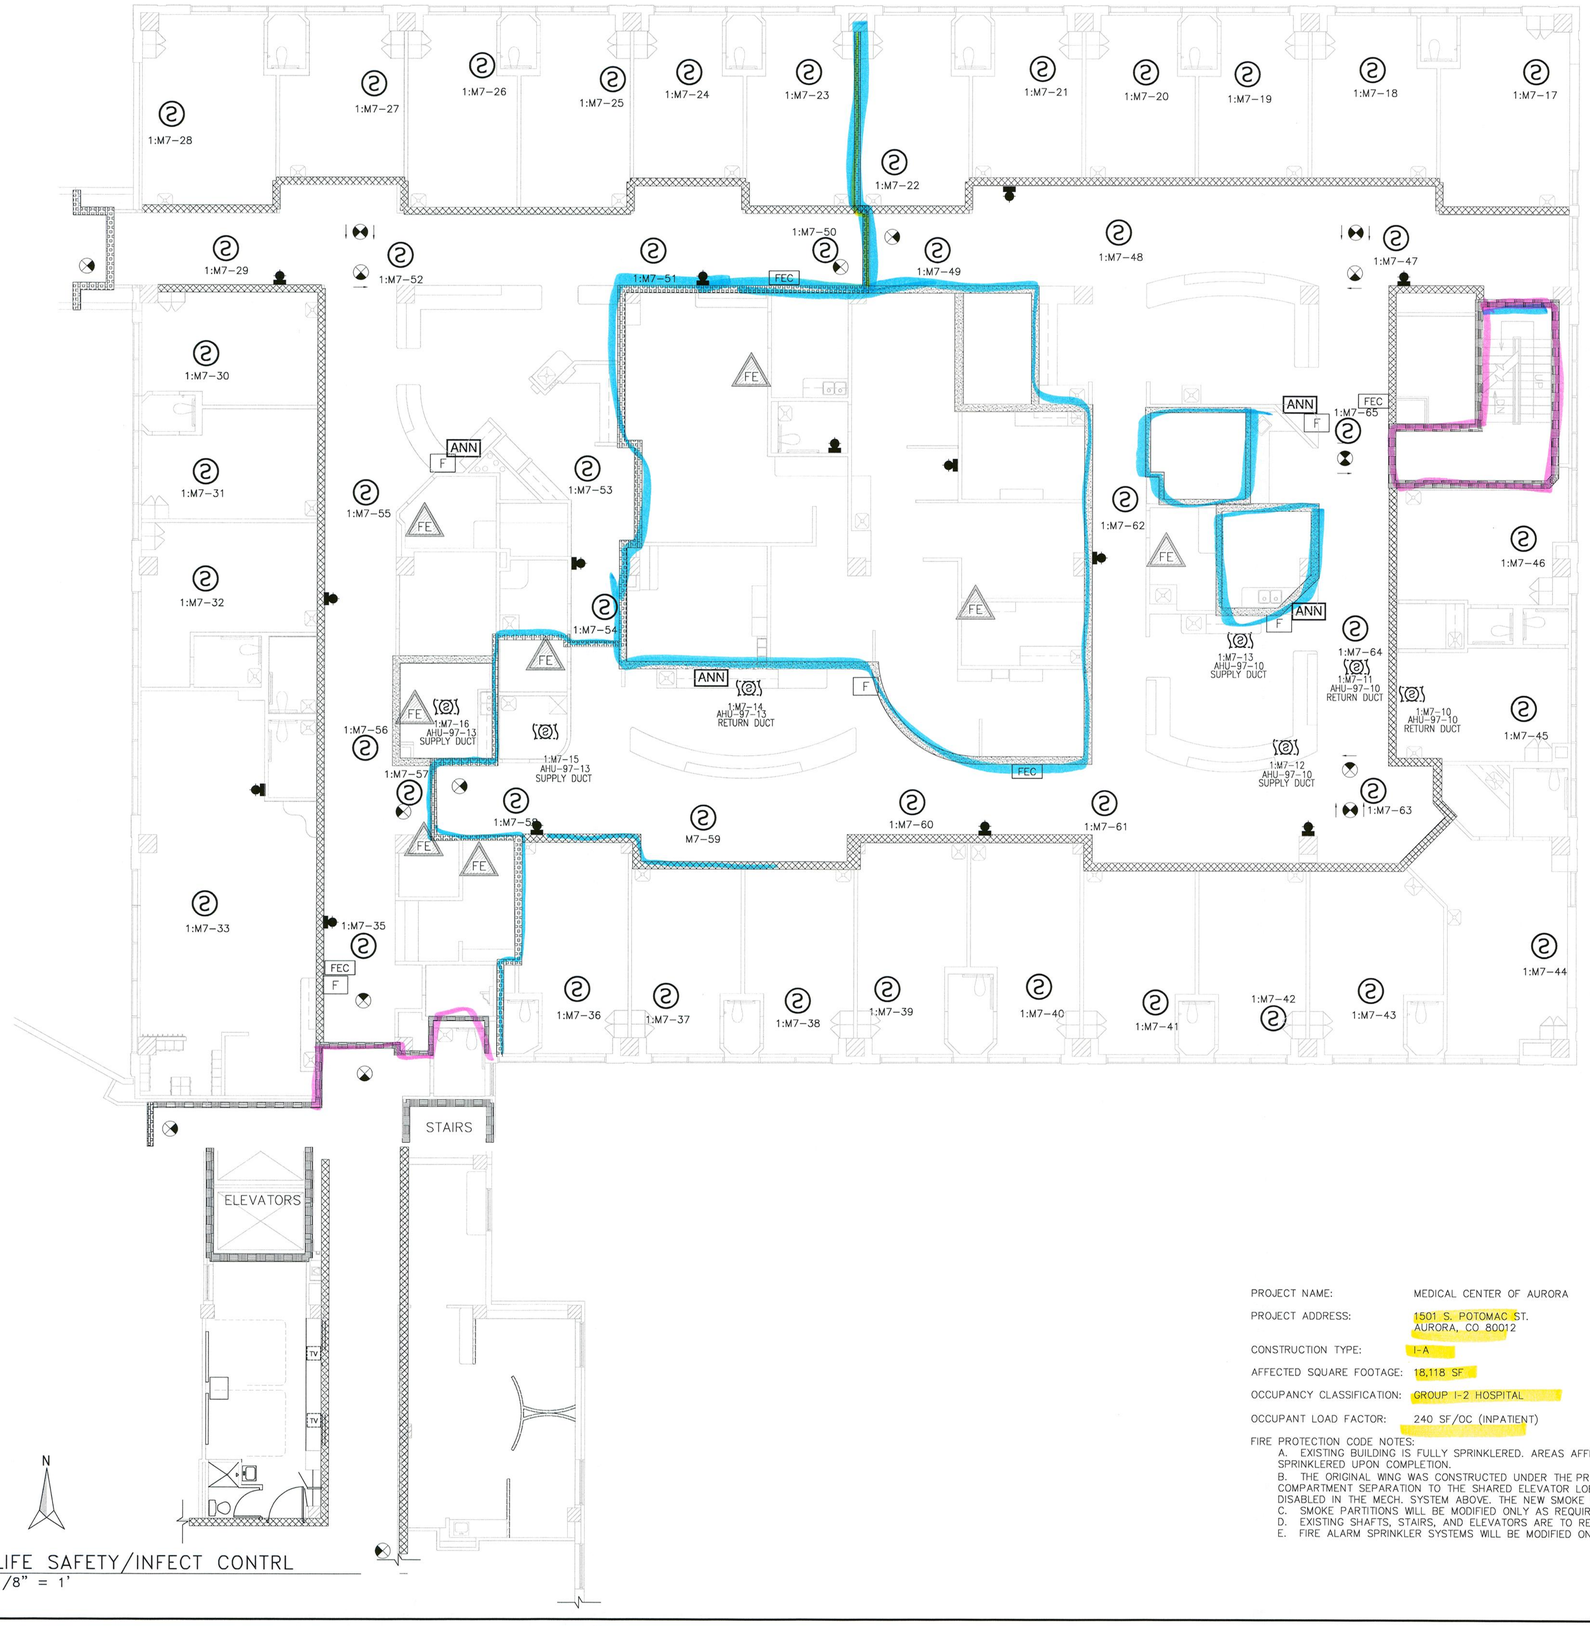

LIFE SAFETY/INFECT CONTRL
1/8" = 1'

CODE COMPLIANCE PLAN LEGEND

- SMOKE PARTITION
- 1 HOUR FIRE BARRIER
- 1 HOUR FIRE BARRIER / SMOKE RESISTANT FOR COMPARTMENTATION
- 2 HOUR FIRE BARRIER / SMOKE RESISTANT
- F - PULL STATION
- EXIT SIGNS
- FE - FIRE EXTINGUISHER
- FEC - FIRE EXTINGUISHER IN WALL CABINET
- SMOKE DETECTOR
- ANN - LCD ANNUNCIATOR
- FIRE ALARM STROBE AND HORN

CODE INFORMATION

CITY OF AURORA:
2009 ~~2006~~ INTERNATIONAL BUILDING CODE (IBC)
2009 ~~2006~~ INTERNATIONAL MECHANICAL CODE (IMC)
2009 ~~2006~~ INTERNATIONAL FUEL GAS CODE
2009 ~~2006~~ INTERNATIONAL PLUMBING CODE (IPC)
2009 ~~2006~~ INTERNATIONAL FIRE CODE (IFC)
2009 ~~2006~~ INTERNATIONAL ENERGY CONSERVATION CODE (IEEC)
2011 ~~2005~~ NATIONAL ELECTRIC CODE (NEC)
2003 ANSI - A117.1

STATE OF COLORADO:
2006 AIA GUIDELINES FOR THE DESIGN AND CONSTRUCTION OF HEALTHCARE FACILITIES
2003 NFPA 101 - LIFE SAFETY CODE

FEDERAL:
1994 AMERICANS WITH DISABILITIES ACT GUIDELINES

FIRE PROTECTION: EXISTING BUILDING IS FULLY SPRINKLERED. AREAS AFFECTED BY WORK UNDER THIS CONTRACT SHALL MAINTAIN FIRE PROTECTION SYSTEM AND BE FULLY SPRINKLERED UPON COMPLETION.

CORRIDORS: EXISTING CORRIDOR SEPARATION IS MAINTAINED AT AREAS OF NEW CONSTRUCTION.

MEANS OF EGRESS: EXISTING EXIT ACCESS, QUANTITY, AND PATH IS NOT ALTERED BY CONSTRUCTION WORK IN THIS PROJECT.

PROJECT NAME: MEDICAL CENTER OF AURORA

PROJECT ADDRESS: 1501 S. POTOMAC ST.
AURORA, CO 80012

CONSTRUCTION TYPE: I-A

AFFECTED SQUARE FOOTAGE: 18,118 SF

OCCUPANCY CLASSIFICATION: GROUP I-2 HOSPITAL

OCCUPANT LOAD FACTOR: 240 SF/OC (INPATIENT)

FIRE PROTECTION CODE NOTES:
A. EXISTING BUILDING IS FULLY SPRINKLERED. AREAS AFFECTED BY WORK UNDER CONTRACT SHALL MAINTAIN FIRE PROTECTION SYSTEM AND BE FULLY SPRINKLERED UPON COMPLETION.
B. THE ORIGINAL WING WAS CONSTRUCTED UNDER THE PREVIOUS BUILDING CODE (1994 UBC). BASED ON THE 2006 IBC, SECTION 407.4. THIS PROJECT SHOWS THE RELOCATION OF SMOKE COMPARTMENT SEPARATION TO THE SHARED ELEVATOR LOBBY BETWEEN WINGS. THE FORMER SMOKE SEPARATION DOORS HAVE BEEN REMOVED, AND THE ASSOCIATED DAMPER SYSTEM DISABLED IN THE MECH. SYSTEM ABOVE. THE NEW SMOKE RATED LOBBY WILL SERVE AS THE AREA SEPARATION BETWEEN SQUARE FOOTAGE LIMITS.
C. SMOKE PARTITIONS WILL BE MODIFIED ONLY AS REQUIRED WHERE INFILL WORK OR REMODEL TO CORRIDOR PATIENT ROOM WALLS OCCUR.
D. EXISTING SHAFTS, STAIRS, AND ELEVATORS ARE TO REMAIN WITHOUT MODIFICATION.
E. FIRE ALARM SPRINKLER SYSTEMS WILL BE MODIFIED ONLY TO THE EXTENT REQUIRED TO ACCOMMODATE FLOOR PLAN CHANGES SHOWN.

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN PLOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
EAST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
LIFE SAFETY PLAN


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/8" = 1'


SHEET NUMBER
A-5

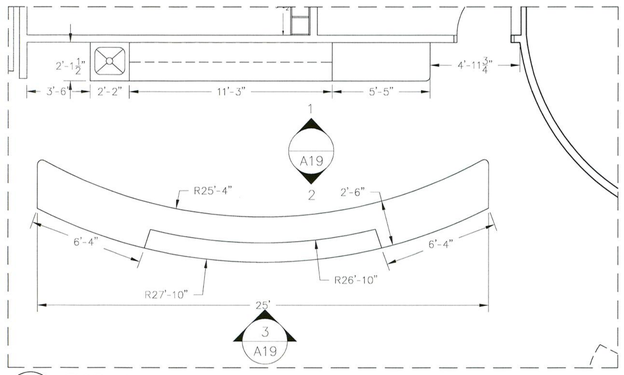


1 A6 POD A
1/4" = 1' - 0"

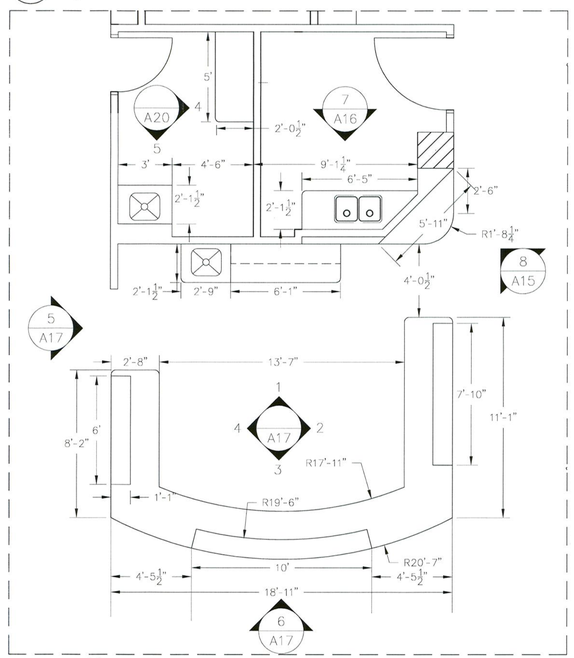


5 A6 POD B
1/4" = 1' - 0"

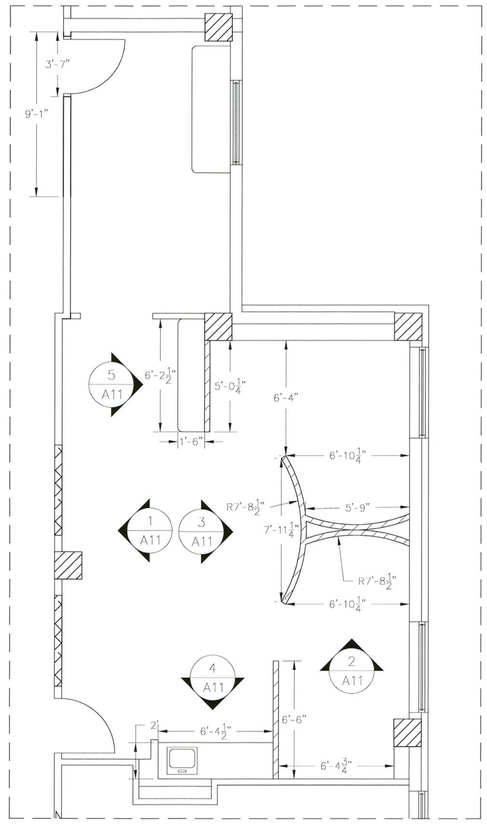


2 A6 WAITING ROOM
1/4" = 1' - 0"

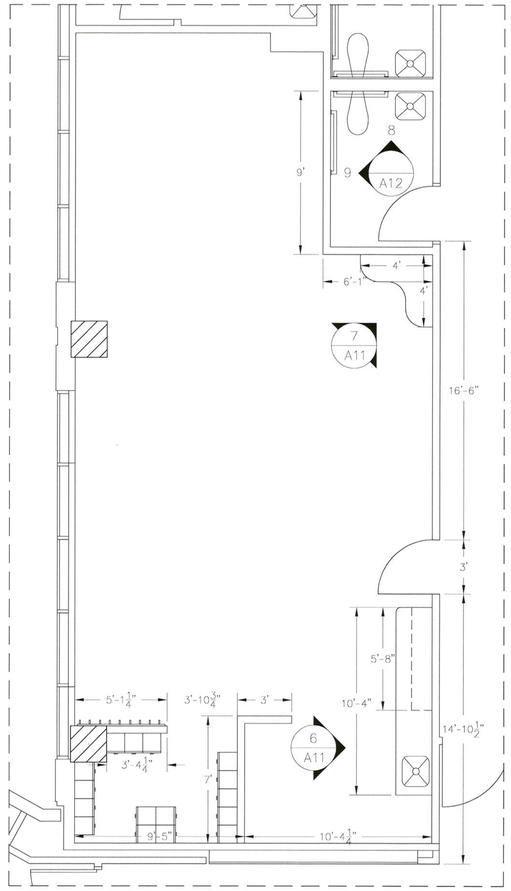


3 A6 ICU LOUNGE
1/4" = 1' - 0"

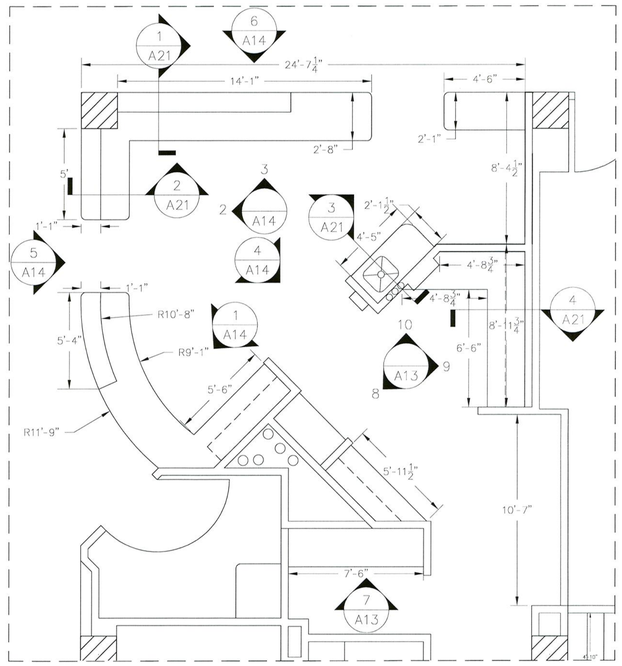

4 A6 POD D
1/4" = 1' - 0"

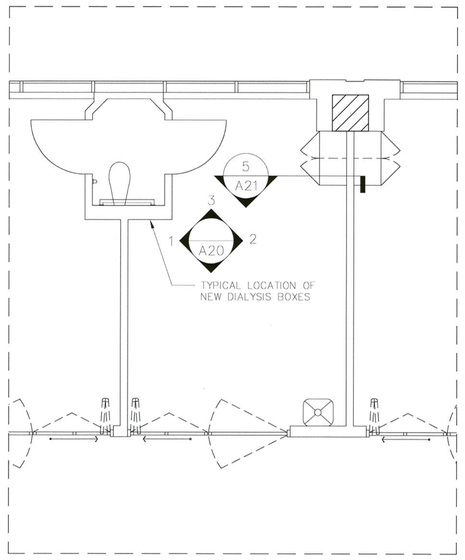

7 A6 TYP PATIENT ROOM
1/4" = 1' - 0"

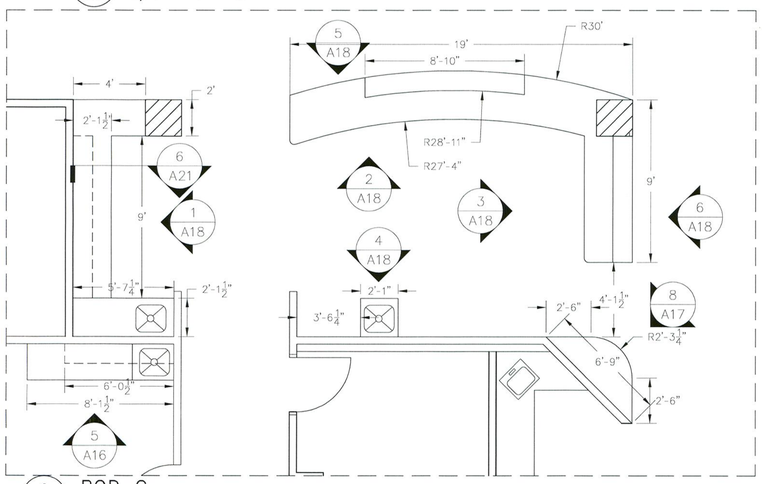

6 A6 POD C
1/4" = 1' - 0"

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012

REVISION & DESCRIPTION

DRAWN BY:

TH
JM


PROJECT

3RD FLOOR
EAST TOWER B
ICU RENOVATION

SHEET DESCRIPTION

ENLARGED PLAN

KEY PLAN



UPDATED

AUGUST 1, 2011

SCALE

1/4" = 1'

SHEET NUMBER

A-6


CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 5 2011
11-563087

U.L. DESIGN *U494

NEW 1 HR FIRE BARRIER PARTITION:

- CONSTRUCTED AS SHOWN. ALL PENETRATIONS TO BE SEALED WITH FIRE-RATED SEALANT BOTH SIDES OF WALL AND TOP AND BOTTOM TRACKS.
- NEW ONE HOUR RATED WALL: CONSTRUCTED AS SHOWN ADDING SMOKE AND FIRE (UL) RATED SEALANT
- PIPES, WIRES, CONDUITS SHALL NOT BE EMBEDDED IN STRUCTURAL MEMBER PROTECTION
- SCREW FASTENERS ARE TO BE USED FOR THE ATTACHMENT OF GYPSUM BOARD TO STEEL FRAME MEMBERS AS PER CODE AND MANUFACTURE'S RECOMMENDATIONS.

TYPE A WALL CONSTRUCTION

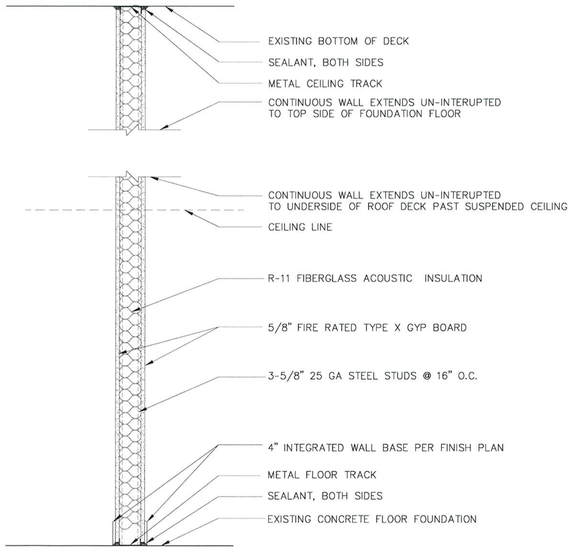


A10 A — ONE HOUR FIRE BARRIER WALL PARTITION A
1" = 1'

U.L. DESIGN *U494

NEW SMOKE PARTITION:


- CONSTRUCTED AS SHOWN. ALL PENETRATIONS TO BE SEALED WITH FIRE-RATED SEALANT ONE SIDE OF WALL AND TOP AND BOTTOM TRACKS.

TYPE B WALL CONSTRUCTION

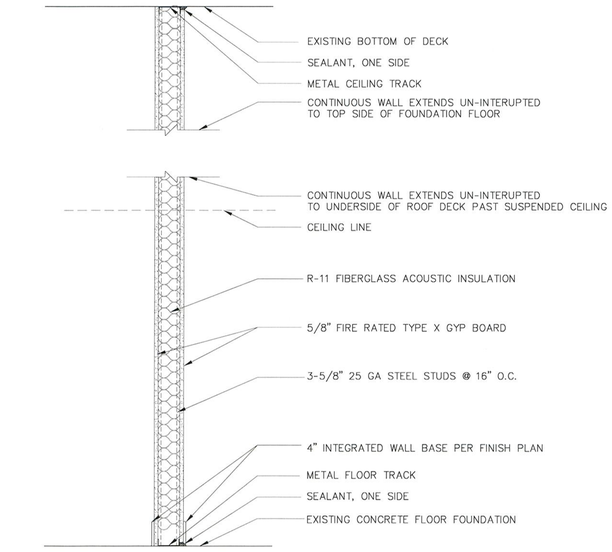


B10 B — SMOKE PARTITION B
1" = 1'


TYPE C WALL CONSTRUCTION

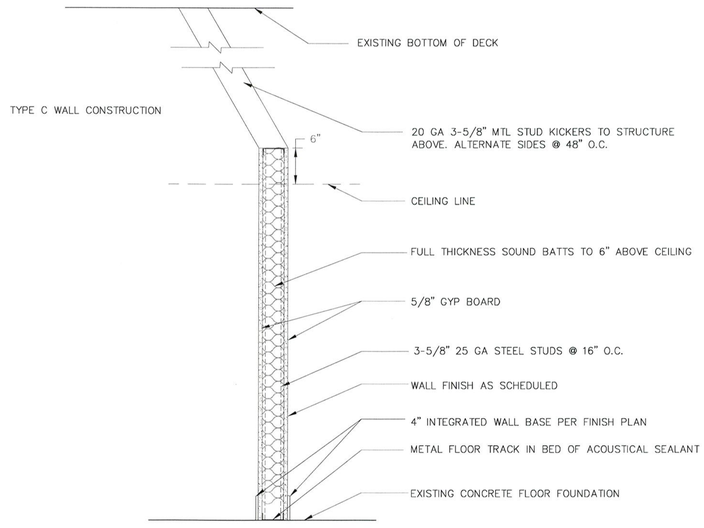


C10 C — NON-RATED WALL PARTITION C
1" = 1'

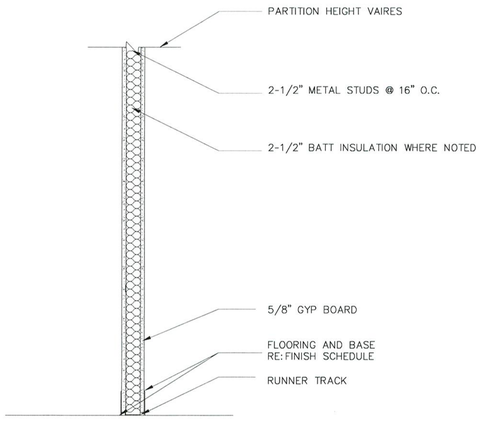

D10 D — 2-1/2" STUD NON-RATED PARTITION D
1" = 1'

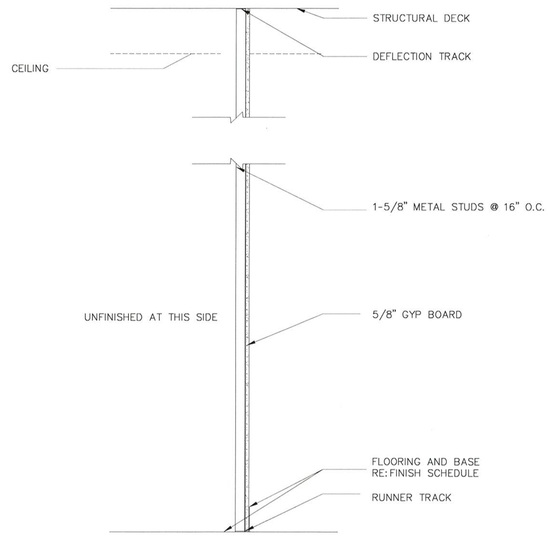

E10 E — 1-5/8" STUD NON-RATED/ONE-SIDED PARTITION E
1" = 1'

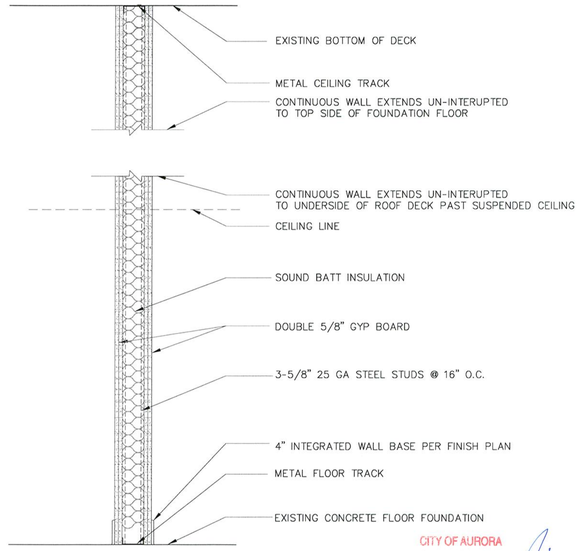

F10 F — 3-5/8" STUD NON-RATED/SOUND DAMPING PARTITION F
1" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 5 2011

11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN
PLOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
EAST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
WALL SECTIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1" = 1'


SHEET NUMBER
A-10

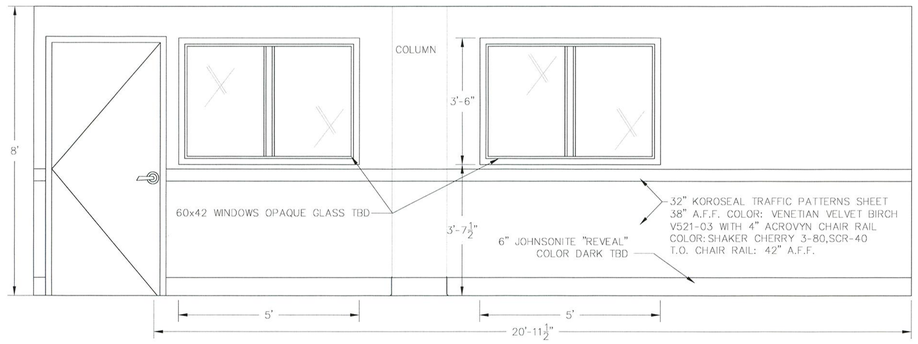


1 A11 WAITING ROOM WEST
SCALE: 1/2" = 1'

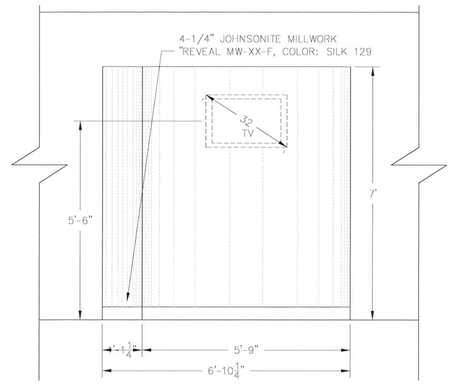


2 A11 WAITING ROOM NORTH TV
SCALE :1/2" = 1'

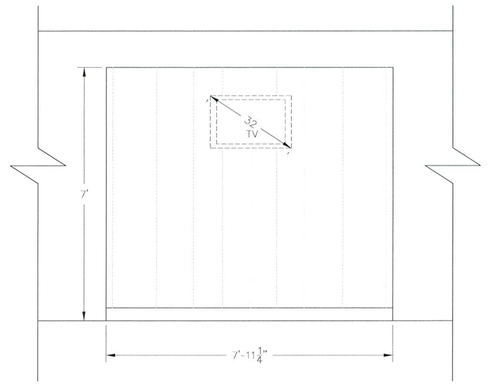


3 A11 WAITING ROOM EAST TV
SCALE :1/2" = 1'

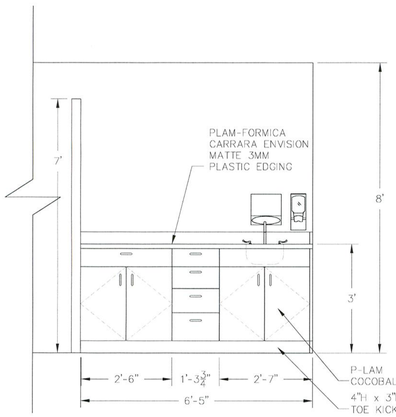


4 A11 WAITING RM SOUTH KITCHENETTE
SCALE :1/2" = 1'

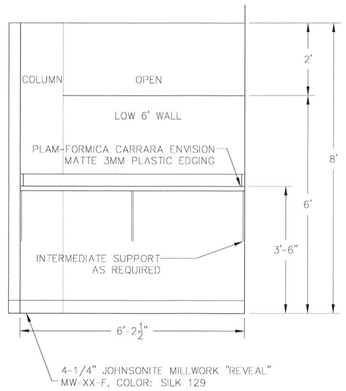

5 A11 WAITING RM EAST COUNTER
SCALE :1/2" = 1'

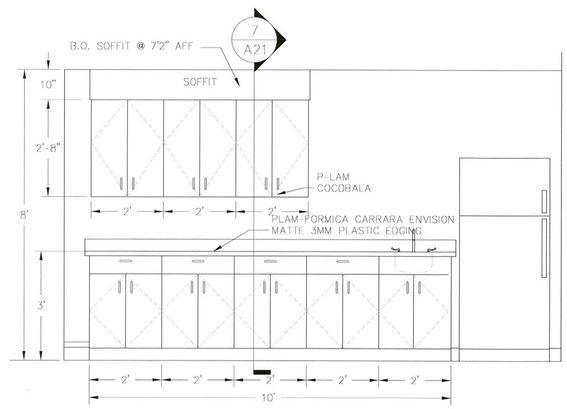

6 A11 ICU STAFF LOUNGE EAST
SCALE :1/2" = 1'

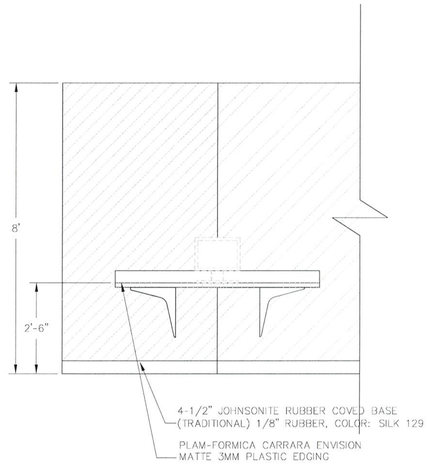

7 A11 ICU STAFF LOUNGE SOUTHEAST
SCALE :1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 2 2011

11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
ELEVATIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-11

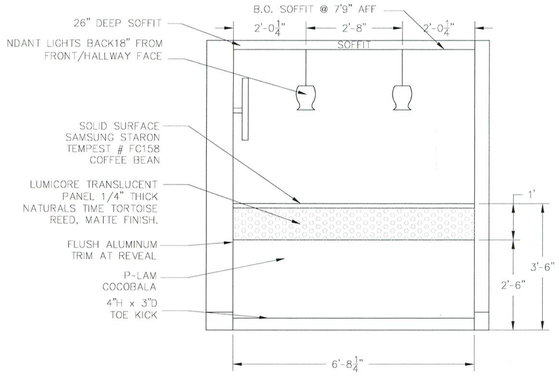


1 A13 RECEPTION DESK EAST
SCALE: 1/2" = 1'

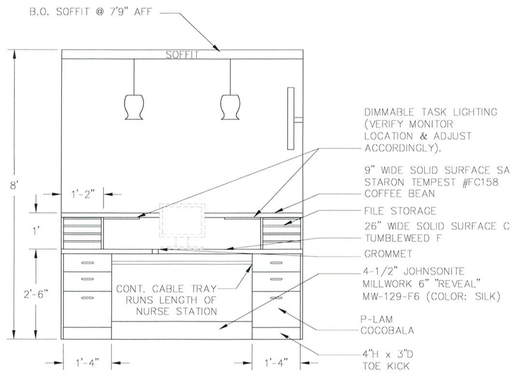


2 A13 RECEPTION DESK WEST
SCALE: 1/2" = 1'

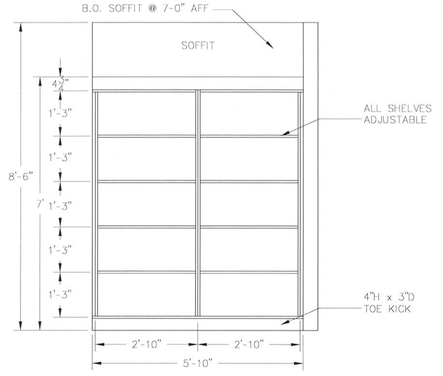


3 A13 RECEPTION AREA BOOKSHELF SOUTH
SCALE: 1/2" = 1'

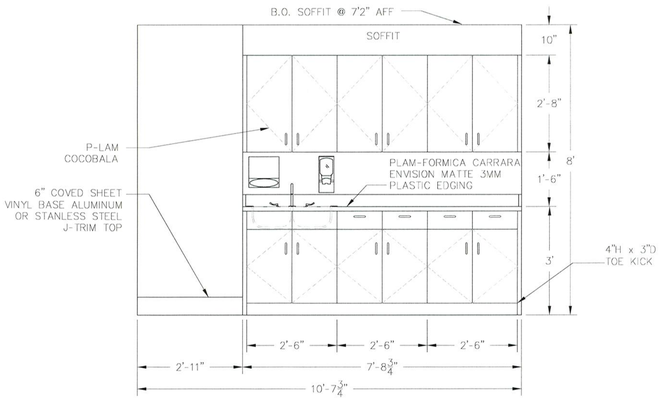


4 A13 BIOHAZARD STORAGE CASEWORK EAST
SCALE: 1/2" = 1'

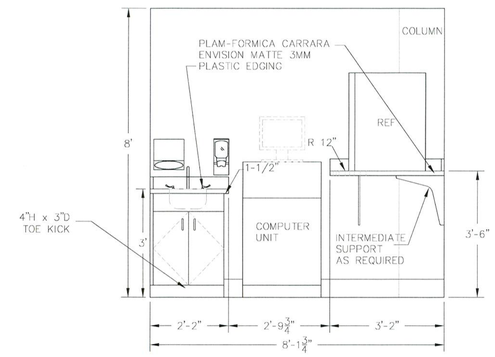


5 A13 MED ROOM 51 EAST
SCALE: 1/2" = 1'

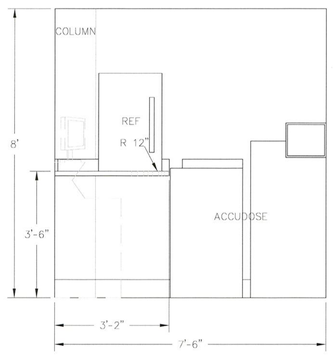


6 A13 MED RM 51 NORTH
SCALE: 1/2" = 1'

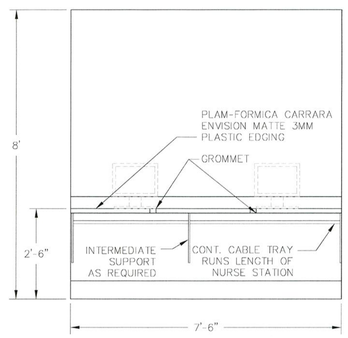


7 A13 DOCTOR'S DICTATION NORTH
SCALE: 1/2" = 1'

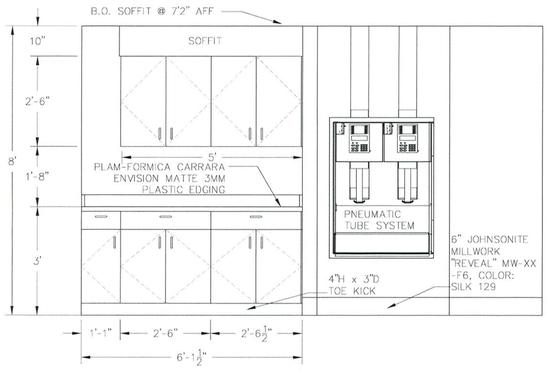

8 A13 WORK AREA 50 SOUTHWEST
SCALE: 1/2" = 1'

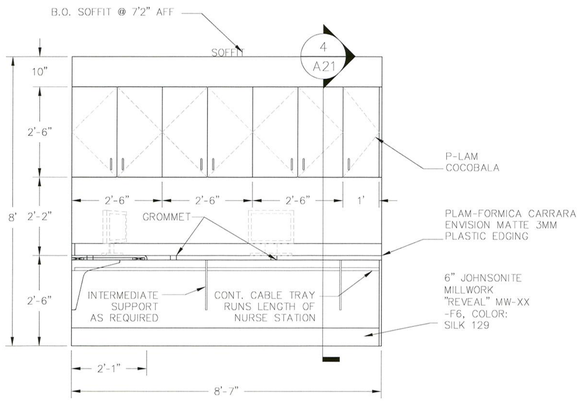

9 A13 WORK AREA 50 EAST
SCALE: 1/2" = 1'

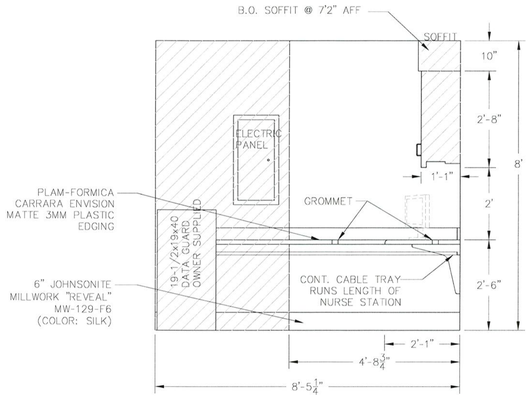

10 A13 WORK AREA 50 EAST
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 3 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
ELEVATIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-13

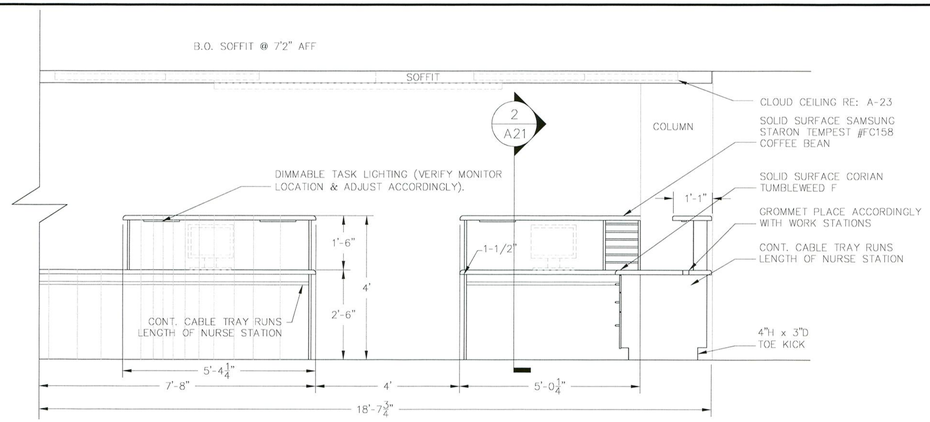


1 A14 NS POD D WEST
SCALE: 1/2" = 1'

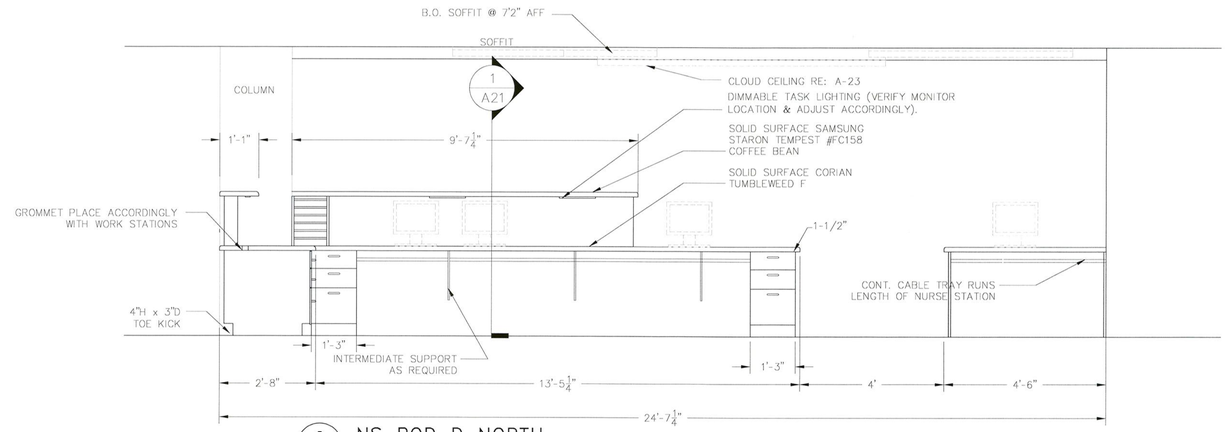


2 A14 NS POD D NORTH
SCALE: 1/2" = 1'

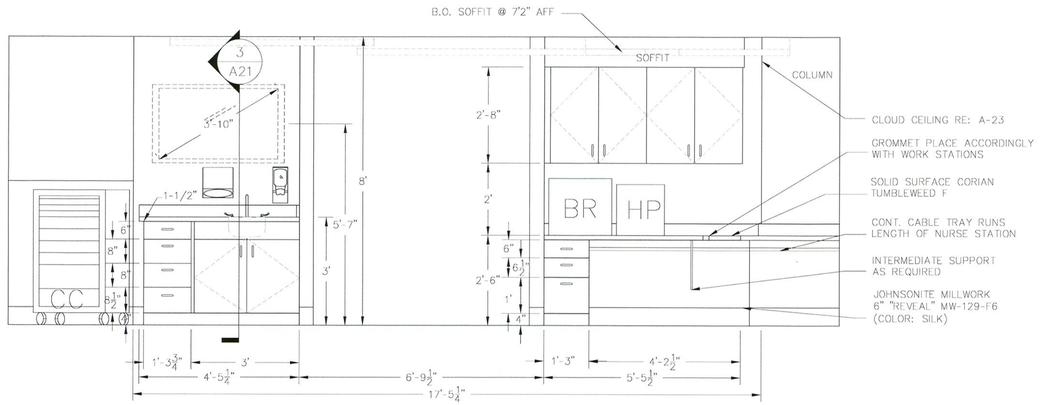

3 A14 NS POD D SOUTH
SCALE: 1/2" = 1'

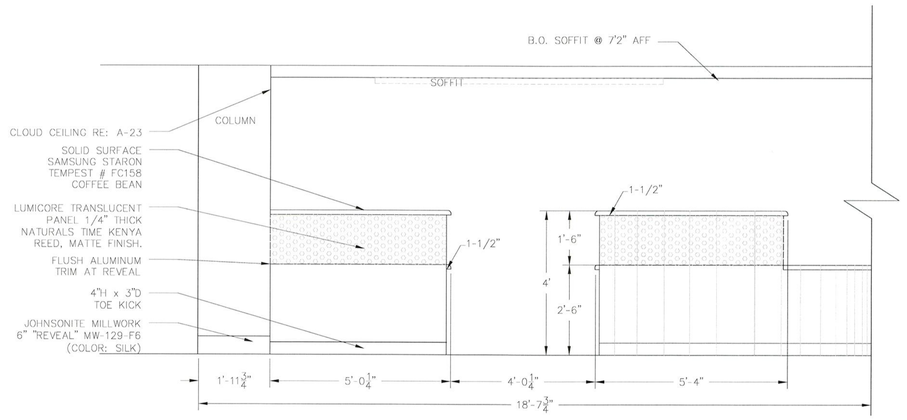

4 A14 NS POD D EXTERIOR EAST
SCALE: 1/2" = 1'

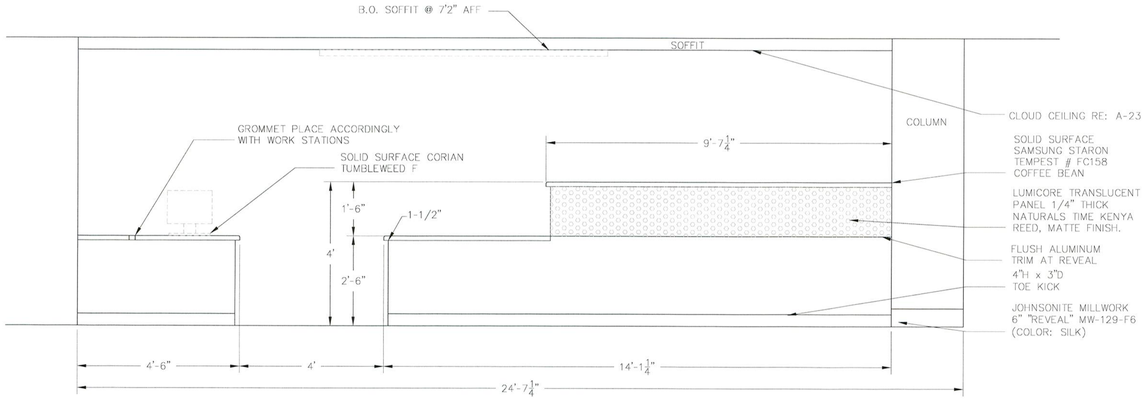

5 A14 NS POD D EXTERIOR SOUTH
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 3 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
PHASE THREE
NURSE STATION
POD D ELEVATIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-14

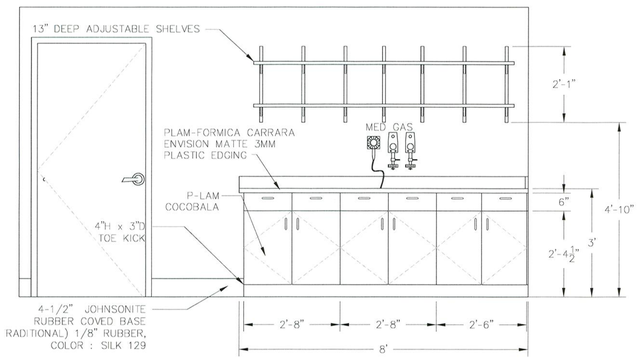


1 A15 RESPIRATORY EQUIP. STOR 49 NORTH ELEV.
SCALE: 1/2" = 1'

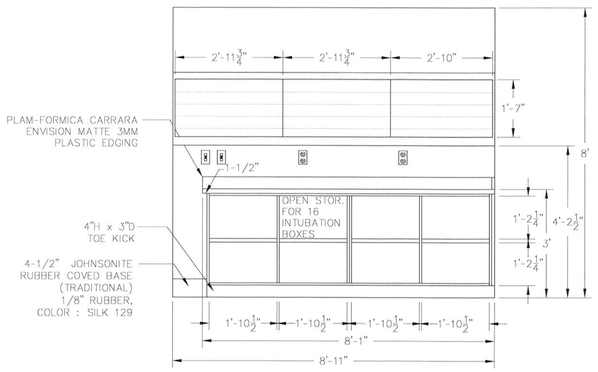


2 A15 RESP EQUIP STOR 49 INTUB. NORTH ELEV.
SCALE: 1/2" = 1'

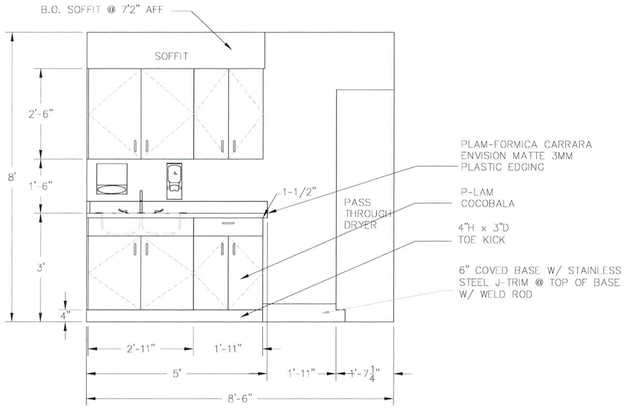


3 A15 SOIL RESP THERAPY EQUIP 48 SOUTH ELEV.
SCALE: 1/2" = 1'

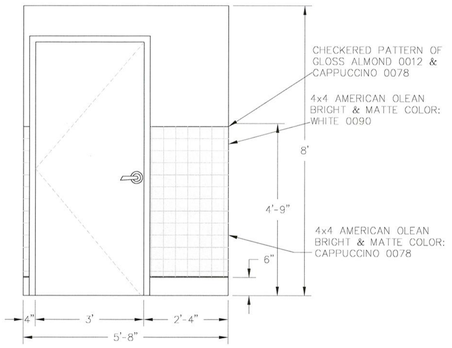


4 A15 BATH 47 EAST ELEV.
SCALE: 1/2" = 1'

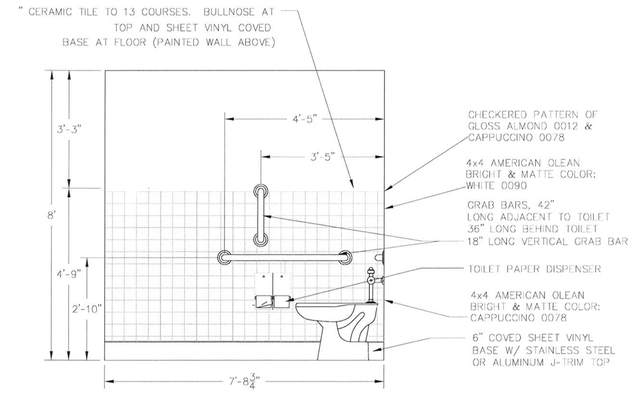


5 A15 BATH 47 SOUTH ELEV.
SCALE: 1/2" = 1'

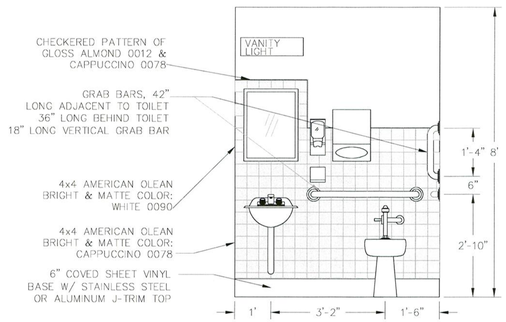

6 A15 BATH 47 WEST ELEV.
SCALE: 1/2" = 1'

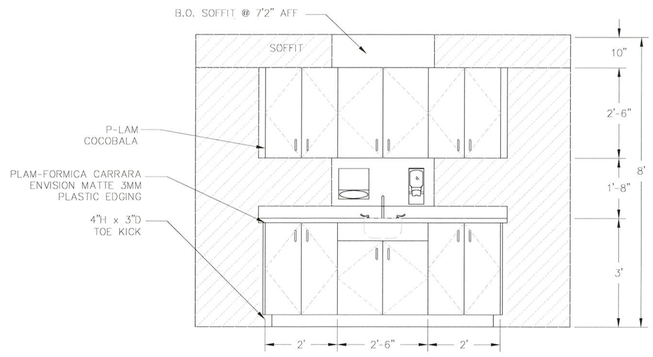

7 A15 ANTE ROOM NORTH EAST
SCALE: 1/2" = 1'

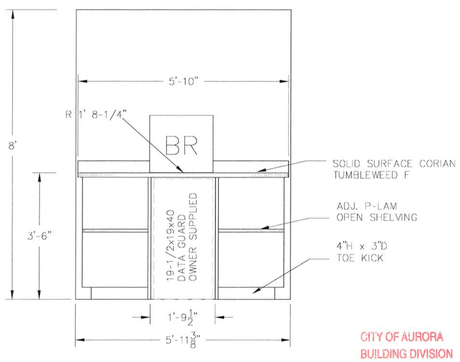

8 A15 POD B DATAGUARD/COUNTER
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 7 2011

11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
ELEVATIONS


KEY PLAN



UPDATED
AUGUST 1, 2011


SCALE
1/2" = 1'

SHEET NUMBER
A-15

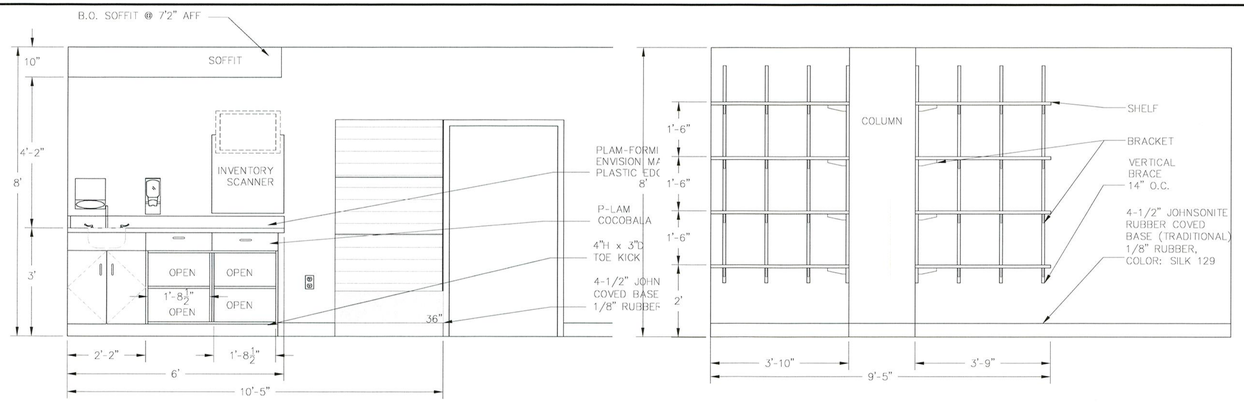


1 A16 CLEAN STOR. 37 WEST
SCALE: 1/2" = 1'


2 A16 CLEAN STOR. 37 SHELVING NORTH
SCALE: 1/2" = 1'

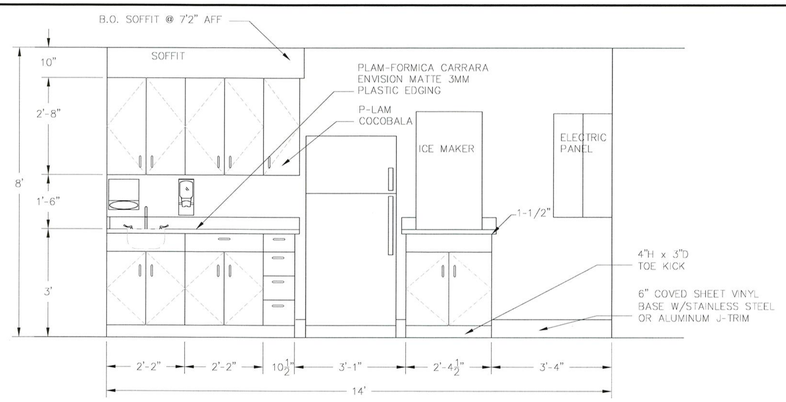


3 A16 ICU NOURISHMENT SOUTH
SCALE: 1/2" = 1'

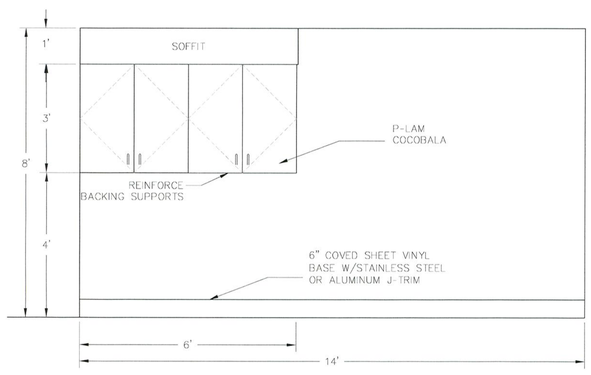


4 A16 ICU NOURISHMENT NORTH
SCALE: 1/2" = 1'

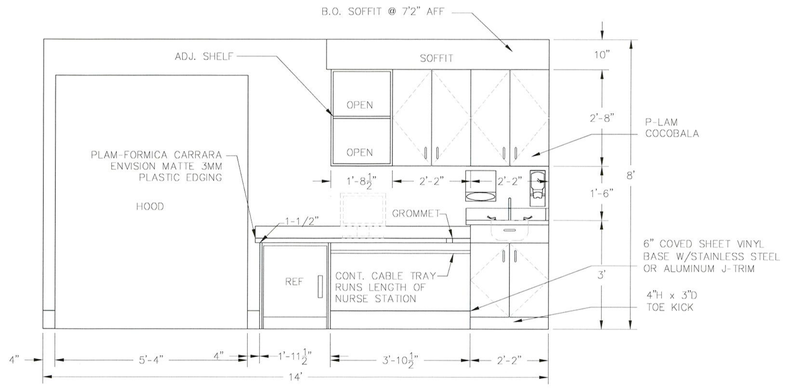


5 A16 PHARMACY NORTH
SCALE: 1/2" = 1'

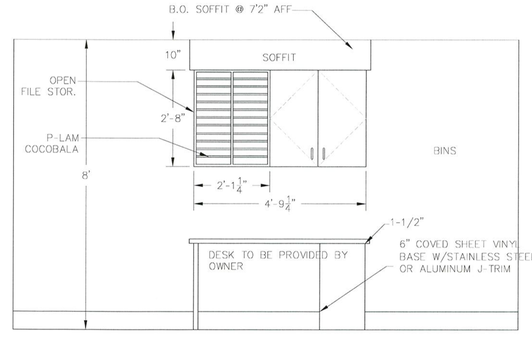


6 A16 PHARMACY SOUTH
SCALE: 1/2" = 1'

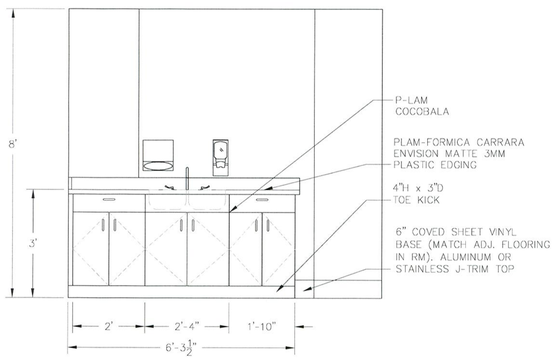

7 A16 SOILED UTILITY SOUTH
SCALE: 1/2" = 1'

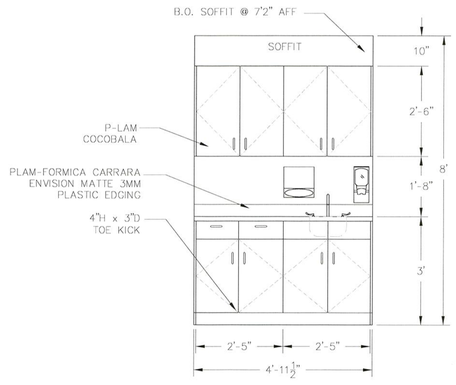

8 A16 ANTE ROOM EAST
SCALE: 1/2" = 1'

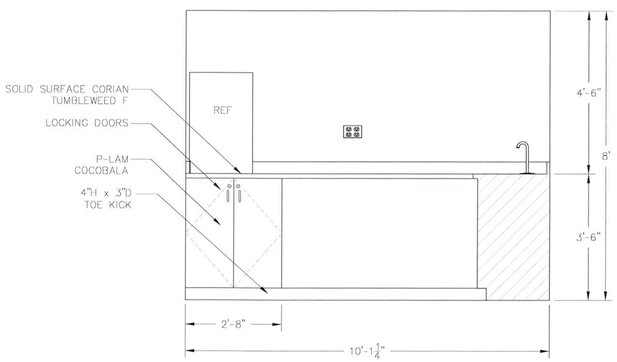

9 A16 GRAB-N-GO
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 8 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012

REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION


SHEET DESCRIPTION
ELEVATIONS

KEY PLAN


UPDATED
AUGUST 6, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-16

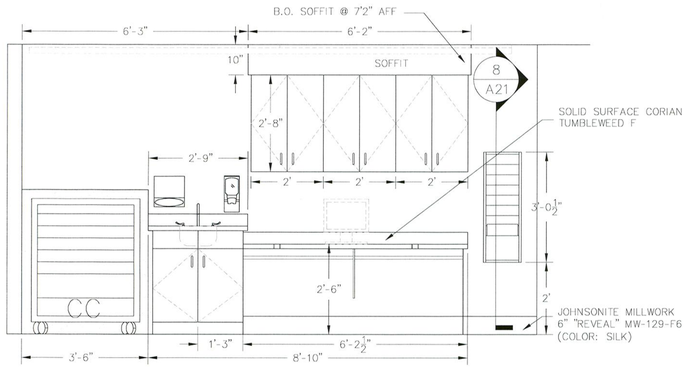


1 A17 NS POD B NORTH
SCALE: 1/2" = 1'

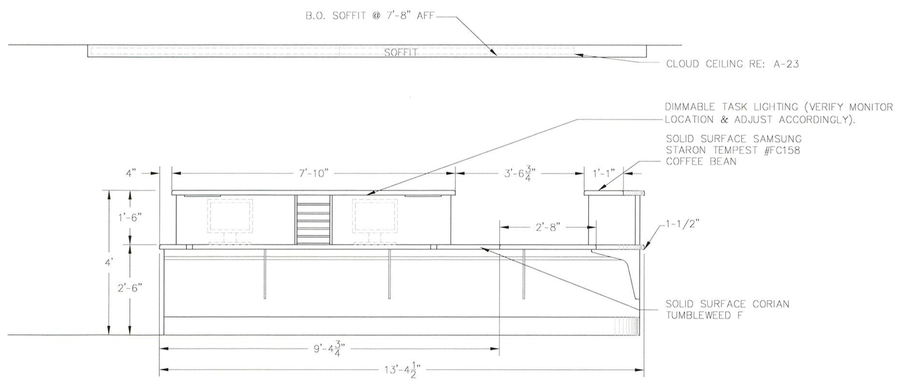


2 A17 NS POD B EAST
SCALE: 1/2" = 1'

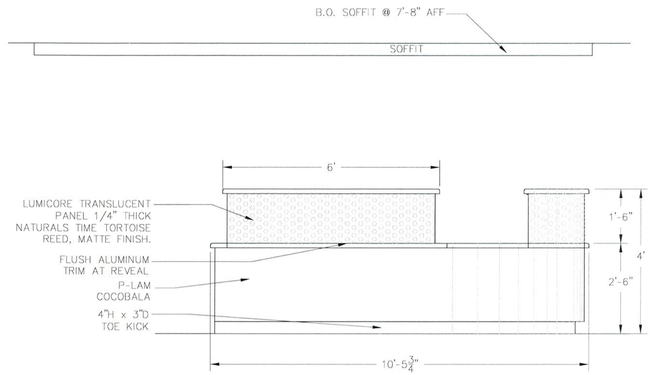


5 A17 NS POD B EAST
SCALE: 1/2" = 1'

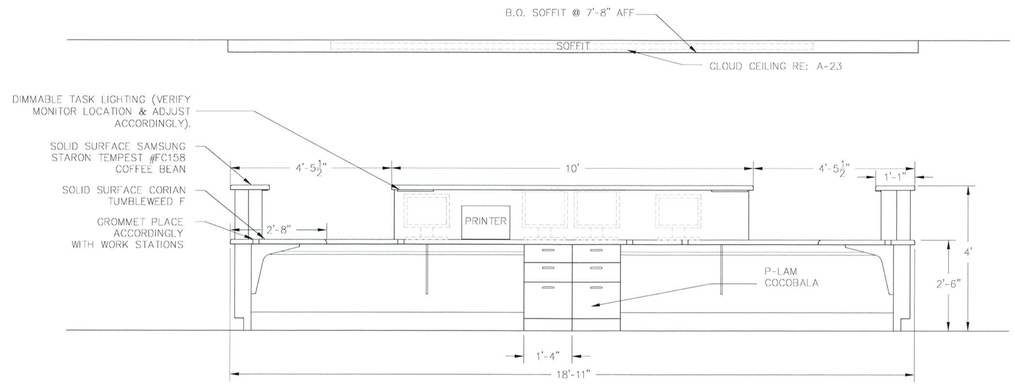


3 A17 NS POD B SOUTH
SCALE: 1/2" = 1'

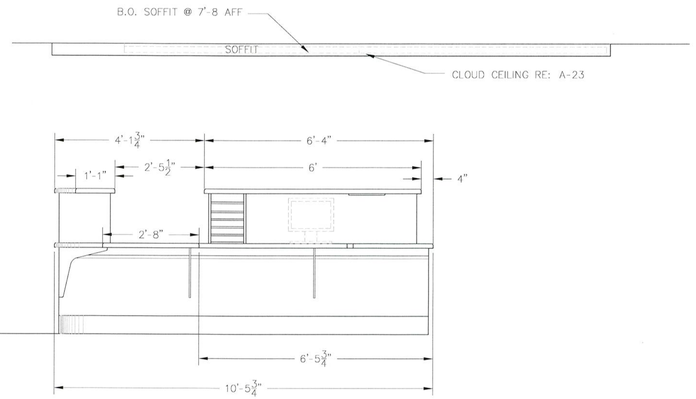


4 A17 NS POD B WEST
SCALE: 1/2" = 1'

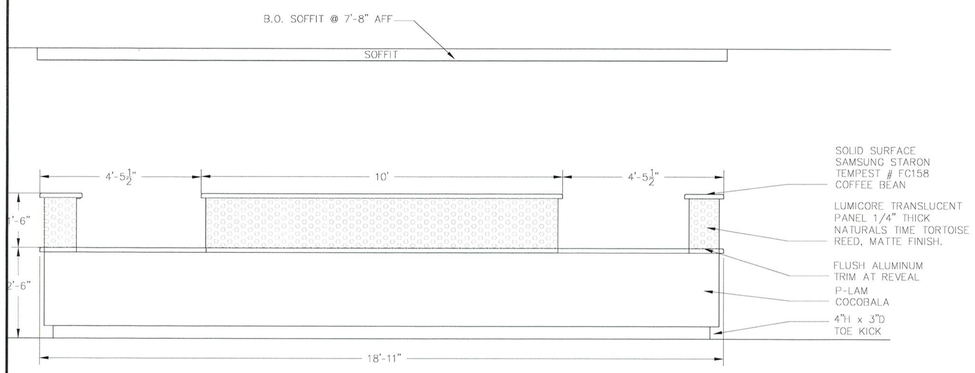

6 A17 NS POD B WEST EXTERIOR NORTH
SCALE: 1/2" = 1'

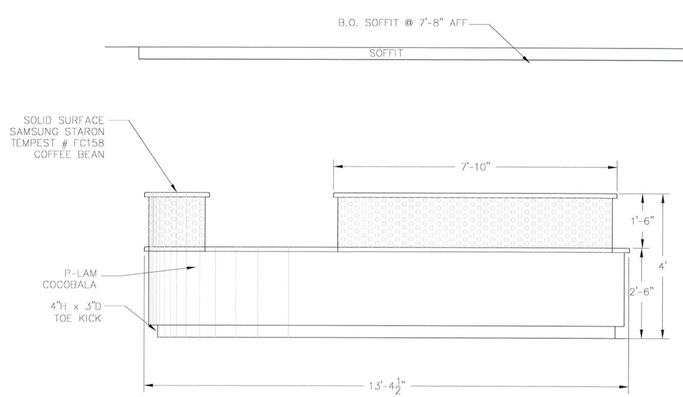

7 A17 NS POD B WEST EXTERIOR WEST
SCALE: 1/2" = 1'

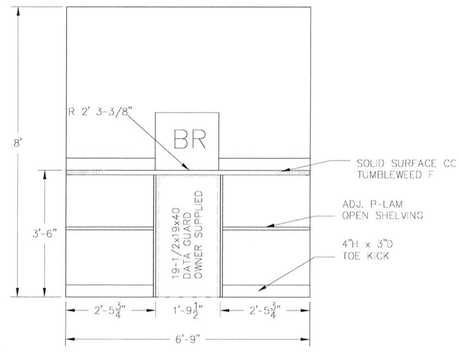

8 A17 POD C DATA GUARD/COUNTER
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 6 2011

11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN
LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
PHASE TWO
NURSE STATION
POD B ELEVATIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'

SHEET NUMBER
A-17

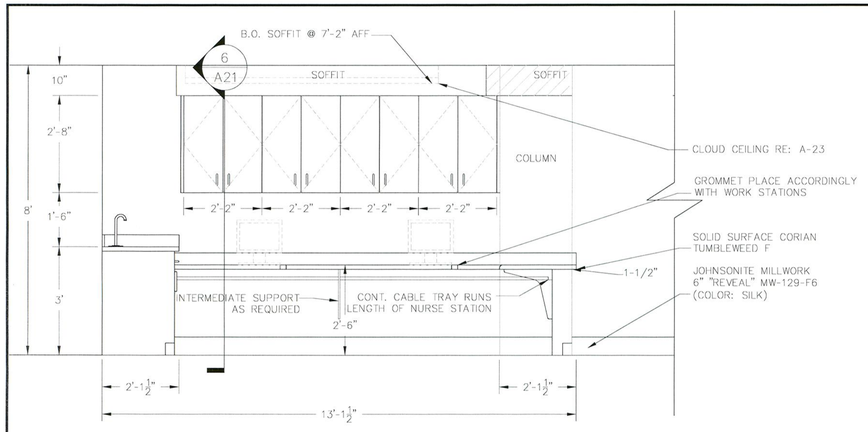


1 A18 NS POD C WEST
SCALE: 1/2" = 1'

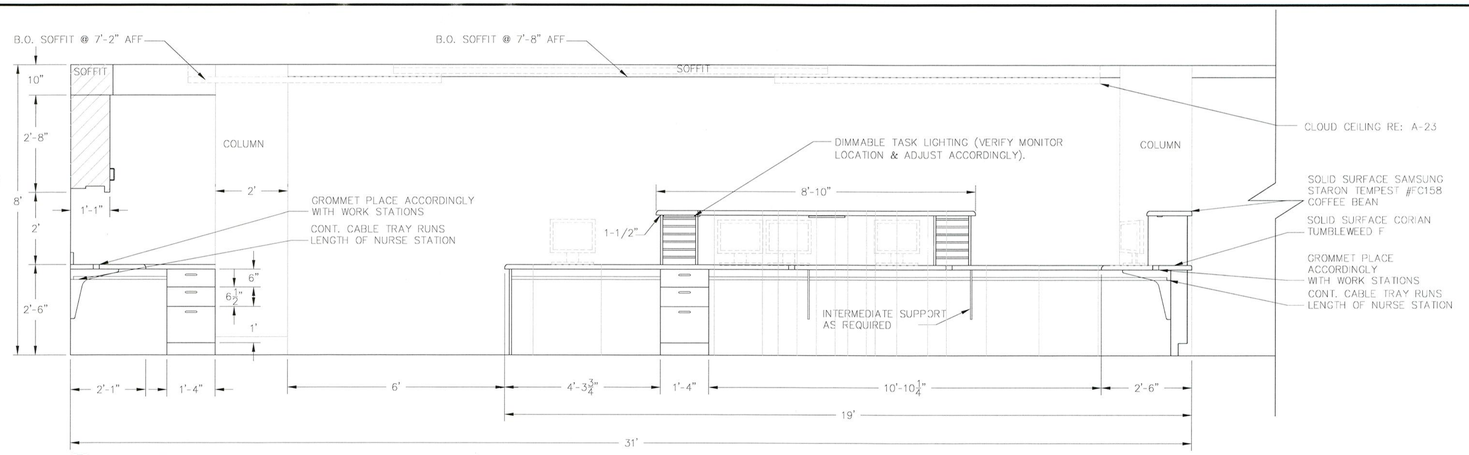


2 A18 NS POD C NORTH
SCALE: 1/2" = 1'

3 A18 NS POD C EAST
SCALE: 1/2" = 1'

4 A18 NS POD C SOUTH
SCALE: 1/2" = 1'

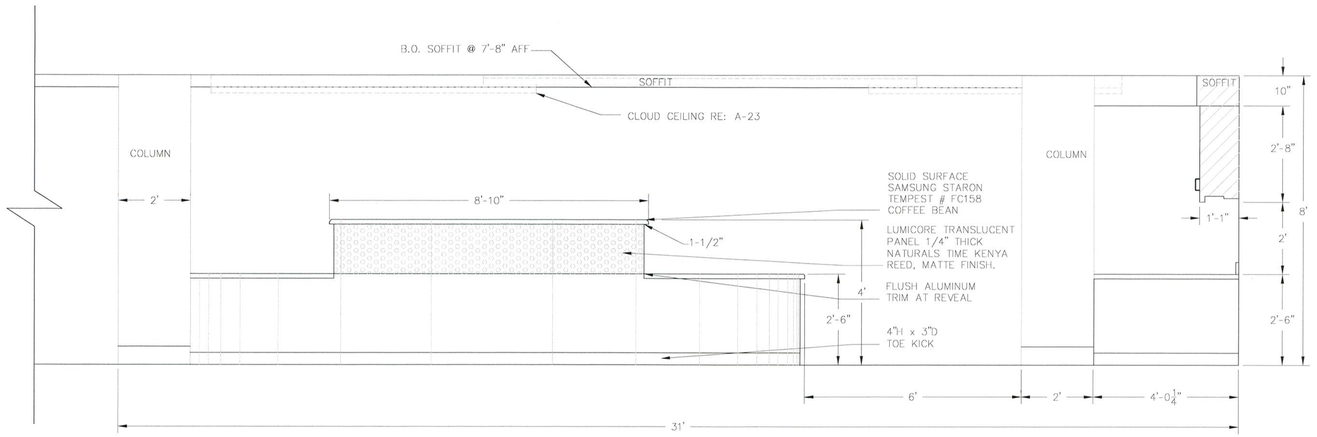

5 A18 NS POD C EXTERIOR SOUTH
SCALE: 1/2" = 1'

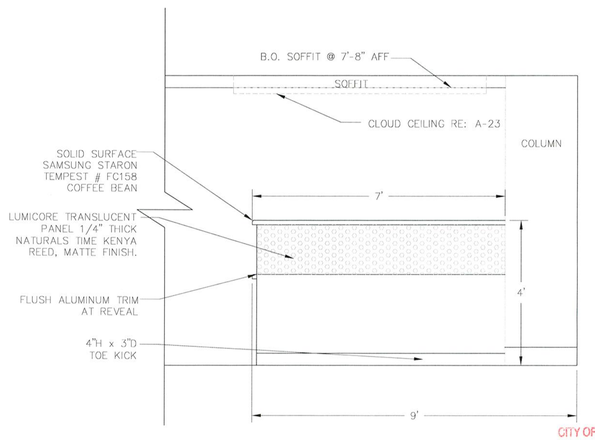

6 A18 NS POD C EXTERIOR WEST
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 2 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

dp DESIGN LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
PHASE TWO
NURSE STATION
POD C ELEVATIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-18

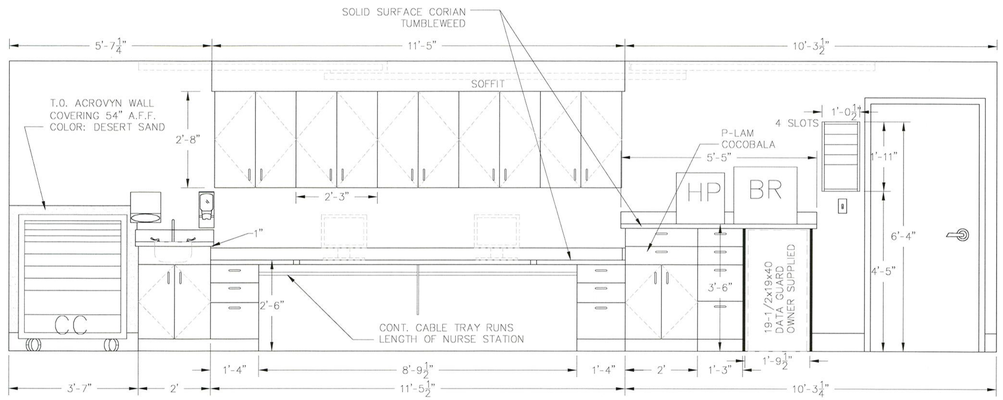

1 / A19 NURSING STATION POD A NORTH
SCALE: 1/2" = 1'

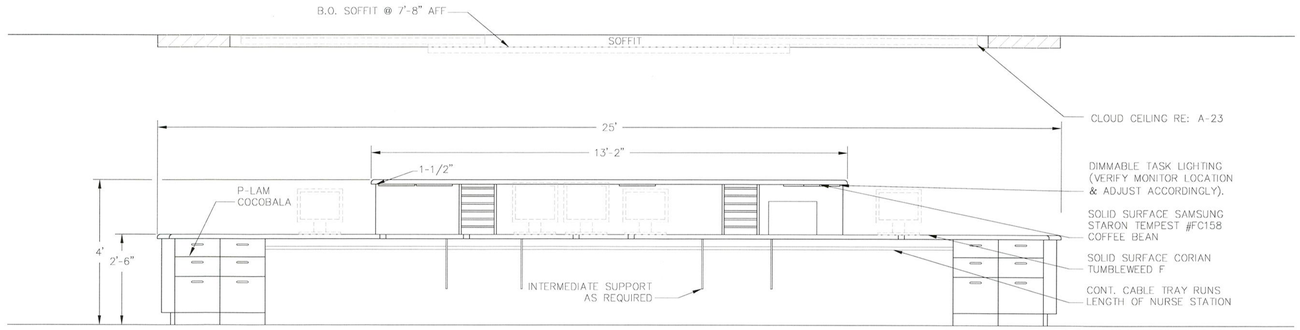

2 / A19 NURSING STATION POD A SOUTH
SCALE: 1/2" = 1'

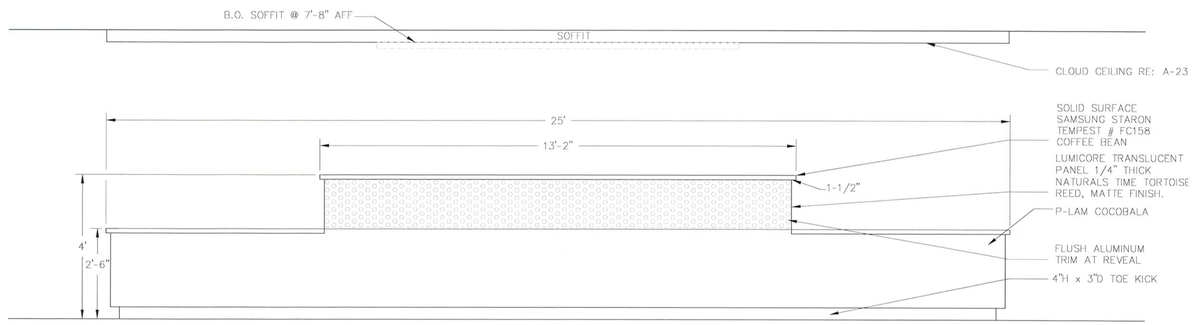

3 / A19 NURSING STATION POD A NORTH EXTERIOR
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 3 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN
LOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
RESPIRATORY DEPT
&
PHASE ONE
NURSE STATION
POD A ELEVATIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-19

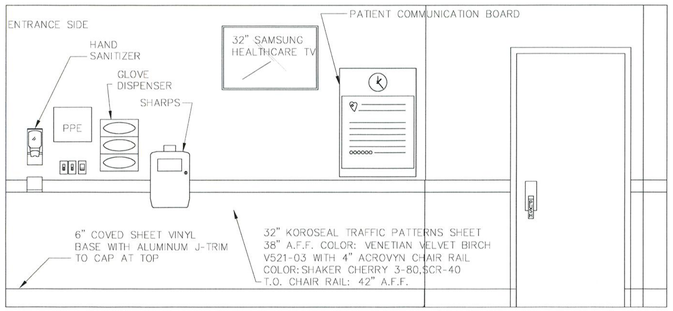


1 A20 TYPICAL PATIENT ROOM
SCALE: 1/2" = 1'

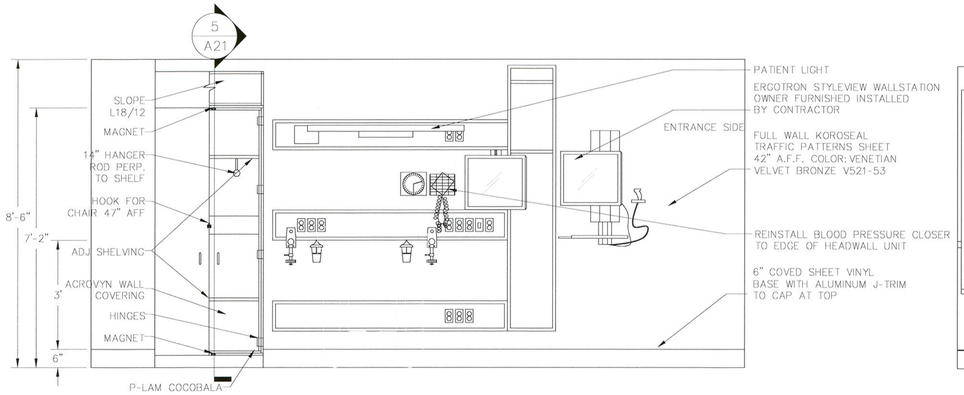


2 A20 TYPICAL PATIENT ROOM
SCALE: 1/2" = 1'

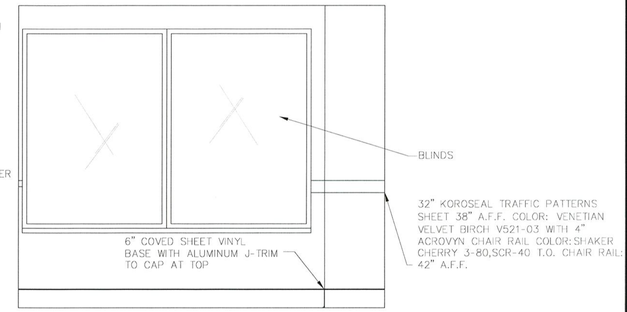


3 A20 TYPICAL PATIENT ROOM
SCALE: 1/2" = 1'

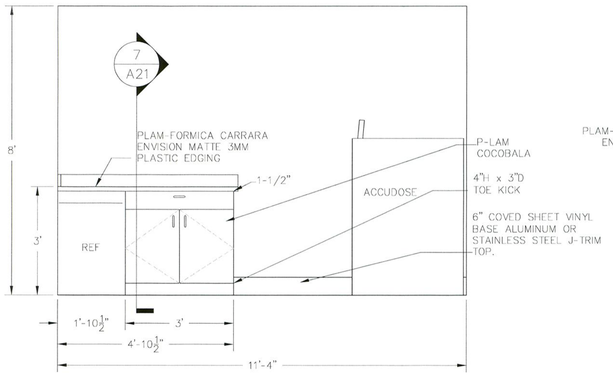

4 A20 MED ROOM EAST
SCALE: 1/2" = 1'

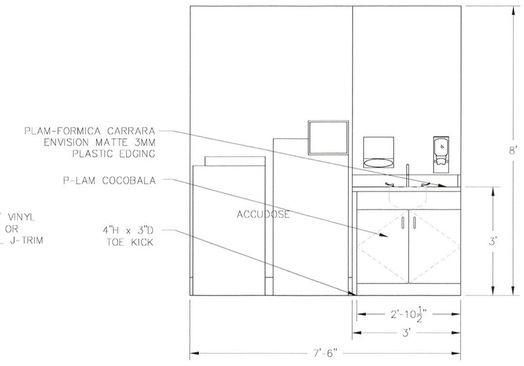

4 A20 MED ROOM EAST
SCALE: 1/2" = 1'

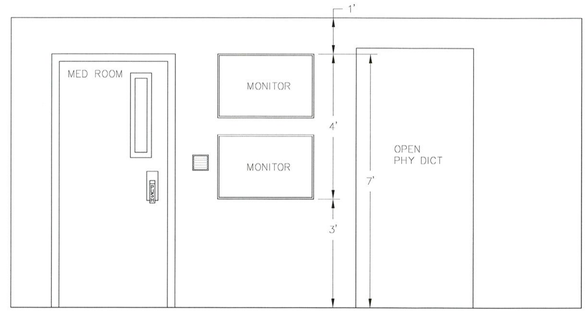

VIEWING HALL WIDTH - 4'8"

5 A20 CORRIDOR 02 MONITOR ELEVATION
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 3 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN PLOT

THE MEDICAL CENTER OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
ELEVATIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-20

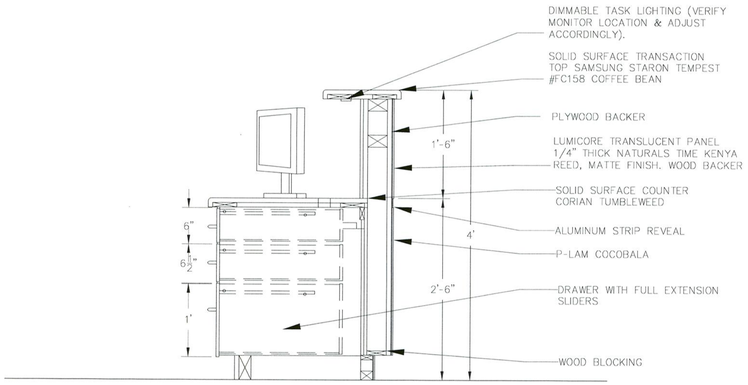


1 A21 NS POD D SECTION
SCALE: 1/2" = 1'

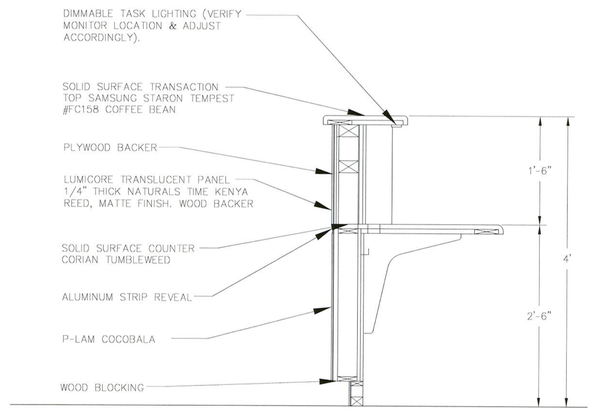


2 A21 NS POD D SECTION
SCALE: 1/2" = 1'

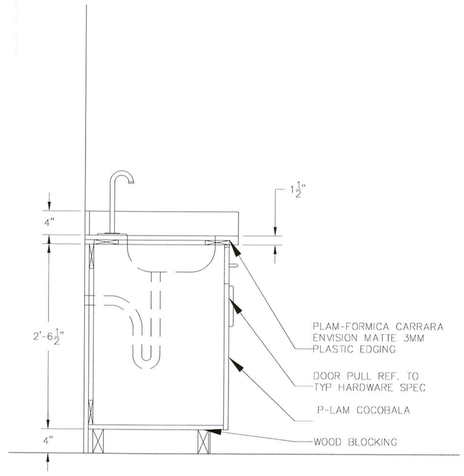


3 A21 NURSE STATION POD D
SCALE: 1/2" = 1'

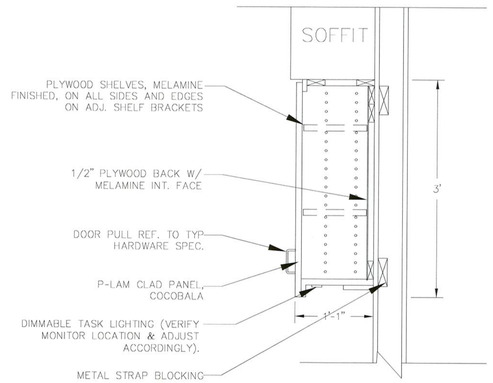


4 A21 SECTION TYP. UPPER CABINETS
SCALE: 1/2" = 1'

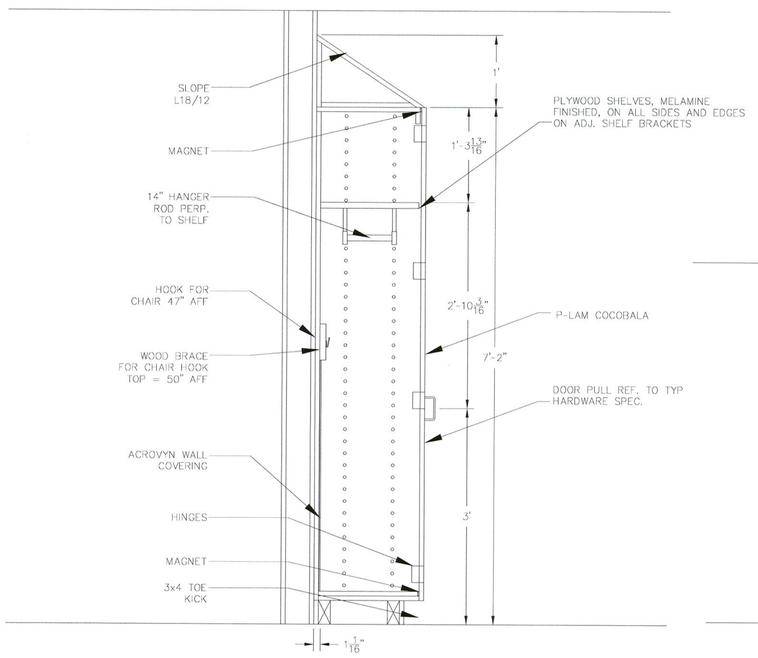

5 A21 PATIENT ROOM CASEWORK SECTION
SCALE: 1/2" = 1'

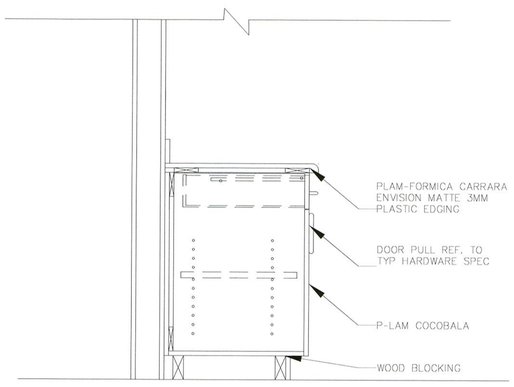

7 A21 ICU LOUNGE SECTION
SCALE: 1/2" = 1'

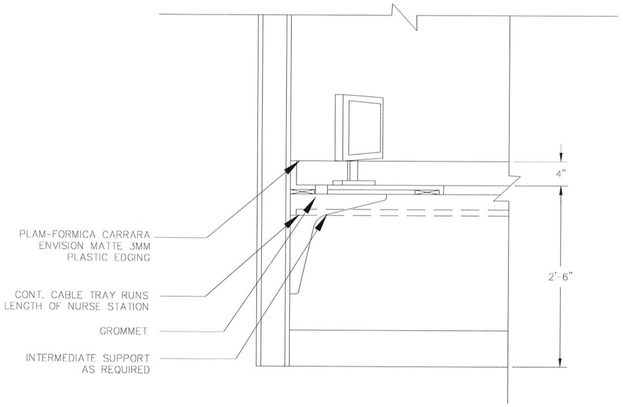

6 A21 NS POD C SECTION
SCALE: 1/2" = 1'

Concrete wood structure
To be Fire Retardant Treated
ONLY

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 23 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
CASEWORK
SECTIONS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'


SHEET NUMBER
A-21

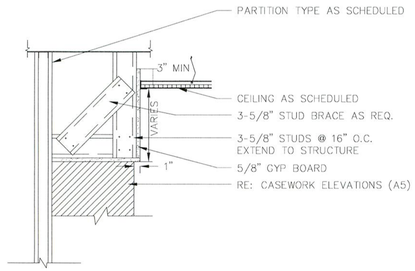


1 A22 DETAIL @ SOFFIT
SCALE: 1"=1'

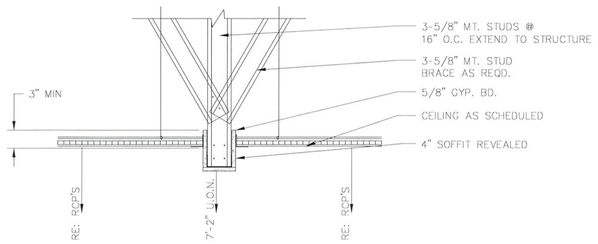


2 A22 DETAIL @ HEADER
SCALE: 1" = 1'

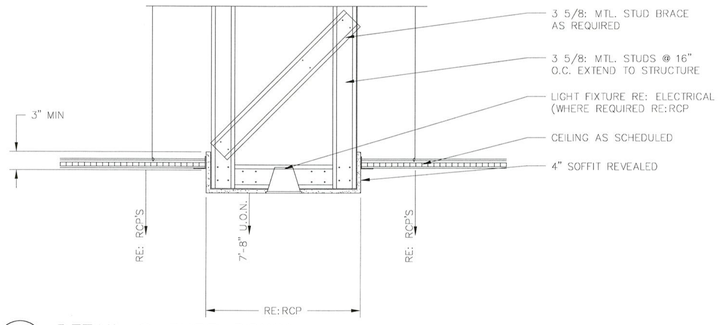


3 A22 DETAIL @ FURR DOWN
SCALE: 1" = 1'

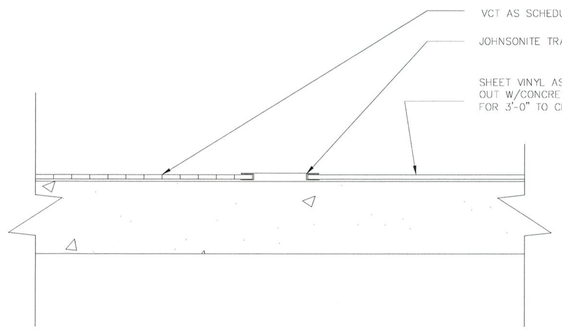


4 A22 VCT/SHEET VINYL DETAIL
SCALE: 3" = 1'

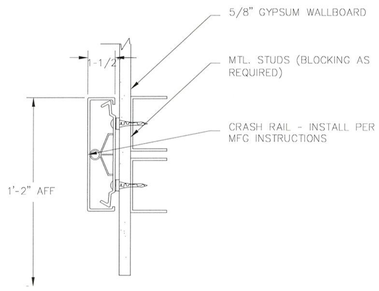

5 A22 WALL PROTECTION WP-4
SCALE: 3" = 1'

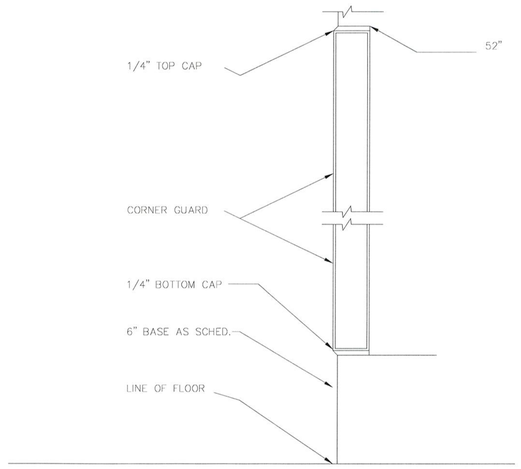

6 A22 CORNER GUARD DETAIL
SCALE: 3" = 1'

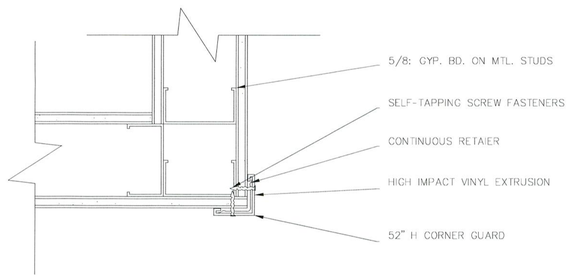

7 A22 WALL PROTECTION-WP1
SCALE: 3" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 2011

11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN PLOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
DETAILS


KEY PLAN




UPDATED
AUGUST 1, 2011

SCALE
VARIES


SHEET NUMBER
A-22

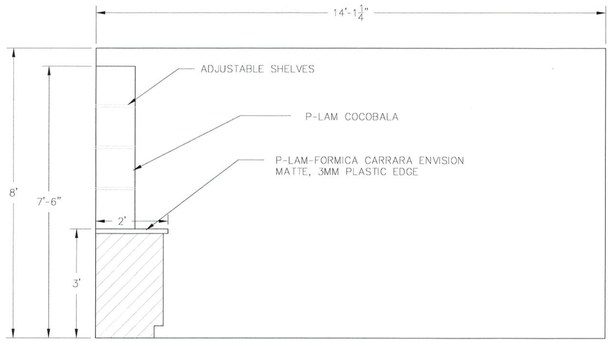


1 A24 OFFICE NORTH WALL
SCALE: 1/2" = 1'

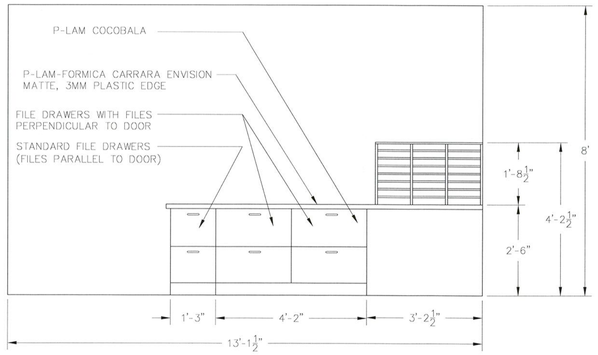

2 A24 OFFICE EAST WALL
SCALE: 1/2" = 1'

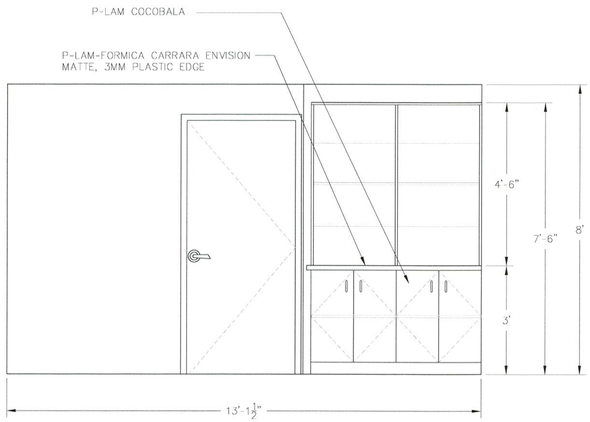

3 A24 OFFICE WEST WALL
SCALE: 1/2" = 1'

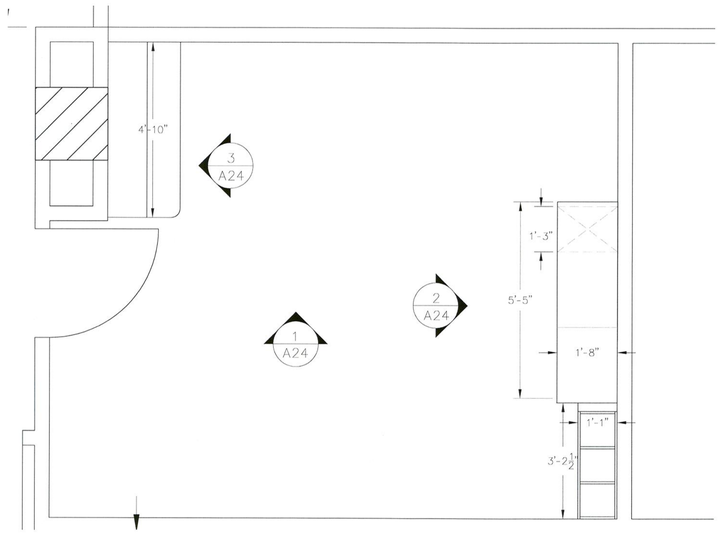

4 A24 OFFICE ENLARGED PLAN
SCALE: 1/2" = 1'

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 2 2011
11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN PLOT

THE MEDICAL CENTER
OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
WEST TOWER B
ICU RENOVATION

SHEET DESCRIPTION
OFFICE ROOM 52
ELEVATIONS


KEY PLAN



UPDATED
AUGUST 1, 2011

SCALE
1/2" = 1'

SHEET NUMBER
A-24

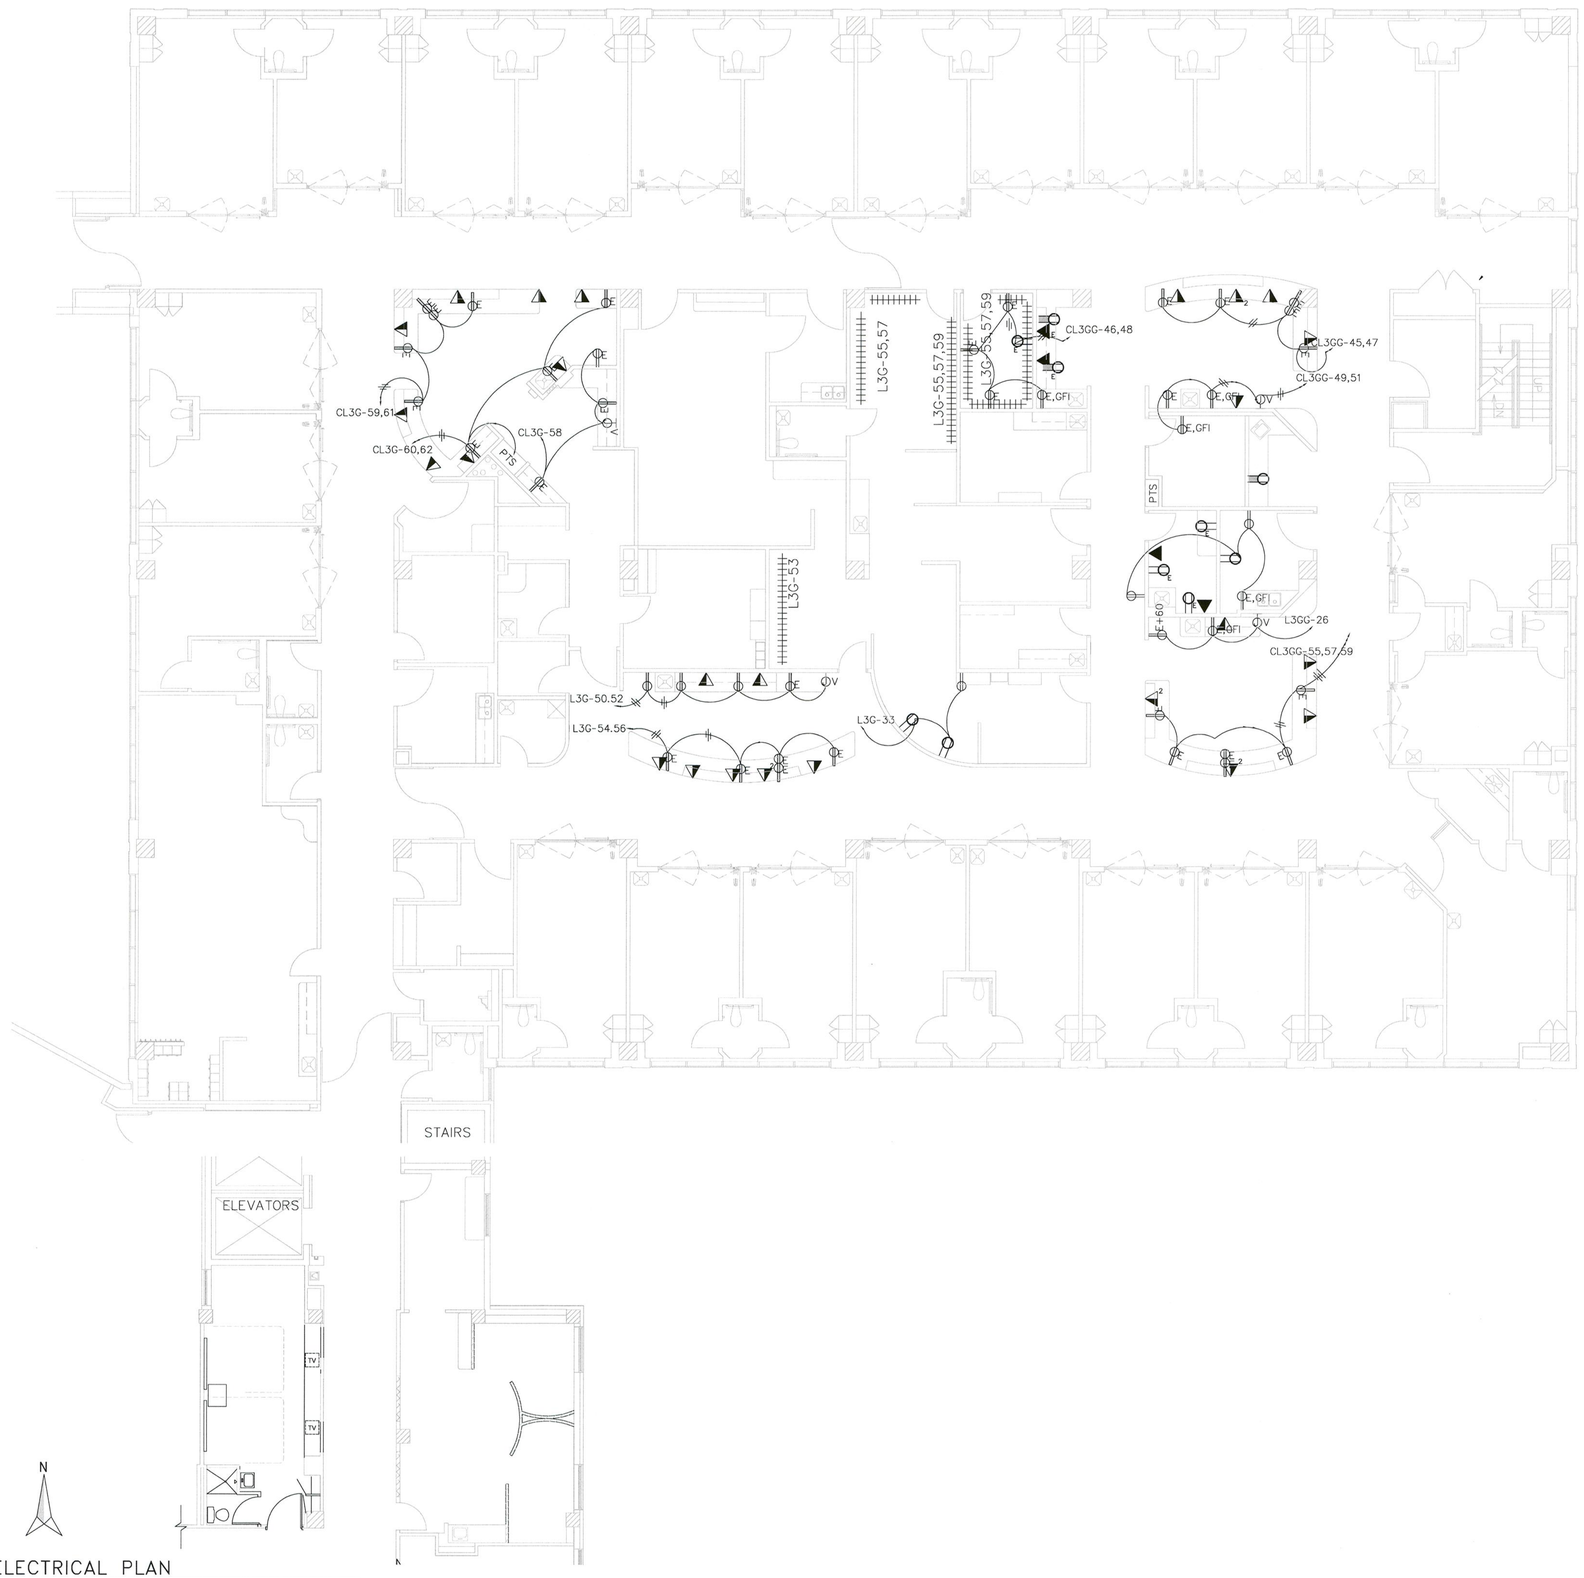

ELECTRICAL PLAN
1/8" = 1'

ELECTRICAL SYMBOL LEGEND

- J — JUNCTION BOX
- J — WALL MOUNTED JUNCTION BOX
- — DUPLEX RECEPTACLE 18" A.F.F. O.C. EXISTING TO BE RELOCATED
- E — EMERGENCY DUPLEX RECEPTACLE 18" A.F.F. O.C. EXISTING TO BE RELOCATED
- M — DUPLEX RECEPTACLE 72" A.F.F. O.C.
- — DUPLEX RECEPTACLE ABOVE COUNTER BACK SPLASH. EXISTING TO BE RELOCATED
- E — EMERGENCY DUPLEX RECEPTACLE ABOVE COUNTER BACK SPLASH. EXISTING TO BE RELOCATED
- GFI — DUPLEX RECEPTACLE ABOVE COUNTER BACK SPLASH WITH GROUND FAULT INTERRUPTER. EXISTING TO BE RELOCATED
- VCC — DUPLEX RECEPTACLE FOR VIDEO CAMERA (SECURITY OR PATIENT MONITORING) UNDER COMMON COVERPLATE WITH VIDEO CAMERA OUTLET. MATCH MOUNTING HEIGHT OF COAZIAL OUTLET. (VCC = CEILNG MOUNTED) EXISTING TO BE RELOCATED
- E+60 — DUPLEX RECEPTACLE @ 60" A.F.F. O.C. EXISTING TO BE RELOCATED
- — NEW DUPLEX RECEPTACLE @ 18" A.F.F O.C.
- — NEW DUPLEX RECEPTACLE ABOVE COUNTER BACK SPLASH
- E — NEW EMERGENCY DUPLEX RECEPTACLE ABOVE COUNTER BACK SPLASH
- GFI — NEW DUPLEX RECEPTACLE ABOVE COUNTER BACK SPLASH WITH GROUND FAULT INTERRUPTER
- — EXISTING PHONE/DATA RECEPTACLE 18" A.F.F. O.C. RELOCATE AS NEEDED
- ▲ — NEW DATA RECEPTACLE A.F.F. O.C
- △ — EXISTING PHONE RECEPTACLE A.F.F. O.C
- NAM — NEGATIVE AIR MONITOR
- — HOMERUN TO PANELBOARD, PANELBOARD DESIGNATION AND CIRCUIT BOARD AS NOTED.
- — CONDUIT AND WIRING CONCEALED
- — MARKS INDICATE NUMBER OF 12 CONDUCTORS, EXCLUSIVE OF GROUND. IN RACEWAY, UON. NO MARKS INDICATES 2#12 & 1#12 GROUND UON.
- ——— — PLUGMOLD 1000 PLUG MOLDING / 24" SPACING, NO TELE/DATA PROVISIONS REQUIRED IN THE RACEWAY. INSTALL @ 52" AFF.

Relocate existing circuits

CITY OF AURORA
BUILDING DIVISION
APPROVED AS NOTED
DATE SEP 3 2011

11-563087

The Medical Center of Aurora
Health ONE

THE DESIGN PLOT
PARKER, CO 80138

DESIGN LOT

THE MEDICAL CENTER OF AURORA
1501 S. POTOMAC ST.
AURORA, CO 80012


REVISION & DESCRIPTION

DRAWN BY:
TH
JM

PROJECT
3RD FLOOR
EAST TOWER B

SHEET DESCRIPTION
POWER PLAN

KEY PLAN



UPDATED
AUGUST 1, 2011

SCALE
1/8" = 1'

SHEET NUMBER
E-1