

GENERAL		05-30-2025 - FOUNDATIONS ONLY I/P
Sheet Number	Sheet Name	
01 - GENERAL		
G00-00	COVER SHEET	X
G00-01	SHEET INDEX	X
G00-02	SHEET INDEX	X
G01-01	LIFE SAFETY PLAN -LEVEL ONE -OVERALL	X
G01-01A	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT A	X
G01-01B	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT B	X
G01-01C	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT C	X
G01-01D	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT D	X
G01-01E	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT E	X
G01-01F	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT F	X
G01-01H	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT H	X
G01-01K	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT K	X
G01-01M	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT M	X
G01-01P	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT P	X
G01-01R	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT R	X
G01-01ST	LIFE SAFETY PLAN -LEVEL ONE -SEGMENT S & T	X
G02-02	LIFE SAFETY PLAN -LEVEL TWO -OVERALL	X
G02-02A	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT A	X
G02-02B	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT B	X
G02-02C	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT C	X
G02-02D	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT D	X
G02-02E	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT E	X
G02-02H	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT H	X
G02-02K	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT K	X
G02-02M	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT M	X
G02-02P	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT P	X
G02-02R	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT R	X
G02-02ST	LIFE SAFETY PLAN -LEVEL TWO -SEGMENT S & T	X

STRUCTURAL			05-30-2025 - FOUNDATIONS ONLY I/P
Sheet Number	Sheet Name		
S0-00	GENERAL NOTES	X	
S0-01	GENERAL NOTES	X	
S0-02	GENERAL NOTES	X	
S0-03	LOADING DIAGRAM	X	
S0-04	LOADING DIAGRAM	X	
S0-05	LOADING DIAGRAM	X	
S0-06	LOADING DIAGRAM	X	
S0-07	SNOW LOAD DIAGRAM	X	
S0-08	SNOW LOAD DIAGRAM	X	
S0-09	OVERALL 3D VIEW	X	
S0-11	ROOF WIND UPLIFT DIAGRAM	X	
S0-12	GENERAL NOTES	X	
S1-10	OVERALL FOUNDATION PLAN	X	
S1-10A	FOUNDATION PLAN - SEGMENT A	X	
S1-10B	FOUNDATION PLAN - SEGMENT B	X	
S1-10C	FOUNDATION PLAN - SEGMENT C	X	
S1-10D	FOUNDATION PLAN - SEGMENT D	X	
S1-10E	FOUNDATION PLAN - SEGMENT E	X	
S1-10F	FOUNDATION PLAN - SEGMENT F	X	
S1-10G	FOUNDATION PLAN - SEGMENT G	X	
S1-10H	FOUNDATION PLAN - SEGMENT H	X	
S1-10J	FOUNDATION PLAN - SEGMENT J	X	
S1-10K	FOUNDATION PLAN - SEGMENT K	X	
S1-10L	FOUNDATION PLAN - SEGMENT L	X	
S1-10M	FOUNDATION PLAN - SEGMENT M	X	
S1-10N	FOUNDATION PLAN - SEGMENT N	X	
S1-10P	FOUNDATION PLAN - SEGMENT P	X	
S1-10Q	FOUNDATION PLAN - SEGMENT Q	X	
S1-10R	FOUNDATION PLAN - SEGMENT R	X	
S1-10S	FOUNDATION PLAN - SEGMENT S	X	
S1-10T	FOUNDATION PLAN - SEGMENT T	X	
S1-11	PARTIAL FOUNDATION PLANS	X	
S2-00	OVERALL SECOND FLOOR FRAMING PLAN	X	
S1-30	OVERALL ROOF FRAMING PLAN	X	
S1-40	OVERALL PLATFORM FRAMING PLAN	X	
S2-00	FRAME ELEVATIONS	X	
S2-01	FRAME ELEVATIONS	X	
S2-02	FRAME ELEVATIONS	X	
S2-03	FRAME ELEVATIONS	X	
S2-04	FRAME ELEVATIONS	X	
S2-05	FRAME ELEVATIONS	X	
S2-06	FRAME ELEVATIONS	X	
S2-07	FRAME ELEVATIONS	X	
S2-08	FRAME ELEVATIONS	X	
S2-09	FRAME ELEVATIONS	X	
S2-10	FRAME ELEVATIONS	X	
S2-11	FRAME ELEVATIONS	X	
S2-12	FRAME ELEVATIONS	X	
S2-13	FRAME ELEVATIONS	X	
S2-30	TYPICAL BRACING DETAILS	X	
S3-00	PIER GRADE BEAM SCHEDULE AND TYPICAL...	X	
S3-01	TYPICAL FOUNDATION DETAILS	X	
S3-10	FOUNDATION DETAILS	X	
S3-11	FOUNDATION DETAILS	X	
S3-12	FOUNDATION DETAILS	X	
S3-20	FOUNDATION DETAILS	X	
S3-21	FOUNDATION DETAILS	X	
S5-00	TYPICAL STEEL COLUMN DETAILS AND BASE PLATE...	X	


ARCHITECTURAL		05.30.2025 - FOUNDATIONS ONLY	FFP
Sheet Number	Sheet Name		
08 - ARCHITECTURAL	SITE PLAN		
A01-00	CAMPUS SITE PLAN		X
A01-02	ENLARGED SITE PLAN DETAILS		X
A02-00	WALL & PARTITION TYPES		X
A02-00B	WALL & PARTITION TYPES		X
A02-00C	WALL & PARTITION DETAILS		X
A02-00D	DEFLECTION DETAILS		X
A02-00E	SECURE WALL MOCK-UP		X
A02-01	FLOOR PLAN -LEVEL ONE -OVERALL		X
A02-01A	FLOOR PLAN -LEVEL ONE -SEGMENT A		X
A02-01B	FLOOR PLAN -LEVEL ONE -SEGMENT B		X
A02-01C	FLOOR PLAN -LEVEL ONE -SEGMENT C		X
A02-01D	FLOOR PLAN -LEVEL ONE -SEGMENT D		X
A02-01E	FLOOR PLAN -LEVEL ONE -SEGMENT E		X
A02-01F	FLOOR PLAN -LEVEL ONE -SEGMENT F		X
A02-01G	FLOOR PLAN -LEVEL ONE -SEGMENT G		X
A02-01H	FLOOR PLAN -LEVEL ONE -SEGMENT H		X
A02-01J	FLOOR PLAN -LEVEL ONE -SEGMENT J		X
A02-01K	FLOOR PLAN -LEVEL ONE -SEGMENT K		X
A02-01L	FLOOR PLAN -LEVEL ONE -SEGMENT L		X
A02-01M	FLOOR PLAN -LEVEL ONE -SEGMENT M		X
A02-01N	FLOOR PLAN -LEVEL ONE -SEGMENT N		X
A02-01P	FLOOR PLAN -LEVEL ONE -SEGMENT P		X
A02-01Q	FLOOR PLAN -LEVEL ONE -SEGMENT Q		X
A02-01R	FLOOR PLAN -LEVEL ONE -SEGMENT R		X
A02-01ST	FLOOR PLAN -LEVEL ONE -SEGMENT S & T		X
A02-02	FLOOR PLAN -LEVEL TWO -OVERALL		X
A02-02A	FLOOR PLAN -LEVEL TWO -SEGMENT A		X
A02-02B	FLOOR PLAN -LEVEL TWO -SEGMENT B		X
A02-02C	FLOOR PLAN -LEVEL TWO -SEGMENT C		X
A02-02D	FLOOR PLAN -LEVEL TWO -SEGMENT D		X
A02-02E	FLOOR PLAN -LEVEL TWO -SEGMENT F		X
A02-02F	FLOOR PLAN -LEVEL TWO -SEGMENT H		X
A02-02K	FLOOR PLAN -LEVEL TWO -SEGMENT K		X
A02-02M	FLOOR PLAN -LEVEL TWO -SEGMENT M		X
A02-02P	FLOOR PLAN -LEVEL TWO -SEGMENT P		X
A02-02R	FLOOR PLAN -LEVEL TWO -SEGMENT R		X
A02-02ST	FLOOR PLAN -LEVEL TWO -SEGMENT S & T		X
A02-R	FLOOR PLAN -ROOF -OVERALL		X
A02-RA	FLOOR PLAN -ROOF -SEGMENT A		X
A02-RB	FLOOR PLAN -ROOF -SEGMENT B		X
A02-RC	FLOOR PLAN -ROOF -SEGMENT C		X
A02-RD	FLOOR PLAN -ROOF -SEGMENT D		X
A02-RF	FLOOR PLAN -ROOF -SEGMENT F		X
A02-RH	FLOOR PLAN -ROOF -SEGMENT H		X
A02-RK	FLOOR PLAN -ROOF -SEGMENT K		X
A02-RM	FLOOR PLAN -ROOF -SEGMENT M		X
A02-RP	FLOOR PLAN -ROOF -SEGMENT P		X
A02-RR	FLOOR PLAN -ROOF -RESTROOM ACCESSORIES		X
A03-01	REFLECTED CEILING PLAN -LEVEL ONE -OVERALL		X
A03-01A	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT A		X
A03-01B	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT B		X
A03-01C	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT C		X
A03-01D	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT D		X
A03-01H	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT F		X
A03-01H	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT H		X
A03-01K	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT K		X
A03-01M	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT M		X
A03-01P	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT P		X
A03-01R	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT R		X
A03-01ST	REFLECTED CEILING PLAN -LEVEL ONE -SEGMENT S & T		X
A03-02	REFLECTED CEILING PLAN -LEVEL TWO -OVERALL		X
A03-02A	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT A		X
A03-02B	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT B		X
A03-02C	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT C		X
A03-02D	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT D		X
A03-02F	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT F		X
A03-02H	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT H		X
A03-02K	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT K		X
A03-02R	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT R		X
A03-02P	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT P		X
A03-02R	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT R		X
A03-02ST	REFLECTED CEILING PLAN -LEVEL TWO -SEGMENT S & T		X
A04-01	RESTROOM TYPES AND DETAILS -RESTROOMS		X
A04-03	ENLARGED PLANS AND DETAILS -RESTROOMS		X
A04-04	ENLARGED PLANS AND DETAILS -FITNESS CENTER		X
A04-05	ENLARGED PLANS AND DETAILS -FITNESS CENTER		X
A04-07	ENLARGED PLANS AND DETAILS -SECURITY OFFICE		X
A04-08	ENLARGED PLANS AND DETAILS -CONFERENCE/AND CAFE		X
A04-09	ENLARGED PLANS AND DETAILS -FACILITIES OFFICE		X
A04-09	ENLARGED PLANS AND DETAILS -FACILITIES OFFICE		X
A04-22	VERTICAL CIRCULATION -LOBBY STAIR		X
A04-23	VERTICAL CIRCULATION -STAIR 01		X
A04-24	VERTICAL CIRCULATION -STAIR 02		X
A04-25	VERTICAL CIRCULATION -STAIR 03		X
A04-26	VERTICAL CIRCULATION -STAIR 04		X
A04-27	VERTICAL CIRCULATION -STAIR 05		X
A04-28	VERTICAL CIRCULATION -STAIR 06		X
A04-29	VERTICAL CIRCULATION -STAIR 07		X
A04-30	VERTICAL CIRCULATION -STAIR 08		X
A04-32	VERTICAL CIRCULATION -STAIR 09		X
A04-36	VERTICAL CIRCULATION -STAIR 10		X
A04-37	VERTICAL CIRCULATION -STAIR 11		X
A05-01	OVERALL EXTERIOR ELEVATIONS		X
A05-02	EXTERIOR ELEVATIONS		X
A05-03	EXTERIOR ELEVATIONS		X
A06-01	BUILDING SECTIONS		X
A06-01	WALL SECTIONS		X
A06-49	SECTION DETAILS		X
A06-51	FREEDOM WALL -SECTION DETAILS		X
A06-81	ROOF DETAILS		X
A06-82	ROOF DETAILS		X
A06-83	ROOF DETAILS		X
A06-84	ROOF DETAILS		X
A07-04	INTERIOR ELEVATIONS -FREIGHT/ELEVATOR		X
A07-05	INTERIOR ELEVATIONS -PASSENGER/ELEVATOR		X
A08-00	DOOR SCHEDULE		X
A08-01	DOOR AND EQUIPMENT SCHEDULES		X
A08-03	DOOR DETAILS		X
A08-21	DOOR AND FRAME DETAILS		X
A09-00A	FINISH SCHEDULE, NOTES, AND LEGENDS		X
A09-00B	FINISH SCHEDULE, NOTES, AND LEGENDS		X
A09-01	FINISH FLOOR PLAN -LEVEL ONE -OVERALL		X
A09-01A	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT A		X
A09-01B	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT B		X
A09-01C	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT C		X
A09-01D	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT D		X
A09-01F	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT F		X
A09-01H	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT H		X
A09-01K	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT K		X
A09-01M	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT M		X
A09-01P	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT P		X
A09-01R	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT R		X
A09-01ST	FINISH FLOOR PLAN -LEVEL ONE -SEGMENT S & T		X
A09-02	FINISH FLOOR PLAN -LEVEL TWO -OVERALL		X
A09-02A	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT A		X
A09-02B	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT B		X
A09-02C	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT C		X
A09-02D	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT D		X
A09-02F	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT F		X
A09-02H	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT H		X
A09-02K	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT K		X
A09-02M	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT M		X
A09-02P	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT P		X
A09-02R	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT R		X
A09-02ST	FINISH FLOOR PLAN -LEVEL TWO -SEGMENT S & T		X
A11-01	INTERIOR SIGNAGE		X

PLUMBING		RSN 190324Z	
			05-30-2025 - FOUNDATIONS ONLY P/P
Sheet Number	Sheet Name		
12 - PLUMBING			
P00-00	SYMBOLS, ABBREVIATIONS, AND GENERAL NOTES		X
P00-00	PLUMBING FLOOR PLAN - LEVEL ONE UG - OVERALL		X
P02-00A	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT A		X
P02-00B	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT B		X
P02-00C	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT C		X
P02-00D	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT D		X
P02-00F	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT F		X
P02-00H	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT H		X
P02-00K	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT K		X
P02-00M	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT M		X
P02-00P	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT P		X
P02-00R	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENT R		X
P02-00ST	PLUMBING FLOOR PLAN - LEVEL ONE UG - SEGMENTS S & T		X

ELECTRICAL			05.31.2025 - FOUNDATIONS ONLY IFP
Sheet Number	Sheet Name		
15 - ELECTRICAL			
E00-01	SYMBOLS, ABBREVIATIONS, AND GENERAL NOTES		X
E01-01	POWER SITE PLAN		X
E03-11A	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT A		X
E03-11C	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT C		X
E03-11D	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT D		X
E03-11E	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT E		X
E03-11G	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT G		X
E03-11J	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT J		X
E03-11L	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT L		X
E03-11N	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT N		X
E03-11Q	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT Q		X
E03-11ST	ROUTING FLOOR PLAN - LEVEL ONE - SEGMENT S-T		X
E04-01	POWER ENLARGED PLAN - LEVEL ONE		X
E04-02	POWER ENLARGED PLAN - LEVEL ONE		X
E05-01	DETAILS		X
E06-01	SINGLE LINE DIAGRAM - MEDIUM VOLTAGE (SUBSTATION)		X
E06-02	SINGLE LINE DIAGRAM - MEDIUM VOLTAGE (DH1100/2100)		X
E06-03	SINGLE LINE DIAGRAM - MEDIUM VOLTAGE (DH 1200/2200)		X
E06-04	SINGLE LINE DIAGRAM - MEDIUM VOLTAGE (DH 1300)		X
E06-05	SINGLE LINE DIAGRAM - MEDIUM VOLTAGE (DH2300)		X

CORGAN ■

401 N. Houston Street Dallas, TX 75202
T: 214.748.2000

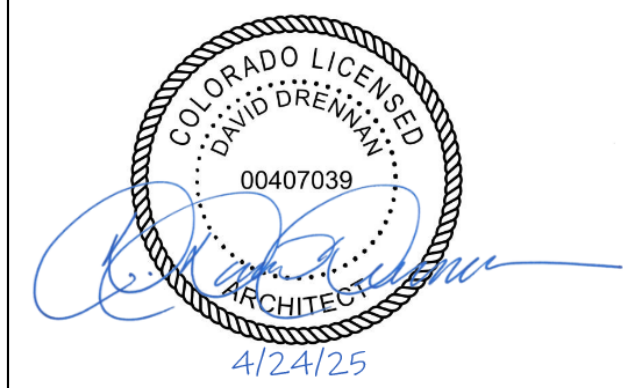[illegible]

Date of issue:
05.16.25

QTS
DEN1 DC2
1140 N. GUN CLUB ROAD

SHEET INDEX


JOB 24464.0000
DATE 05.16.25
SHEET

G00-04

THIS SHEET IS FOR
REFERENCE ONLY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION


1 LIFE SAFETY PLAN - LEVEL ONE - OVERALL
1" = 40'-0"

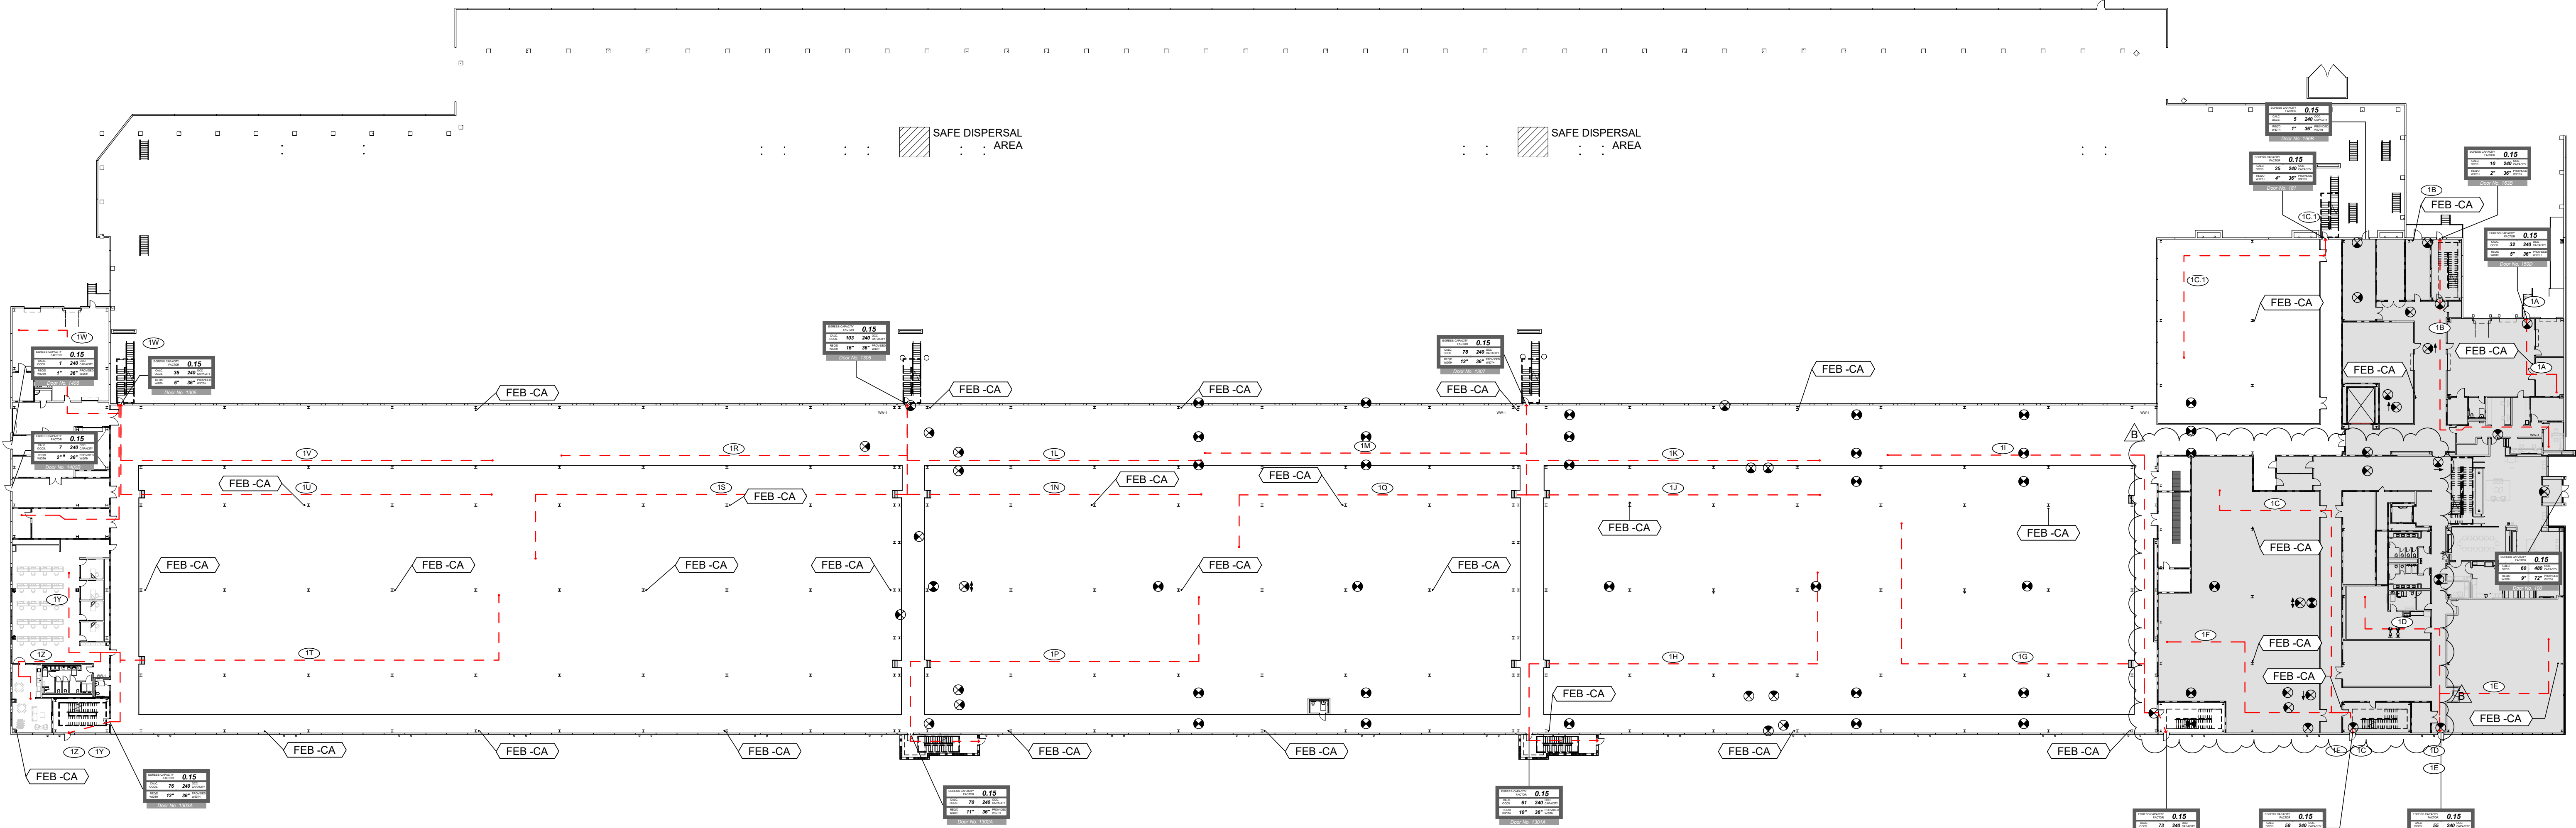


OCCUPANCY SCHEDULE BY ROOM - LEVEL 1						
Number	Name	Occ.	Function of Space	Occ. Load Factor Calc	Area	Total Occ. Calc
0100	LOBBY	B	BUSINESS AREA	150	1591 SF	11
0101	VEST	B	CIRCULATION	150	120 SF	1
0102	FREEDOM CAFE	B	BUSINESS AREA	150	1178 SF	8
0103	STORAGE	B	BUSINESS AREA	150	42 SF	1
0104	LARGE CONFERENCE	B	ASSEMBLY	150	498 SF	4
0105	BREAK	B	BUSINESS AREA	150	105 SF	1
0106	WELL	B	BUSINESS AREA	150	87 SF	1
0107	VEST	B	CIRCULATION	150	110 SF	1
0108	VEST	B	CIRCULATION	150	111 SF	1
0109	TENANT OFFICE	B	BUSINESS AREA	150	3872 SF	26
0111	ELEV ROOM	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	150	180 SF	2
0112	GRASS ELEV.	B	CIRCULATION	150	83 SF	1
0113	WRR	B	BUSINESS AREA	150	214 SF	2
0114	MRR	B	BUSINESS AREA	150	211 SF	2
0115	SHOWER	B	BUSINESS AREA	150	100 SF	1
0116	FITNESS CENTER	B	BUSINESS AREA	150	942 SF	7
0117	STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	986 SF	4
0118	STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	142 SF	1
0119	STAIR 02	B	CIRCULATION	150	509 SF	4
120	JAN	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	116 SF	1
0130	VEST	B	CIRCULATION	150	63 SF	1
0131	SEC. RECEPTION	B	BUSINESS AREA	150	127 SF	1
0132	SEC. MANAGER	B	BUSINESS AREA	150	140 SF	1
0133	SDF	B	BUSINESS AREA	150	126 SF	1
0134	SECURITY OFFICE	B	BUSINESS AREA	150	587 SF	4
0135	SEC. STORAGE	B	BUSINESS AREA	150	72 SF	1
0150	DOCK	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	1677 SF	6
0151	RR	B	BUSINESS AREA	150	93 SF	1
0152	QTS STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	406 SF	2
0153	TRASH	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	268 SF	1
0154	ELEV. ROOM	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	109 SF	1
0161	STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	1456 SF	5
0162	STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	52 SF	1
0163	STAIR 01	B	CIRCULATION	150	463 SF	4
0164	RISER	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	374 SF	2
0165	TENANT STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	424 SF	2
0166	ELEC ROOM	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	713 SF	3
0180	FLEX	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	7493 SF	25
0190	FLEX	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	9806 SF	33
0192	MDF	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	282 SF	1
0193	MMR	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	510 SF	2
0194	VAULT	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	234 SF	1
0195	STAIR 03	B	CIRCULATION	150	507 SF	4

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1						
Number	Name	Occ.	Function of Space	Occ. Load Factor Calc	Area	Total Occ. Calc
0196	STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	150	1043 SF	7
1000	DATA HALL	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	24161 SF	81
1010	PDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	5953 SF	20
1020	CRAH/CDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	5083 SF	17
1030	CRAH/CDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	5811 SF	20
1100	DATA HALL	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	24081 SF	81
1110	PDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	5956 SF	20
1120	CRAH/CDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	5083 SF	17
1130	CRAH/CDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	5811 SF	20
1200	DATA HALL	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	30965 SF	104
1210	PDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	7638 SF	26
1220	CRAH/CDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	6540 SF	22
1230	CRAH/CDU GALLERY	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	7469 SF	25
1301	STAIR 04	B	CIRCULATION	150	461 SF	4
1302	STAIR 05	B	CIRCULATION	150	458 SF	4
1303	STAIR 06	B	CIRCULATION	150	483 SF	4
1305	STAIR 08	B	CIRCULATION	150	224 SF	2
1306	STAIR 09	B	CIRCULATION	150	224 SF	2
1307	STAIR 10	B	CIRCULATION	150	224 SF	2
1200	UNISEX RR	B	BUSINESS AREA	150	61 SF	1
1201	FACILITIES OFFICE	B	BUSINESS AREA	150	1920 SF	13
1202	RR	B	BUSINESS AREA	150	185 SF	2
1203	BREAK ROOM	B	BUSINESS AREA	150	571 SF	4
1204	OFFICE	B	BUSINESS AREA	150	142 SF	1
1205	OFFICE	B	BUSINESS AREA	150	142 SF	1
1206	OFFICE	B	BUSINESS AREA	150	142 SF	1
1207	OFFICE	B	BUSINESS AREA	150	142 SF	1
1400	MMR	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	557 SF	2
1401	EF	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	134 SF	1
1402	HOUSE ELEC.	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	695 SF	3
1403	ELI	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	289 SF	1
1405	IDF	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	154 SF	1
1406	FIRE	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	131 SF	1
1407	STORAGE	B	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	47 SF	1
1408	LOADING DOCK	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	1928 SF	7
1409	RR	B	BUSINESS AREA	150	63 SF	1
1410	ELEV. MECH. ROOM	S-2	ACCESSORY STORAGE AREAS, MECH. EQUIP. ROOM	300	154 SF	1
Grand Total					182104	704

2 OCCUPANCY CLASSIFICATION FLOOR PLAN - LEVEL 1
1" = 100'-0"

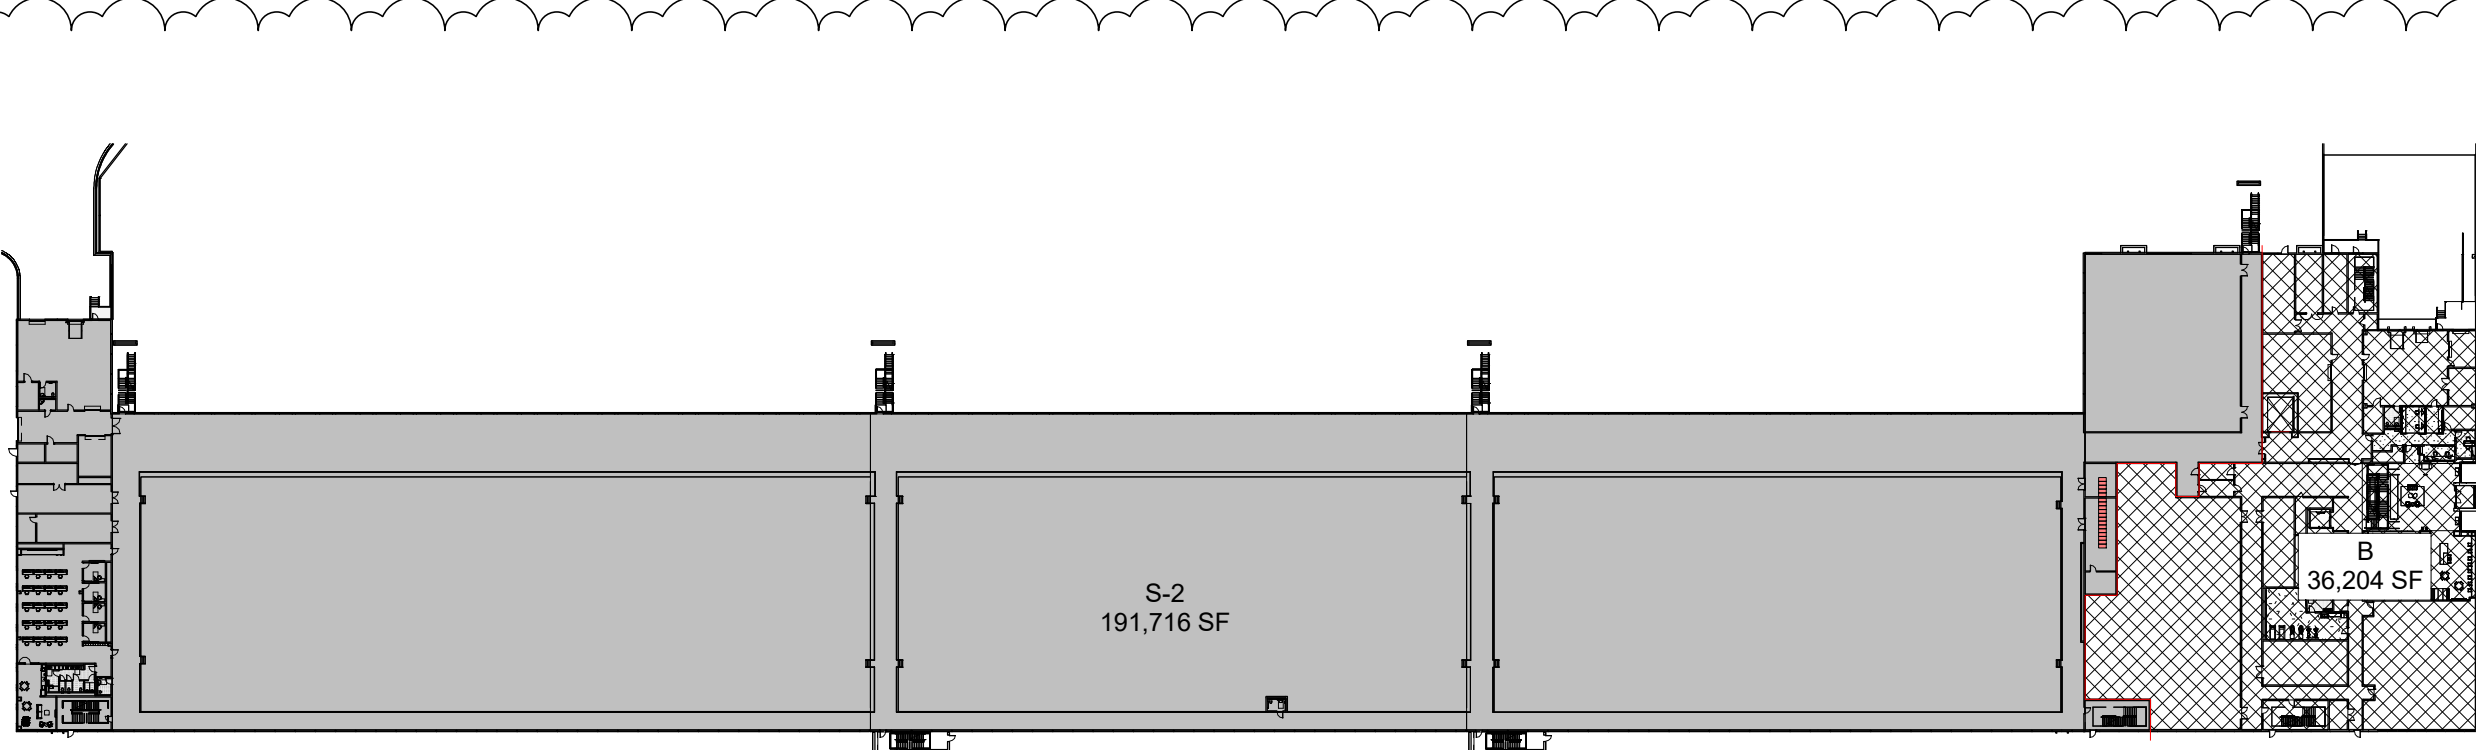

*OWNER TO PROVIDE WELLNESS WALL ITEMS

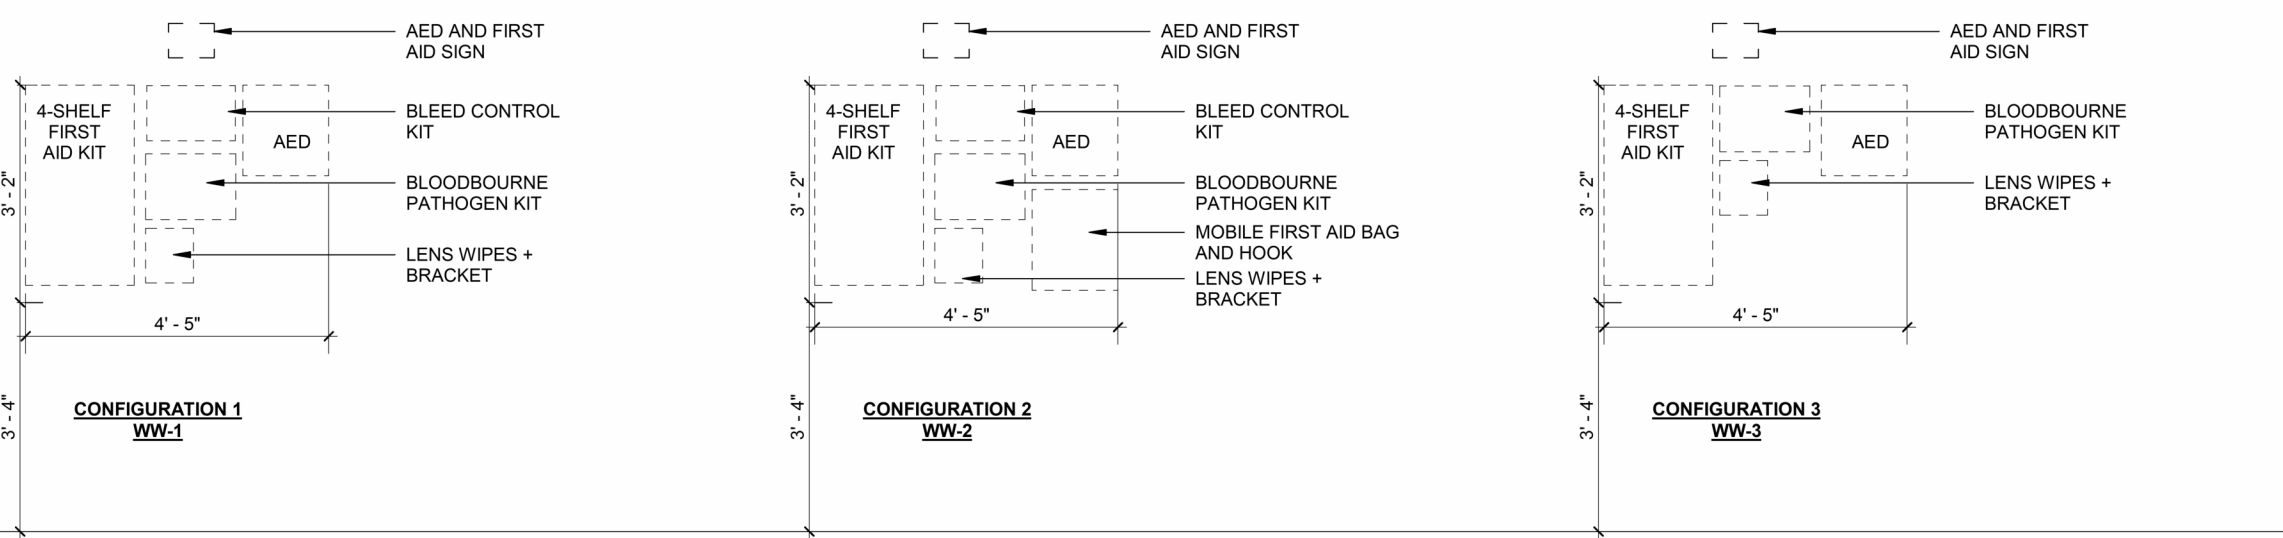

LIFE SAFETY LEGEND

- OCCUPANCY BOUNDARY
- EXIT TRAVEL DISTANCE
- TRAVEL PATH ID
- EMERGENCY EXIT

TRAVEL DISTANCES

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	234' - 7"
1H	261' - 10"
1I	258' - 2"
1J	192' - 8"
1K	175' - 2"
1L	185' - 8"
1N	192' - 7"
1P	251' - 8"
1Q	215' - 8"
1R	199' - 1"
1S	298' - 10"
1T	253' - 7"
1U	231' - 2"
1V	214' - 7"
1W	92' - 0"
1X	107' - 1"
1Y	100' - 5"
1Z	114' - 8"

CORGAN

401 N. Houston Street Dallas, TX 75202
T: 214.748.2000

AG/E

SYSKA HENNESSY GROUP


TEC DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFP
4		
5		
6		
7		
8		
9		
10		

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS

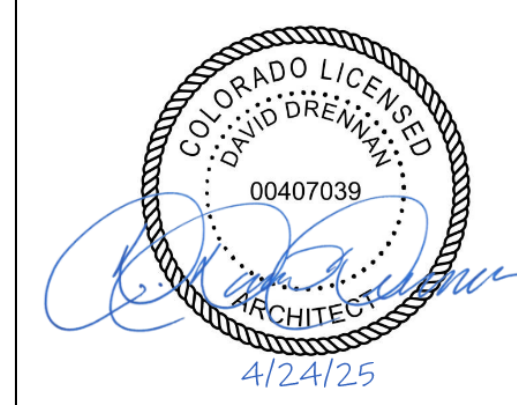

Date of issue:
04.24.25

THIS SHEET IS FOR
REFERENCE ONLY

PARTITION RATING LEGEND

- UNRATED PARTITION ASSEMBLY
- 1 HOUR RATED PARTITION ASSEMBLY
- 2 HOUR RATED PARTITION ASSEMBLY
- 3 HOUR RATED PARTITION ASSEMBLY
- 1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER LEGEND

- FEB-X: FIRE EXTINGUISHER BRACKET
- FECR-X: FIRE EXTINGUISHER CABINET - RECESSED
- FECX-X: FIRE EXTINGUISHER CABINET - SEMI RECESSED
- FECW-X: FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
- FEH-X: FIRE EXTINGUISHER HOOK

AGENT TYPE 'X':
CA: CLEAN AGENT

- B OCCUPANCY
- S-2 OCCUPANCY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

KEYPLAN



LIFE SAFETY PLAN
- LEVEL ONE -
OVERALL

JOB 24464.0000
DATE 04.24.25
SHEET

G01-01

PARTITION RATING LEGEND

	UNRATED PARTITION ASSEMBLY
	1 HOUR RATED PARTITION ASSEMBLY
	2 HOUR RATED PARTITION ASSEMBLY
	3 HOUR RATED PARTITION ASSEMBLY
	1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER MOUNTING LEGEND

INTENT IS ALIGNMENT IN VISUAL FIELD				
ACCESSORY NAME	HOOKS	NOTE FROM BOTTOM OF HOOK	BRACKETS	NOTE FROM CENTER LINE OF BRACKET
		FIRE EXTINGUISHER HOOK		FIRE EXTINGUISHER BRACKET
				FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
				FIRE EXTINGUISHER CABINET - SEMI RECESSED
				FIRE EXTINGUISHER CABINET - RECESSED
				FIRE EXTINGUISHER CABINET - EXTERIOR

LIFE SAFETY LEGEND

	OCCUPANCY BOUNDARY
	EXIT TRAVEL DISTANCE
	TRAVEL PATH ID
	EMERGENCY EXIT

TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	234' - 7"
1H	261' - 10"
1I	258' - 2"
1J	192' - 8"
1K	175' - 2"
1L	175' - 5"
1M	185' - 8"
1N	192' - 7"
1P	251' - 8"
1Q	215' - 8"
1R	199' - 1"
1S	296' - 10"
1T	253' - 7"
1U	231' - 2"
1W	92' - 0"
1X	107' - 1"
1Y	100' - 5"
1Z	114' - 8"


OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Load Factor	Total Occ.
			Calc	Calc
LEVEL 1				
0100	VEST	120 SF	150	1
0101	LOBBY	1666 SF	150	12
0102	FREEDOM CAFE	1233 SF	150	9
0104	LARGE CONFERENCE	498 SF	150	4
0105	BREAK VEST.	114 SF	150	1
0106	WELL	83 SF	150	1
0107	VEST	154 SF	150	2
0108	VEST	155 SF	150	2
0109	TENANT OFFICE	3841 SF	150	26
0110	CORRIDOR	3992 SF	300	14
0111	STORAGE	182 SF	150	2
0112	PASS ELEV.	98 SF	150	1
0113	WRR	212 SF	150	2
0114	MRR	212 SF	150	2
0115	SHOWER	122 SF	150	1
0116	FITNESS CENTER	857 SF	150	6
0117	STORAGE	1005 SF	300	4
0118	ELEC ROOM	145 SF	300	1
0119	STAIR 02	523 SF	150	4
120	JAN	68 SF	300	1
0130	VEST	67 SF	150	1
0131	SEC. RECEPTION	129 SF	150	1
0132	SEC. MANAGER	144 SF	150	1
0133	SDF	195 SF	150	2
0134	SECURITY OFFICE	382 SF	150	4
0135	ARMORY	108 SF	150	1
0136	CORRIDOR	1951 SF	300	7
0150	DOCK	1894 SF	300	6
0151	RR	86 SF	150	1
0152	DOCK STORAGE	86 SF	300	1
0153	TRASH	268 SF	300	1
0154	ELEV MACH	138 SF	300	1
0160	FREIGHT ELEV.	240 SF	300	1
0161	STORAGE	1430 SF	300	5
0162	STORAGE	53 SF	300	1
0163	STAIR 01	463 SF	150	4
0164	RISER	374 SF	300	2
0165	ELI	424 SF	300	2
0166	ELEC ROOM	677 SF	300	3
0180	FLEX	7493 SF	300	25
0181	STAIR 11	224 SF	150	2
0190	FLEX	8937 SF	300	30
0191	CORRIDOR	2586 SF	300	9
0192	DCIM	280 SF	300	1
0193	MMRIA	600 SF	300	3
0194	EF	183 SF	300	1
0195	STAIR 03	509 SF	150	4
0196	STORAGE	757 SF	300	3
1000	DATA HALL	42062 SF	300	141
1100	DATA HALL	41861 SF	300	140
1133	RR	53 SF	300	1
1200	DATA HALL	46596 SF	300	156
1300	CORRIDOR	10801 SF	300	37
1300	CORRIDOR	9109 SF	300	31
1300	CORRIDOR	18343 SF	300	62
1300	CORRIDOR	721 SF	300	3
1301	STAIR 04	461 SF	150	4
1302	STAIR 05	458 SF	150	4
1303	STAIR 06	488 SF	150	4
1305	STAIR 08	224 SF	150	2
1306	STAIR 09	224 SF	150	2
1307	STAIR 10	224 SF	150	2
1400	MMR1B	575 SF	300	2
1401	EF	138 SF	300	1
1402	HOUSE ELEC.	719 SF	300	3
1403	ELI	324 SF	300	2
1404	FREIGHT ELEV.	362 SF	300	2
1405	IDF	153 SF	300	1
1406	FIRE	134 SF	300	1
1407	JAN.	47 SF	300	1
1408	LOADING DOCK	1956 SF	300	7
1409	RR	63 SF	150	1
1410	ELEV. MACH	154 SF	300	1
1500	FACILITIES OFFICE	2348 SF	150	16
1501	RR	63 SF	150	1
1502	RR	131 SF	150	1
1503	BREAK ROOM	580 SF	150	4
1504	OFFICE	113 SF	150	1
1505	OFFICE	113 SF	150	1
1506	OFFICE	113 SF	150	1
1507	OFFICE	115 SF	150	1
LEVEL 1: 81		225987 SF		854
Grand total: 81		225987 SF		854

FIRE EXTINGUISHER LEGEND

	MOUNTING TYPE	AGENT TYPE
	FIRE EXTINGUISHER BRACKET	
	FIRE EXTINGUISHER CABINET - RECESSED	
	FIRE EXTINGUISHER CABINET - SEMI RECESSED	
	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED	
	FIRE EXTINGUISHER HOOK	

AGENT TYPE "X":
CA: CLEAN AGENT

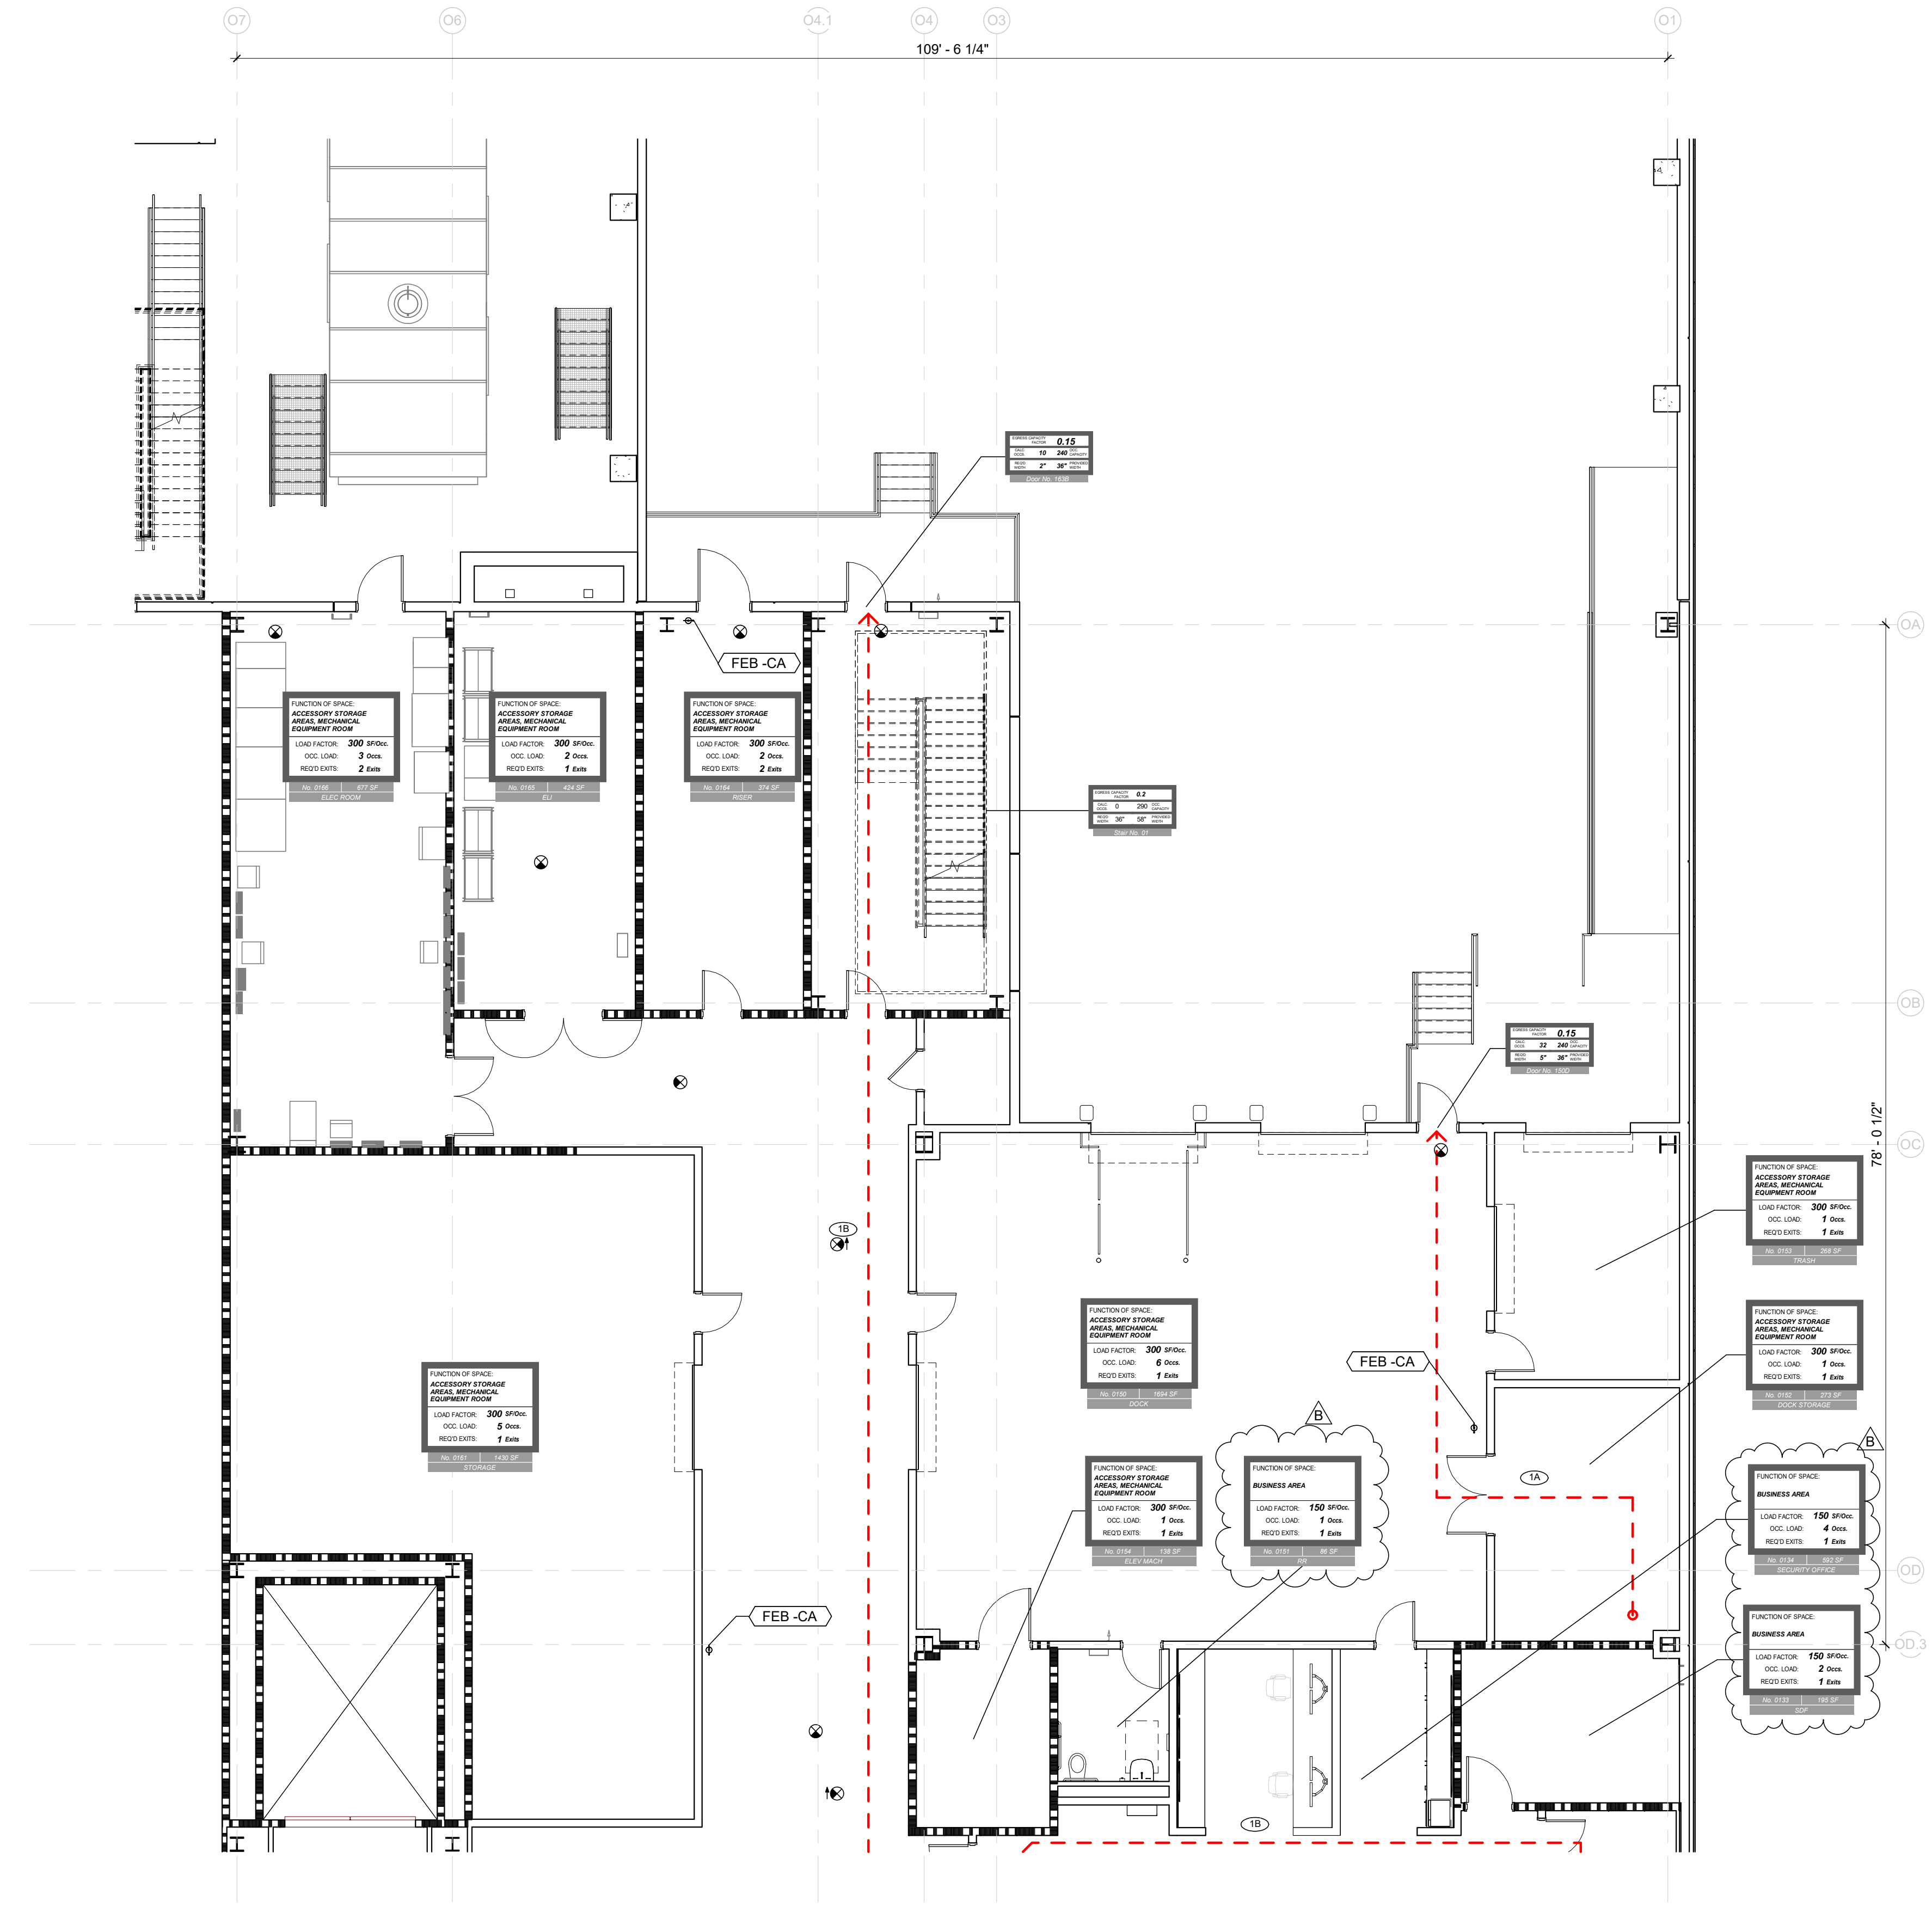

THIS SHEET IS FOR
REFERENCE ONLY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

1 LIFE SAFETY PLAN - LEVEL ONE - SEGMENT A
1/8" = 1'-0"

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP

TD
DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT A

JOB 24464.0000
DATE 04.24.25
SHEET

G01-01A

PARTITION RATING LEGEND

	UNRATED PARTITION ASSEMBLY
	1 HOUR RATED PARTITION ASSEMBLY
	2 HOUR RATED PARTITION ASSEMBLY
	3 HOUR RATED PARTITION ASSEMBLY
	1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER MOUNTING LEGEND

INTENT IS ALIGNMENT IN VISUAL FIELD						
ACCESSORY NAME	HOOKS	NOTE FROM BOTTOM OF HOOK	BRACKETS	NOTE FROM CENTER LINE OF BRACKET	CABINET	NOTE FROM CENTER LINE OF HANDLE
		FIRE EXTINGUISHER-HOOK		FIRE EXTINGUISHER BRACKET		FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
						FIRE EXTINGUISHER CABINET - SEMI RECESSED
						FIRE EXTINGUISHER CABINET - RECESSED
						FIRE EXTINGUISHER CABINET - EXTERIOR

LIFE SAFETY LEGEND

	OCCUPANCY BOUNDARY
	EXIT TRAVEL DISTANCE
	TRAVEL PATH ID
	EMERGENCY EXIT

TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	234' - 7"
1H	261' - 10"
1I	258' - 2"
1J	192' - 8"
1K	175' - 2"
1L	175' - 5"
1M	185' - 8"
1N	192' - 7"
1P	251' - 8"
1Q	215' - 8"
1R	195' - 1"
1S	295' - 10"
1T	253' - 7"
1U	231' - 2"
1W	92' - 0"
1X	107' - 1"
1Y	100' - 5"
1Z	114' - 8"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 1				
0100	VEST	120 SF	150	1
0101	LOBBY	1666 SF	150	12
0102	FREEDOM CAFE	1233 SF	150	9
0104	LARGE CONFERENCE	498 SF	150	4
0105	BREAK VEST.	114 SF	150	1
0106	WELL	83 SF	150	1
0107	VEST	154 SF	150	2
0108	VEST	155 SF	150	2
0109	TENANT OFFICE	3841 SF	150	26
0110	CORRIDOR	3992 SF	300	14
0111	STORAGE	182 SF	150	2
0112	PASS ELEV.	98 SF	150	1
0113	WRR	212 SF	150	2
0114	MRR	212 SF	150	2
0115	SHOWER	122 SF	150	1
0116	FITNESS CENTER	857 SF	150	6
0117	STORAGE	1005 SF	300	4
0118	ELEC ROOM	145 SF	300	1
0119	STAIR 02	523 SF	150	4
120	JAN	68 SF	300	1
0130	VEST	67 SF	150	1
0131	SEC. RECEPTION	129 SF	150	1
0132	SEC. MANAGER	144 SF	150	1
0133	SDF	195 SF	150	2
0134	SECURITY OFFICE	382 SF	150	4
0135	ARMORY	105 SF	150	1
0136	CORRIDOR	1951 SF	300	7
0150	DOCK	1894 SF	300	6
0151	RR	86 SF	150	1
0152	DOCK STORAGE	273 SF	300	1
0153	TRASH	289 SF	300	1
0154	ELEV MACH	138 SF	300	1
0160	FREIGHT ELEV.	240 SF	300	1
0161	STORAGE	1430 SF	300	5
0162	STORAGE	53 SF	300	1
0163	STAIR 01	463 SF	150	4
0164	RISER	374 SF	300	2
0165	ELI	424 SF	300	2
0166	ELEC ROOM	677 SF	300	3
0180	FLEX	7493 SF	300	25
0181	STAIR 11	224 SF	150	2
0190	FLEX	8937 SF	300	30
0191	CORRIDOR	2586 SF	300	9
0192	DCIM	280 SF	300	1
0193	MMR1A	600 SF	300	3
0194	EF	183 SF	300	1
0195	STAIR 03	509 SF	150	4
0196	STORAGE	757 SF	300	3
1000	DATA HALL	42062 SF	300	141
1100	DATA HALL	41861 SF	300	140
1133	RR	53 SF	300	1
1200	DATA HALL	46596 SF	300	156
1300	CORRIDOR	10801 SF	300	37
1300	CORRIDOR	9109 SF	300	31
1300	CORRIDOR	18343 SF	300	62
1300	CORRIDOR	721 SF	300	3
1301	STAIR 04	461 SF	150	4
1302	STAIR 05	458 SF	150	4
1303	STAIR 06	488 SF	150	4
1305	STAIR 08	224 SF	150	2
1306	STAIR 09	224 SF	150	2
1307	STAIR 10	224 SF	150	2
1400	MMR1B	575 SF	300	2
1401	EF	138 SF	300	1
1402	HOUSE ELEC.	719 SF	300	3
1403	ELI	324 SF	300	2
1404	FREIGHT ELEV.	362 SF	300	2
1405	IDF	153 SF	300	1
1406	FIRE	134 SF	300	1
1407	JAN.	47 SF	300	1
1408	LOADING DOCK	1956 SF	300	7
1409	RR	63 SF	150	1
1410	ELEV MACH	154 SF	300	1
1500	FACILITIES OFFICE	2348 SF	150	16
1501	RR	63 SF	150	1
1502	RR	131 SF	150	1
1503	BREAK ROOM	580 SF	150	4
1504	OFFICE	113 SF	150	1
1505	OFFICE	113 SF	150	1
1506	OFFICE	113 SF	150	1
1507	OFFICE	115 SF	150	1
LEVEL 1: 81		225987 SF		854
Grand total: 81		225987 SF		854

FIRE EXTINGUISHER LEGEND

	AGENT TYPE
	MOUNTING TYPE
	FIRE EXTINGUISHER BRACKET
	FIRE EXTINGUISHER CABINET - RECESSED
	FIRE EXTINGUISHER CABINET - SEMI RECESSED
	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
	FIRE EXTINGUISHER HOOK

AGENT TYPE 'X':
CA: CLEAN AGENT

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP

TD
DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFP

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT B

JOB 24464.0000
DATE 04.24.25
SHEET

G01-01B


THIS SHEET IS FOR
REFERENCE ONLY

1 LIFE SAFETY PLAN - LEVEL ONE - SEGMENT B
1/8" = 1'-0"


FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION


PARTITION RATING LEGEND

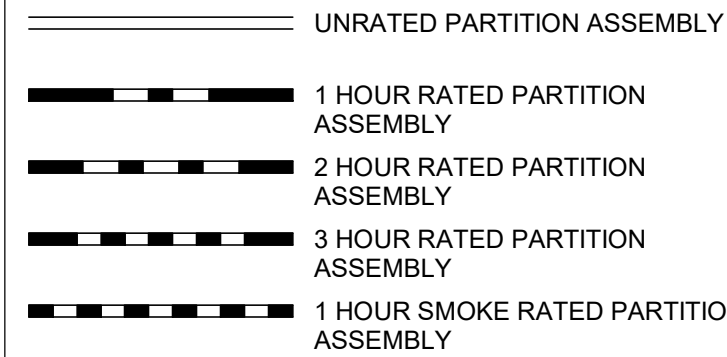

FIRE EXTINGUISHER MOUNTING LEGEND

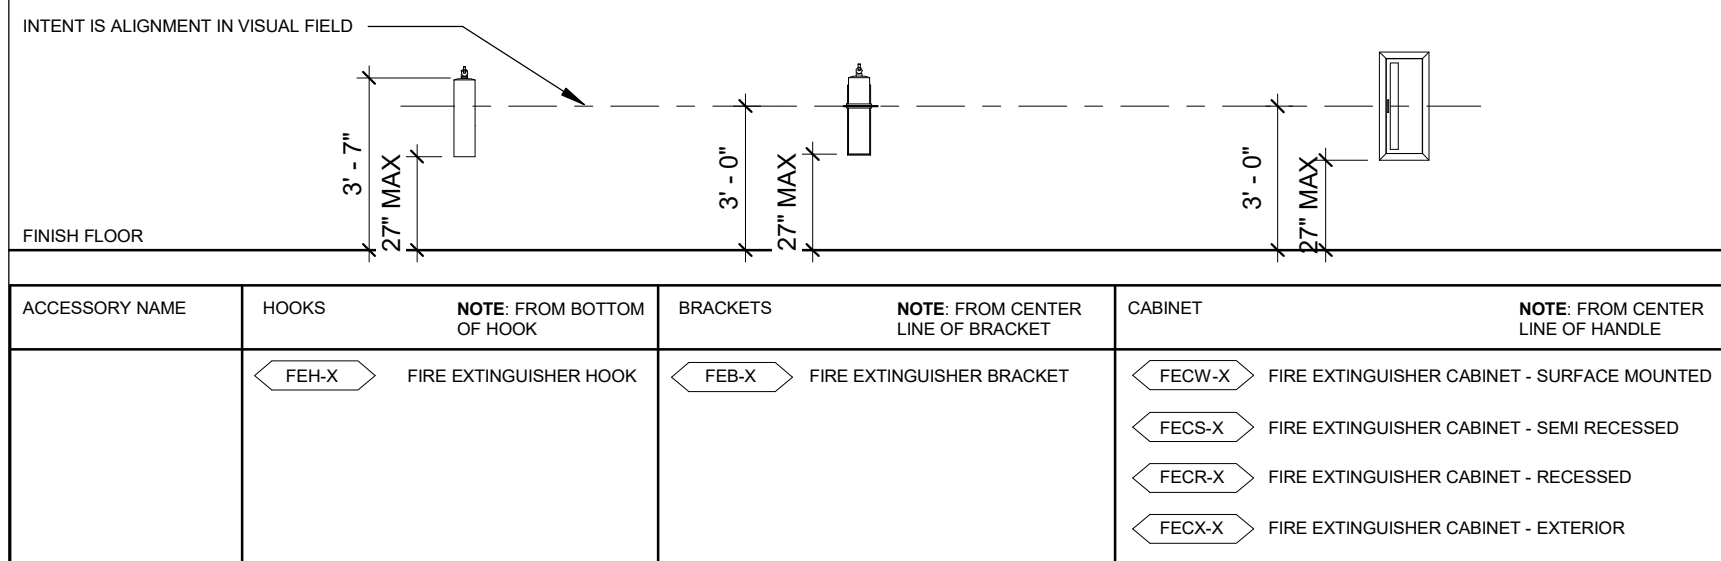

LIFE SAFETY LEGEND

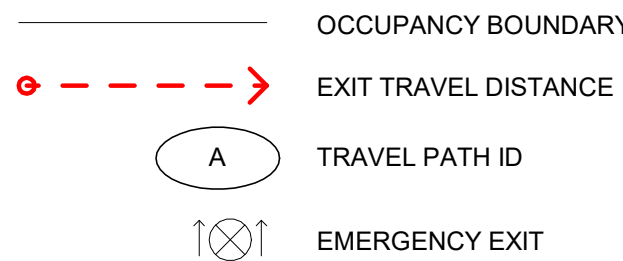


TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	234' - 7"
1H	261' - 10"
1I	258' - 2"
1J	192' - 8"
1K	175' - 2"
1L	185' - 8"
1M	192' - 7"
1N	192' - 7"
1P	251' - 8"
1Q	215' - 8"
1R	199' - 1"
1S	299' - 10"
1T	253' - 7"
1U	231' - 2"
1W	92' - 0"
1X	107' - 1"
1Y	100' - 5"
1Z	114' - 8"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 1				
0100	VEST	120 SF	150	1
0101	LOBBY	1666 SF	150	12
0102	FREEDOM CAFE	1233 SF	150	9
0104	LARGE CONFERENCE	498 SF	150	4
0105	BREAK VEST.	114 SF	150	1
0106	WELL	83 SF	150	1
0107	VEST	154 SF	150	2
0108	VEST	155 SF	150	2
0109	TENANT OFFICE	3841 SF	150	26
0110	CORRIDOR	3992 SF	300	14
0111	STORAGE	182 SF	150	2
0112	PASS ELEV.	98 SF	150	1
0113	WRR	212 SF	150	2
0114	MRR	212 SF	150	2
0115	SHOWER	122 SF	150	1
0116	FITNESS CENTER	857 SF	150	6
0117	STORAGE	1005 SF	300	4
0118	ELEC ROOM	145 SF	300	1
0119	STAIR 02	523 SF	150	4
120	JAN	68 SF	300	1
0130	VEST	67 SF	150	1
0131	SEC. RECEPTION	129 SF	150	1
0132	SEC. MANAGER	144 SF	150	1
0133	SDF	195 SF	150	2
0134	SECURITY OFFICE	582 SF	150	4
0135	ARMORY	105 SF	150	1
0136	CORRIDOR	1951 SF	300	7
0150	DOCK	1894 SF	300	6
0151	RR	86 SF	150	1
0152	DOCK STORAGE	273 SF	300	1
0153	TRASH	268 SF	300	1
0154	ELEV MACH	138 SF	300	1
0160	FREIGHT ELEV.	240 SF	300	1
0161	STORAGE	1430 SF	300	5
0162	STORAGE	53 SF	300	1
0163	STAIR 01	463 SF	150	4
0164	RISER	374 SF	300	2
0165	ELI	424 SF	300	2
0166	ELEC ROOM	677 SF	300	3
0180	FLEX	7493 SF	300	25
0181	STAIR 11	224 SF	150	2
0190	FLEX	8937 SF	300	30
0191	CORRIDOR	2586 SF	300	9
0192	DCIM	280 SF	300	1
0193	MMR1A	609 SF	300	3
0194	EF	183 SF	300	1
0195	STAIR 03	509 SF	150	4
0196	STORAGE	757 SF	300	3
1000	DATA HALL	42062 SF	300	141
1100	DATA HALL	41861 SF	300	140
1133	RR	53 SF	300	1
1200	DATA HALL	46596 SF	300	156
1300	CORRIDOR	10801 SF	300	37
1300	CORRIDOR	9109 SF	300	31
1300	CORRIDOR	18343 SF	300	62
1300	CORRIDOR	721 SF	300	3
1301	STAIR 04	461 SF	150	4
1302	STAIR 05	458 SF	150	4
1303	STAIR 06	488 SF	150	4
1305	STAIR 08	224 SF	150	2
1306	STAIR 09	224 SF	150	2
1307	STAIR 10	224 SF	150	2
1400	MMR1B	575 SF	300	2
1401	EF	138 SF	300	1
1402	HOUSE ELEC.	719 SF	300	3
1403	ELI	324 SF	300	2
1404	FREIGHT ELEV.	362 SF	300	2
1405	IDF	153 SF	300	1
1406	FIRE	134 SF	300	1
1407	JAN.	47 SF	300	1
1408	LOADING DOCK	1956 SF	300	7
1409	RR	63 SF	150	1
1410	ELEV MACH	154 SF	300	1
1500	FACILITIES OFFICE	2348 SF	150	16
1501	RR	63 SF	150	1
1502	RR	131 SF	150	1
1503	BREAK ROOM	580 SF	150	4
1504	OFFICE	113 SF	150	1
1505	OFFICE	113 SF	150	1
1506	OFFICE	113 SF	150	1
1507	OFFICE	115 SF	150	1
LEVEL 1: 81		225987 SF		854
Grand total: 81		225987 SF		854

FIRE EXTINGUISHER LEGEND

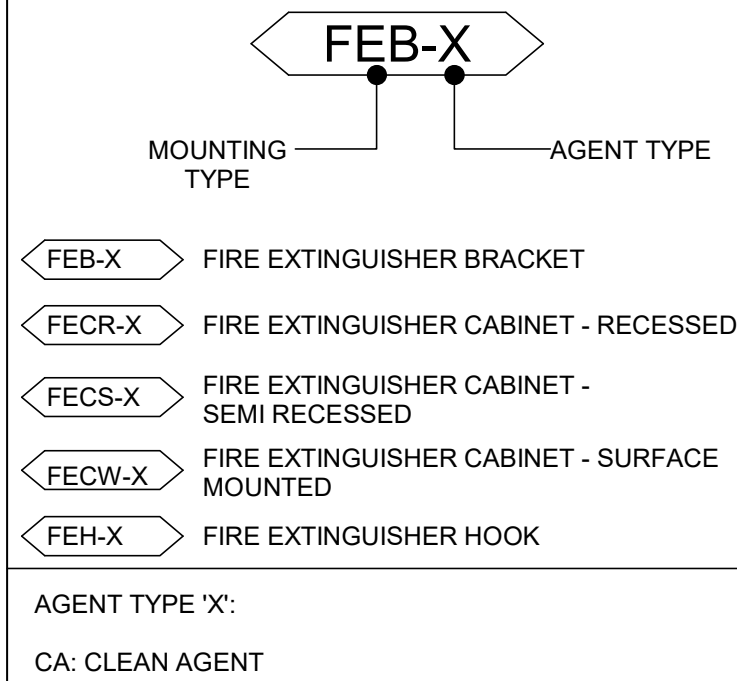

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

KYSSA HENNESSY
GROUP

TEC
DESIGN CONSULTING LLC

ISSUES


1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

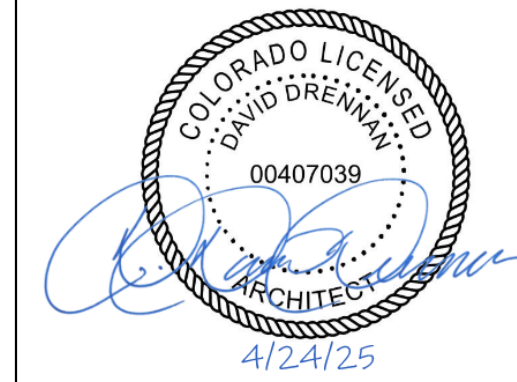

Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT D


JOB 24464.0000
DATE 04.24.25
SHEET

G01-01D


THIS SHEET IS FOR
REFERENCE ONLY

1 LIFE SAFETY PLAN - LEVEL ONE - SEGMENT D
1/8" = 1'-0"


PARTITION RATING LEGEND

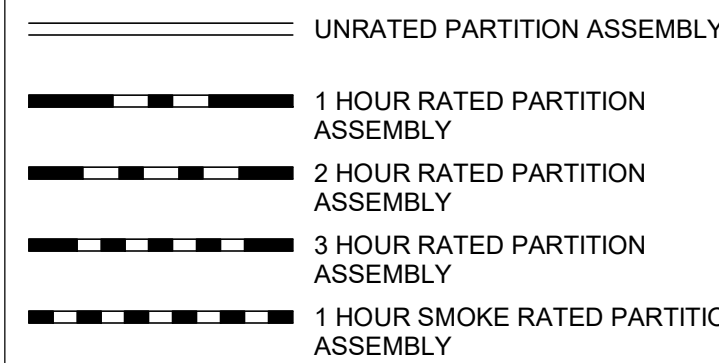

FIRE EXTINGUISHER MOUNTING LEGEND

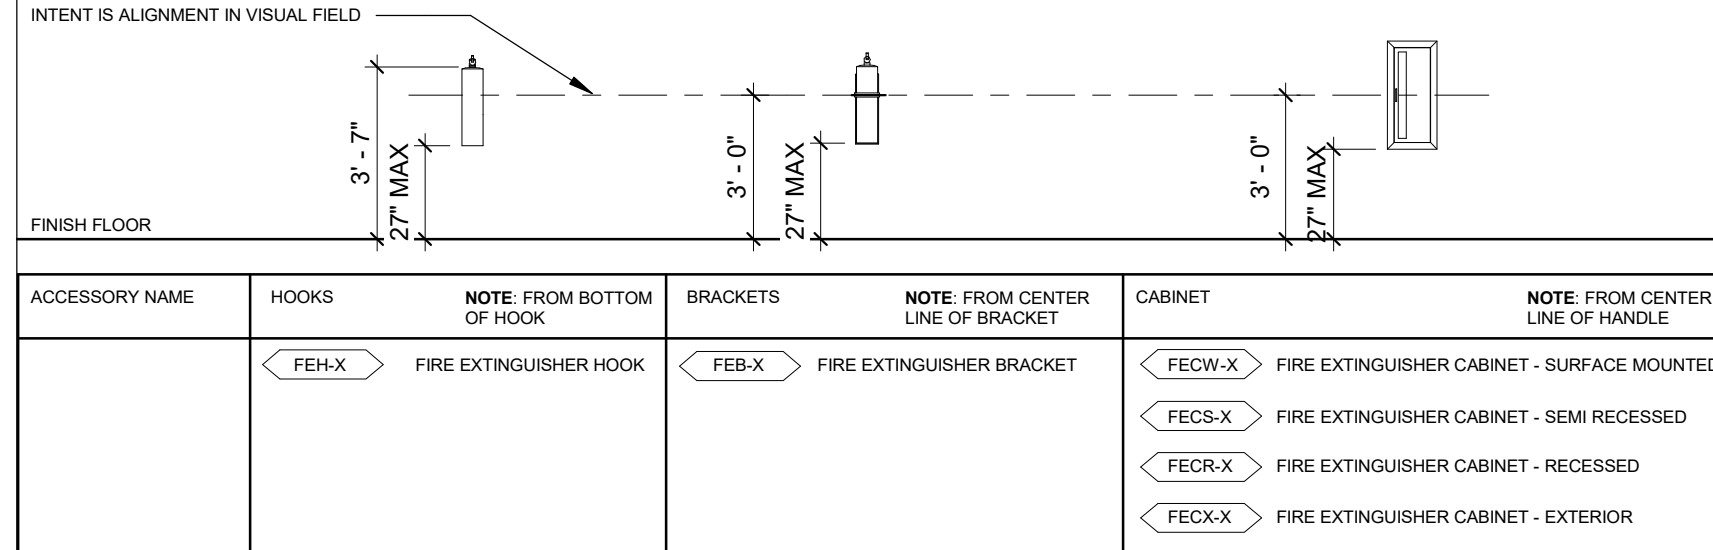

LIFE SAFETY LEGEND

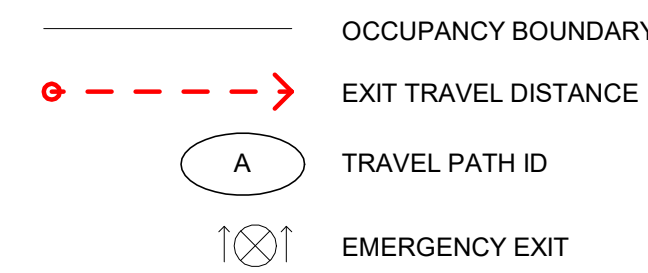

TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	109' - 10"
1F	124' - 0"
2A2	242' - 1"
2B	242' - 11"
1J	260' - 4"
1JH	192' - 4"
1K	175' - 2"
1L	175' - 5"
1M	187' - 8"
1N	192' - 8"
1P	243' - 5"
1Q	218' - 2"
1R	200' - 0"
1S	302' - 8"
1T	245' - 0"
1U	231' - 0"
1W	98' - 3"
1X	106' - 6"
1Y	102' - 9"
1Z	93' - 9"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

			Occ. Load Factor	Total Occ.
Number	Name	Area	Calc	Calc
LEVEL 1				
0100	VEST	120 SF	100	2
0101	LOBBY	1678 SF	100	17
0102	FREEDOM CAFE	1192 SF	100	12
0104	LARGE CONFERENCE	498 SF	100	5
0105	BREAK	116 SF	100	2
0106	WELL	83 SF	100	1
0107	VEST	105 SF	100	2
0108	VEST	105 SF	100	2
0109	TENANT OFFICE	3841 SF	100	38
0110	CORRIDOR	1743 SF	300	6
0111	ELEVATOR	174.5 SF	300	2

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000



SYSKA HENNESSY
GROUP




DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

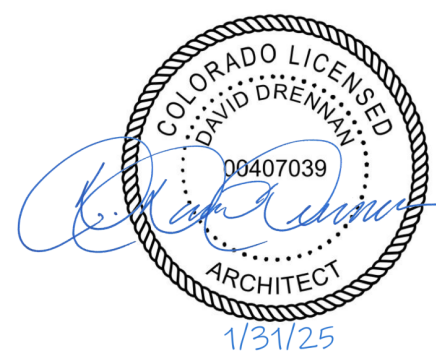

QTS DEN1 DC2

1140 N. GUN CLUB ROAD




KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B


LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT F

JOB 24464.0000
DATE 01.31.25
SHEET

G01-01F

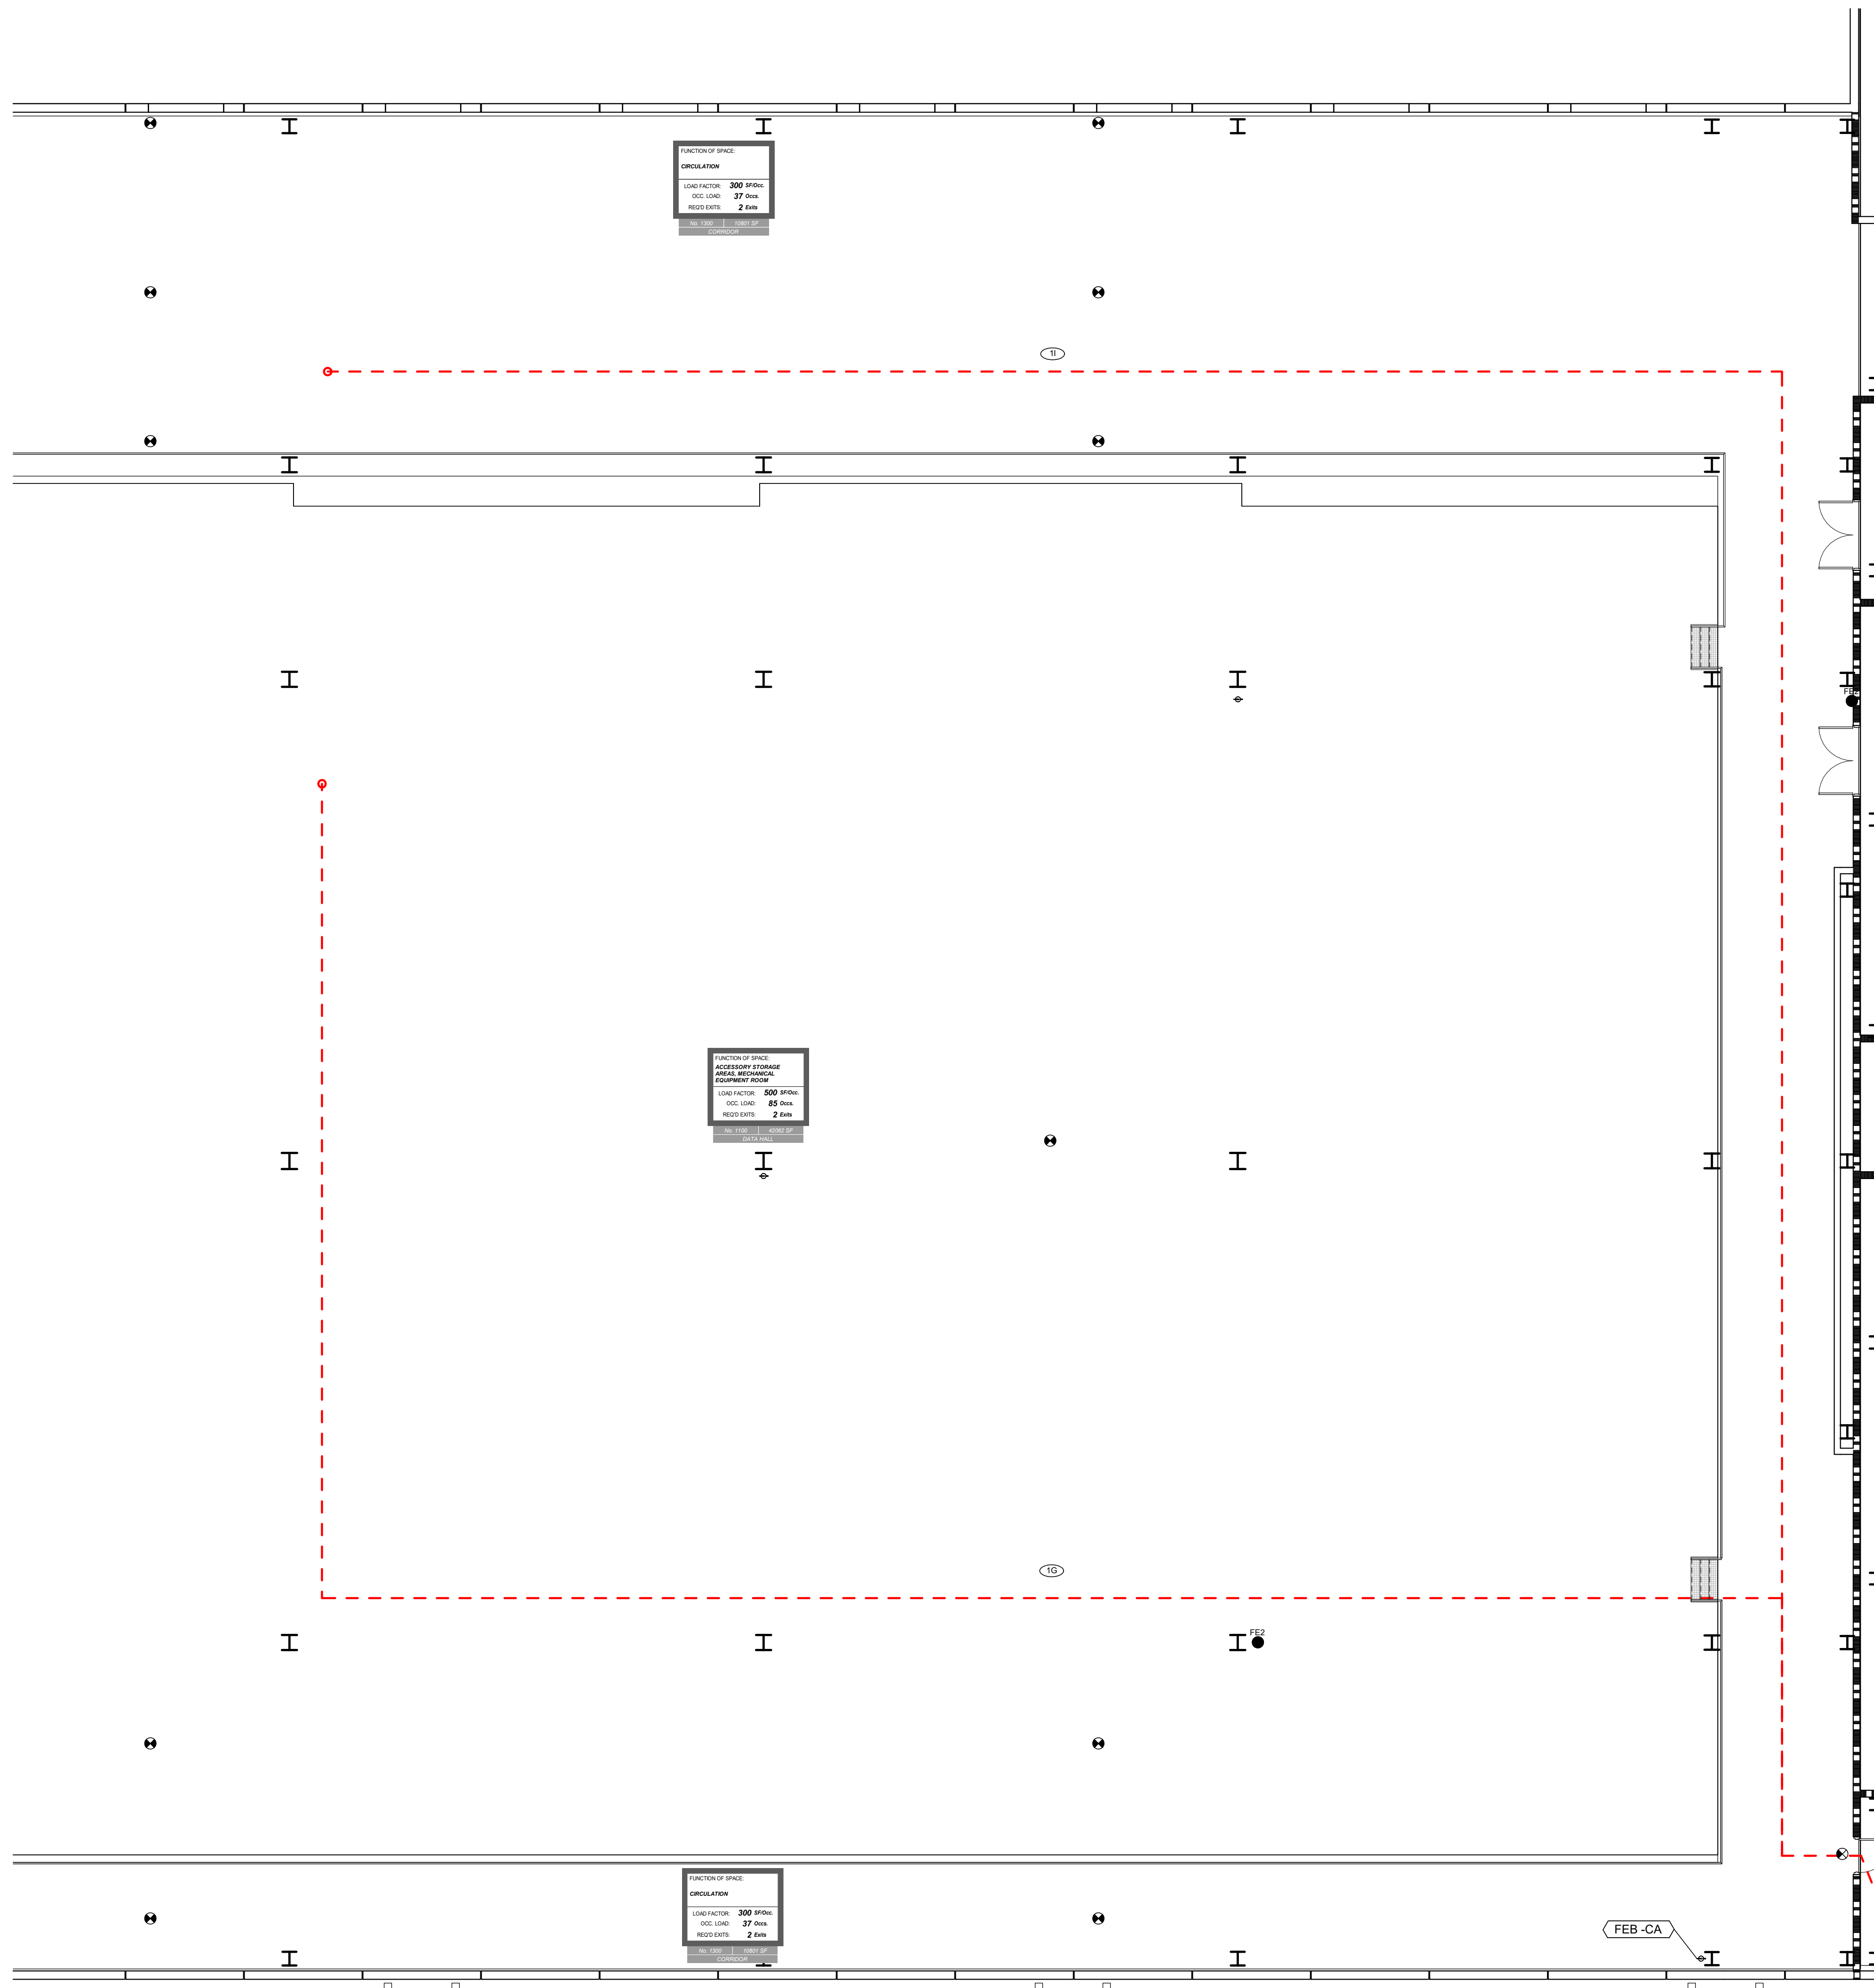

FIRE EXTINGUISHER LEGEND

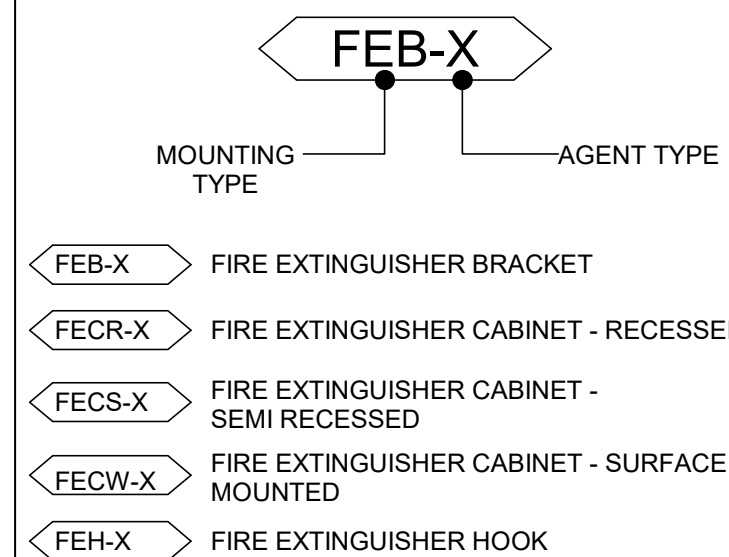

AGENT TYPE 'X':
CA: CLEAN AGENT

1 LIFE SAFETY PLAN - LEVEL ONE - SEGMENT F
1/8" = 1'-0"

THIS SHEET IS FOR
REFERENCE ONLY

03242 PARTITION RATING LEGEND

UNRATED PARTITION ASSEMBLY


1 HOUR RATED PARTITION ASSEMBLY

2 HOUR RATED PARTITION ASSEMBLY


3 HOUR RATED PARTITION ASSEMBLY

1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER MOUNTING LEGEND

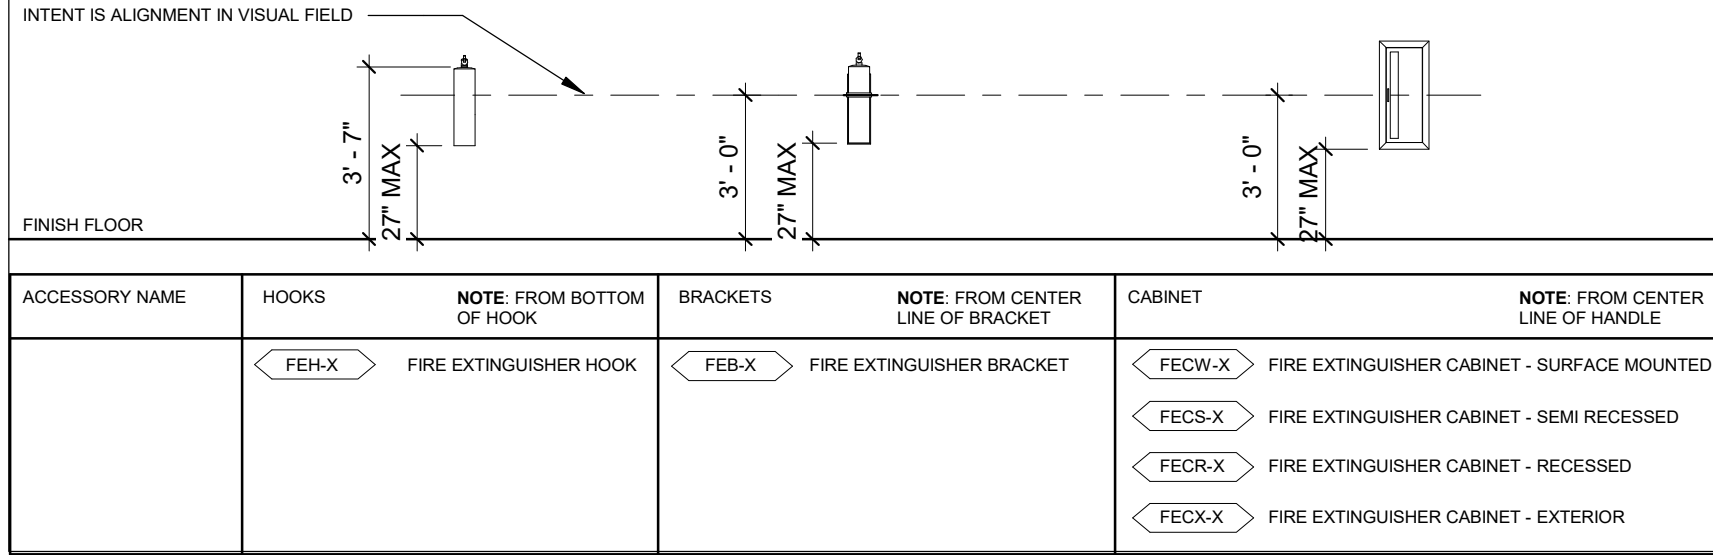

LIFE SAFETY LEGEND

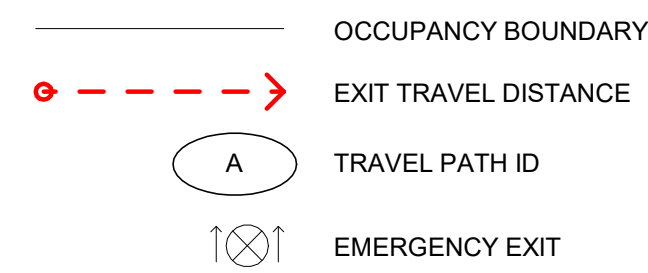


TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	242' - 1"
1H	242' - 11"
1I	260' - 4"
1J	192' - 4"
1K	175' - 2"
1L	176' - 5"
1M	187' - 8"
1N	192' - 8"
1P	243' - 5"
1Q	218' - 2"
1R	200' - 0"
1S	302' - 8"
1T	245' - 0"
1U	231' - 0"
1V	98' - 3"
1X	106' - 6"
1Y	102' - 9"
1Z	93' - 9"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ.		Total
			Load	Calc	
LEVEL 1					
0100	VEST	120 SF	100	2	
0101	LOBBY	1678 SF	100	17	
0102	FREEDOM CAFE	1192 SF	100	12	
0104	Large CONFERENCE	498 SF	100	5	
0105	BREAK	116 SF	100	2	
0106	WELL	83 SF	100	1	
0107	VEST	106 SF	100	2	
0108	TENANT	105 SF	100	2	
0109	VESTMENT OFFICE	3841 SF	100	39	
0110	CORRIDOR	1743 SF	300	3	
0111	ELEV ROOM	171 SF	100	6	
0112	PASS ELEV.	96 SF	100	1	
0113	WRR	212 SF	100	3	
0114	MRR	212 SF	100	3	
0115	SHOWER	122 SF	100	2	
0116	VEST	900 SF	100	10	
0117	STORAGE CENTER	1005 SF	300	4	
0118	STORAGE	145 SF	300	1	
0119	STAIR 02	523 SF	100	6	
0120	JAN	68 SF	300	1	
0130	VEST	67 SF	100	2	
0131	SEC. RECEPTION	129 SF	100	2	
0132	SEC. MANAGER	144 SF	100	2	
0133	SECURITY OFFICE	195 SF	100	2	
0134	VEST	592 SF	100	6	
0135	ARMORY	106 SF	100	2	
0136	CORRIDOR	1859 SF	300	7	
0150	DOCK	1696 SF	300	6	
0151	RR	86 SF	100	1	
0152	DOCK STORAGE	273 SF	300	1	
0153	TRASH	268 SF	300	1	
0154	ELEV ROOM	138 SF	300	1	
0160	FREIGHT ELEV.	240 SF	300	1	
0161	STAIR	1430 SF	300	1	
0162	STORAGE	53 SF	300	1	
0163	STAIR 01	463 SF	100	5	
0164	RISER	374 SF	300	2	
0165	TELEVISION STORAGE	424 SF	300	2	
0166	ELEV ROOM	67 SF	300	1	
0180	FLEX	7493 SF	300	25	
0181	STAIR 11	224 SF	100	3	
0190	FLEX	9537 SF	300	32	
0191	STAIR 03	424 SF	300	15	
0192	DOIM	280 SF	300	3	
0193	MMRIA	609 SF	300	3	
0194	EF	183 SF	300	1	
0195	STAIR 03	509 SF	100	6	
0196	ELEV	757 SF	100	3	
1100	DATA HALL	42062 SF	300	141	
1200	DATA HALL	41968 SF	300	140	
1300	CORRIDOR	10801 SF	300	37	
1400	STAIR 07	912 SF	300	3	
1500	DATA HALL	46586 SF	300	156	
1600	CORRIDOR	18296 SF	300	61	
1700	CORRIDOR	791 SF	300	3	
1301	STAIR 04	461 SF	100	5	
1302	STAIR 05	458 SF	100	5	
1303	STAIR 06	488 SF	100	5	
1305	STAIR 08	224 SF	100	3	
1306	STAIR 09	224 SF	100	3	
1307	STAIR 10	224 SF	100	3	
1400	MMR1B	557 SF	300	2	
1401	EF	134 SF	300	1	
1402	HOUSE ELEC.	700 SF	300	3	
1403	ELI	627 SF	300	3	
1404	BRIGHT ELEV.	362 SF	300	2	
1405	IDF	239 SF	300	3	
1406	FIRE	207 SF	300	3	
1407	STORAGE	47 SF	300	1	
1409	RR	63 SF	300	1	
1410	ELEV ROOM	154 SF	300	1	
1500	FACILITIES OFFICE	1895 SF	100	19	
1501	RR	63 SF	100	1	
1502	RR	190 SF	100	2	
1503	BREAK ROOM	580 SF	100	6	
1504	OFFICE	131 SF	100	1	
1505	OFFICE	113 SF	100	2	
1506	OFFICE	113 SF	100	2	
1507	OFFICE	113 SF	100	2	
Level 1: 79		224033 SF			905
Level 1 total:		224033 SF			905

FIRE EXTINGUISHER LEGEND

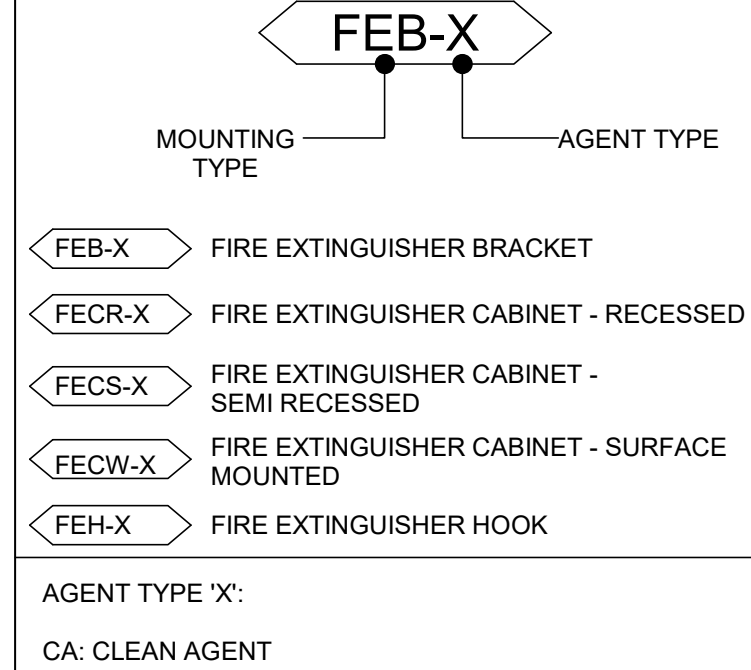

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000




SYSKA HENNESSY
GROUP



ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

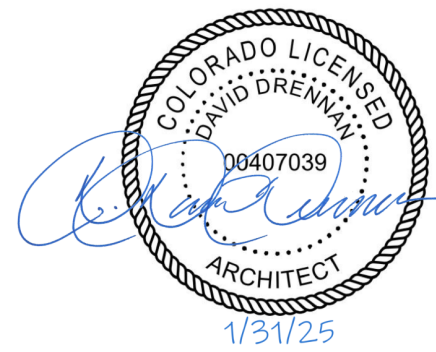

QTS DEN1 DC2

1140 N. GUN CLUB ROAD



KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT H

JOB 24464.0000
DATE 01.31.25
SHEET

G01-01H

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

PARTITION RATING LEGEND

	UNRATED PARTITION ASSEMBLY
	1 HOUR RATED PARTITION ASSEMBLY
	2 HOUR RATED PARTITION ASSEMBLY
	3 HOUR RATED PARTITION ASSEMBLY
	1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER MOUNTING LEGEND

INTENT IS ALIGNMENT IN VISUAL FIELD						
FINISH FLOOR						
ACCESSORY NAME	HOOKS	NOTE FROM BOTTOM OF HOOK	BRACKETS	NOTE FROM CENTER LINE OF BRACKET	CABINET	NOTE FROM CENTER LINE OF HANDLE
		FIRE EXTINGUISHER HOOK		FIRE EXTINGUISHER BRACKET		FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
						FIRE EXTINGUISHER CABINET - SEMI RECESSED
						FIRE EXTINGUISHER CABINET - RECESSED
						FIRE EXTINGUISHER CABINET - EXTERIOR

LIFE SAFETY LEGEND

	OCCUPANCY BOUNDARY
	EXIT TRAVEL DISTANCE
	TRAVEL PATH ID
	EMERGENCY EXIT

TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	242' - 1"
1H	242' - 11"
1I	260' - 4"
1J	192' - 4"
1K	175' - 2"
1L	175' - 5"
1M	187' - 8"
1N	192' - 8"
1P	243' - 5"
1Q	218' - 2"
1R	200' - 0"
1S	302' - 8"
1T	245' - 9"
1U	231' - 0"
1W	98' - 3"
1X	106' - 8"
1Y	102' - 9"
1Z	93' - 9"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 1				
0100	VEST	120 SF	100	2
0101	LOBBY	1678 SF	100	17
0102	FREEDOM CAFE	1192 SF	100	12
0104	LARGE CONFERENCE	498 SF	100	5
0105	BREAK	116 SF	100	2
0106	WELL	83 SF	100	1
0107	VEST	105 SF	100	2
0108	VEST	105 SF	100	2
0109	TENANT OFFICE	3841 SF	100	39
0110	CORRIDOR	1743 SF	300	6
0111	ELEV ROOM	171 SF	100	2
0112	PASS ELEV.	95 SF	100	1
0113	WRR	212 SF	100	3
0114	MRR	212 SF	100	3
0115	SHOWER	122 SF	100	2
0116	FITNESS CENTER	903 SF	100	10
0117	STORAGE	1005 SF	300	4
0118	STORAGE	145 SF	300	1
0119	STAIR 02	523 SF	100	6
120	JAN	68 SF	300	1
0130	VEST	67 SF	100	1
0131	SEC. RECEPTION	129 SF	100	2
0132	SEC. MANAGER	144 SF	100	2
0133	SDF	195 SF	100	2
0134	SECURITY OFFICE	582 SF	100	6
0135	ARMORY	105 SF	100	2
0136	CORRIDOR	1859 SF	300	7
0150	DOCK	1894 SF	300	6
0151	RR	86 SF	100	1
0152	DOCK STORAGE	273 SF	300	1
0153	TRASH	285 SF	300	1
0154	ELEV ROOM	138 SF	300	1
0160	FREIGHT ELEV.	240 SF	300	1
0161	STORAGE	1430 SF	300	5
0162	STORAGE	53 SF	300	1
0163	STAIR 01	463 SF	100	5
0164	RISER	374 SF	300	2
0165	TENANT STORAGE	424 SF	300	2
0166	ELEC ROOM	677 SF	300	3
0180	FLEX	7493 SF	300	25
0181	STAIR 11	224 SF	100	3
0190	FLEX	9537 SF	300	32
0191	CORRIDOR	4314 SF	300	15
0192	DCIM	280 SF	300	1
0193	MMRIA	600 SF	300	3
0194	EF	183 SF	300	1
0195	STAIR 03	509 SF	100	6
0196	STORAGE	757 SF	300	3
1100	DATA HALL	42062 SF	300	141
1200	DATA HALL	41948 SF	300	140
1300	CORRIDOR	10801 SF	300	37
1300	GALLERY	9112 SF	300	31
1300	DATA HALL	46596 SF	300	156
1300	CORRIDOR	18296 SF	300	61
1300	CORRIDOR	791 SF	300	3
1301	STAIR 04	461 SF	100	5
1302	STAIR 05	458 SF	100	5
1303	STAIR 06	488 SF	100	5
1305	STAIR 08	224 SF	100	3
1306	STAIR 09	224 SF	100	3
1307	STAIR 10	224 SF	100	3
1400	MMR1B	557 SF	300	2
1401	EF	134 SF	300	1
1402	HOUSE ELEC.	700 SF	300	3
1403	ELI	627 SF	300	3
1404	FREIGHT ELEV.	362 SF	300	2
1405	IDF	239 SF	300	1
1406	FIRE	207 SF	300	1
1407	STORAGE	47 SF	300	1
1409	RR	63 SF	100	1
1410	ELEV. ROOM	154 SF	300	1
1500	FACILITIES OFFICE	1895 SF	100	19
1501	RR	63 SF	100	1
1502	RR	190 SF	100	2
1503	BREAK ROOM	580 SF	100	6
1504	OFFICE	131 SF	100	2
1505	OFFICE	113 SF	100	2
1506	OFFICE	113 SF	100	2
1507	OFFICE	113 SF	100	2
LEVEL 1: 79	224033 SF	905		
Grand total: 79	224033 SF	905		

FIRE EXTINGUISHER LEGEND

	AGENT TYPE
	MOUNTING TYPE
	FIRE EXTINGUISHER BRACKET
	FIRE EXTINGUISHER CABINET - RECESSED
	FIRE EXTINGUISHER CABINET - SEMI RECESSED
	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
	FIRE EXTINGUISHER HOOK
AGENT TYPE 'X':	
CA: CLEAN AGENT	

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000



SYSKA HENNESSY
GROUP



DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

4

5

6

7

8

9

10

REVISIONS

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

31

32

33

34

35

36

37

38

39

40

41

42

43

44

45

46

47

48

49

50

51

52

53

54

55

56

57

58

59

60

61

62

63

64

65

66

67

68

69

70

71

72

73

74

75

76

77

78

79

80

81

82

83

84

85

86

87

88

89

90

91

92

93

94

95

96

97

98

99

100

101

102

103

104

105

106

107

108

109

110

111

112

113

114

115

116

117

118

119

120

121

122

123

124

125

126

127

128

129

130

131

132

133

134

135

136

137

138

139

140

141

142

143

144

145

146

147

148

149

150

151

152

153

154

155

156

157

158

159

160

161

162

163

164

165

166

167

168

169


170

171


172

1


03242 PARTITION RATING LEGEND

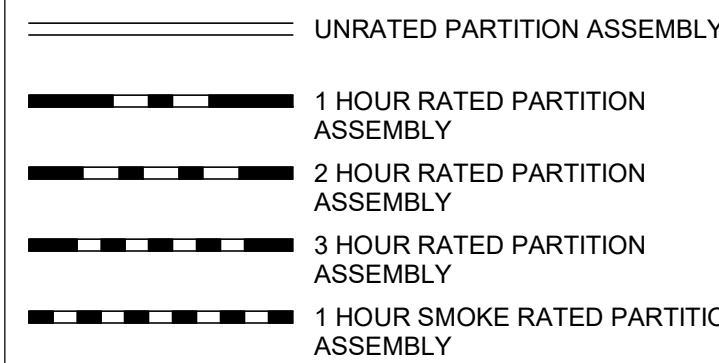

FIRE EXTINGUISHER MOUNTING LEGEND

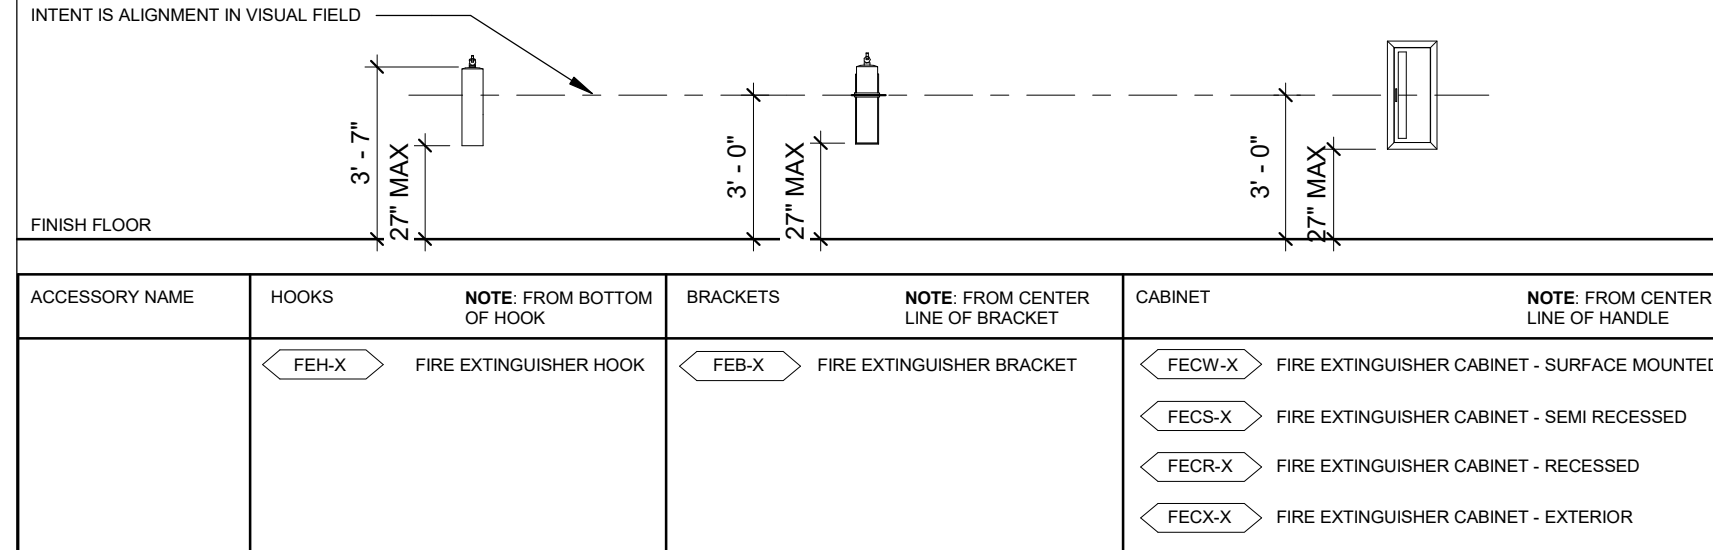

LIFE SAFETY LEGEND

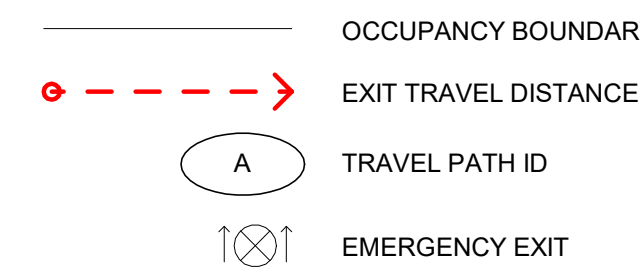


TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	107' - 10"
1F	124' - 0"
1G	242' - 1"
1H	242' - 11"
1I	260' - 4"
1J	192' - 4"
1K	175' - 2"
1L	175' - 5"
1M	187' - 8"
1N	192' - 8"
1P	243' - 5"
1Q	218' - 2"
1R	200' - 0"
1S	302' - 8"
1T	245' - 9"
1U	231' - 0"
1W	98' - 3"
1X	106' - 6"
1Y	102' - 9"
1Z	93' - 9"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Factor		Total Occ
			Calc	Calcd	
LEVEL 1					
0100	VEST	120 SF	100	2	
0101	LOBBY	1678 SF	100	17	
0102	1192 EDOM CAFE	1192 SF	100	12	
0104	Large CONFERENCE	498 SF	100	5	
0105	BREAK	116 SF	100	5	
0106	WELL	83 SF	100	1	
0107	STREET	100 SF	100	2	
0108	VEST	105 SF	100	2	
0109	TENANT OFFICE	3841 SF	100	39	
0110	CORRIDOR	1743 SF	300	6	
0111	ELEV ROOM	171 SF	100	2	
0112	ELEV.	98 SF	100	1	
0113	WRR	212 SF	100	3	
0114	MRR	212 SF	100	3	
0115	SHOWER	122 SF	100	2	
0116	SECURITY CENTER	902 SF	100	10	
0117	STORAGE	1005 SF	300	4	
0118	STORAGE	145 SF	300	1	
0119	STAIR 02	523 SF	100	1	
120	JAN	68 SF	300	1	
1300	TEST	67 SF	100	1	
0131	SEC. RECEPTION	129 SF	100	2	
0132	SEC. MANAGER	144 SF	100	2	
0133	SDF	196 SF	100	2	
0134	SECURITY OFFICE	100 SF	100	6	
0135	ARMORY	106 SF	100	2	
0136	CORRIDOR	1859 SF	300	7	
0150	DOCK	1864 SF	300	6	
0151	RR	86 SF	100	1	
0152	DOCK STORAGE	273 SF	300	1	
0153	TRASH	268 SF	300	1	
0154	ELEV ROOM	138 SF	300	1	
0160	FREIGHT ELEV.	240 SF	300	1	
0161	STORAGE	1430 SF	300	1	
0162	STORAGE	53 SF	300	1	
0163	STAIR 01	463 SF	100	5	
0164	RISER	374 SF	300	2	
0165	TENANT STORAGE	424 SF	300	2	
0166	ELEV ROOM	677 SF	300	2	
0180	FLEX	7493 SF	300	25	
0181	STAIR	224 SF	100	3	
0189	FLX	9537 SF	300	32	
0191	CORRIDOR	424 SF	300	15	
0192	DCIM	280 SF	300	1	
0193	MMR1A	609 SF	300	3	
0194	EF	183 SF	300	1	
0195	STAIR 03	509 SF	100	6	
0196	STAIR	707 SF	300	3	
1100	DATA HALL	4296 SF	300	141	
1200	DATA HALL	41602 SF	300	140	
1300	CORRIDOR	10801 SF	300	37	
1300	STAIR	915 SF	300	3	
1300	DATA HALL	46586 SF	300	156	
1300	CORRIDOR	18296 SF	300	61	
1300	CORRIDOR	791 SF	300	3	
1301	STAIR 04	461 SF	100	5	
1302	STAIR 05	458 SF	100	5	
1303	STAIR 06	488 SF	100	5	
1305	STAIR 08	224 SF	100	3	
1306	STAIR 09	224 SF	100	3	
1307	STAIR 10	224 SF	100	3	
1400	MMR1B	557 SF	300	2	
1401	EF	134 SF	300	1	
1402	HOUSE ELEC.	700 SF	300	3	
1403	ELI	627 SF	300	3	
1404	FREIGHT ELEV.	362 SF	300	2	
1405	IDF	239 SF	300	1	
1406	FIRE	207 SF	300	1	
1407	STORAGE	47 SF	300	1	
1409	RR	154 SF	300	1	
1410	ELEV ROOM	174 SF	300	1	
1500	FACILITIES OFFICE	1895 SF	100	19	
1501	RR	63 SF	100	1	
1502	RR	190 SF	100	2	
1503	BRACK ROOM	585 SF	100	6	
1504	OFFICE	131 SF	100	1	
1505	OFFICE	113 SF	100	2	
1506	OFFICE	113 SF	100	2	
1507	OFFICE	113 SF	100	2	
LEVEL 79		224033 SF			905
Grand total: 79		224033 SF			905

FIRE EXTINGUISHER LEGEND

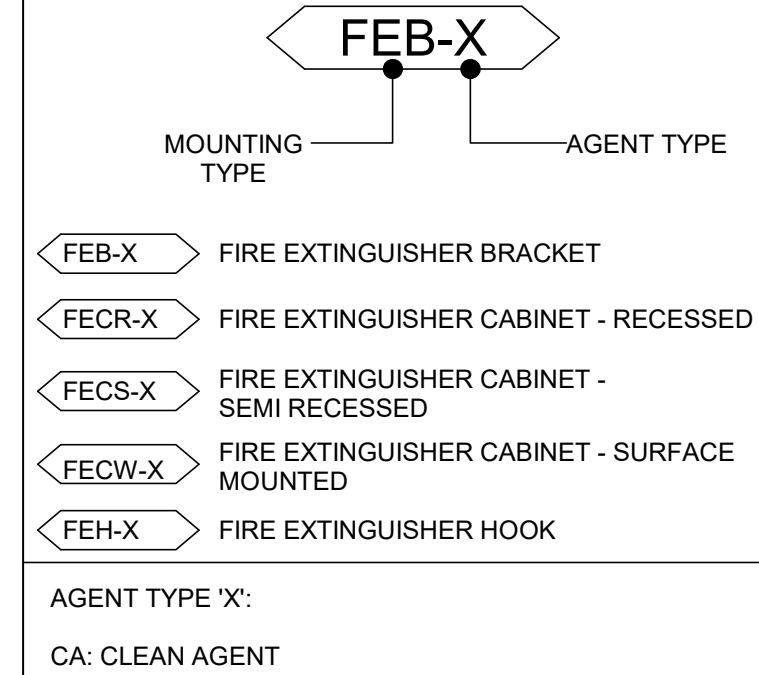

CORGAN


401 N. Houston Street Dallas, TX
75202
T: 214.748.2000



ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

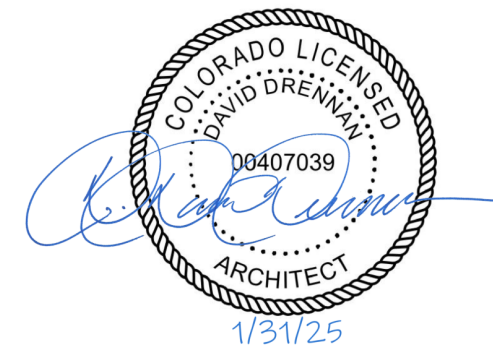

QTS DEN1 DC2

1140 N. GUN CLUB ROAD



KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT M

JOB 24464.0000
DATE 01.31.25
SHEET

G01-01M Page 11 of 58

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

PARTITION RATING LEGEND

	UNRATED PARTITION ASSEMBLY
	1 HOUR RATED PARTITION ASSEMBLY
	2 HOUR RATED PARTITION ASSEMBLY
	3 HOUR RATED PARTITION ASSEMBLY
	1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER MOUNTING LEGEND

INTENT IS ALIGNMENT IN VISUAL FIELD						
ACCESSORY NAME	HOOKS	NOTE FROM BOTTOM OF HOOK	BRACKETS	NOTE FROM CENTER LINE OF BRACKET	CABINET	NOTE FROM CENTER LINE OF HANDLE
		FIRE EXTINGUISHER HOOK		FIRE EXTINGUISHER BRACKET		FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
						FIRE EXTINGUISHER CABINET - SEMI RECESSED
						FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
						FIRE EXTINGUISHER HOOK

LIFE SAFETY LEGEND

	OCCUPANCY BOUNDARY
	EXIT TRAVEL DISTANCE
	TRAVEL PATH ID
	EMERGENCY EXIT

TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	242' - 1"
1H	242' - 11"
1I	260' - 4"
1J	192' - 4"
1K	175' - 2"
1L	175' - 5"
1M	187' - 8"
1N	192' - 8"
1P	243' - 5"
1Q	218' - 2"
1R	200' - 0"
1S	302' - 8"
1T	245' - 9"
1U	231' - 0"
1W	98' - 3"
1X	106' - 8"
1Y	102' - 9"
1Z	93' - 9"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 1				
0100	VEST	120 SF	100	2
0101	LOBBY	1678 SF	100	17
0102	FREEDOM CAFE	1192 SF	100	12
0104	LARGE CONFERENCE	498 SF	100	5
0105	BREAK	116 SF	100	2
0106	WELL	83 SF	100	1
0107	VEST	105 SF	100	2
0108	VEST	105 SF	100	2
0109	TENANT OFFICE	3841 SF	100	39
0110	CORRIDOR	1743 SF	300	6
0111	ELEV ROOM	171 SF	100	2
0112	PASS ELEV.	96 SF	100	1
0113	WRR	212 SF	100	3
0114	MRR	212 SF	100	3
0115	SHOWER	122 SF	100	2
0116	FITNESS CENTER	903 SF	100	10
0117	STORAGE	1005 SF	300	4
0118	STORAGE	145 SF	300	1
0119	STAIR 02	523 SF	100	6
120	JAN	68 SF	300	1
0130	VEST	67 SF	100	1
0131	SEC. RECEPTION	129 SF	100	2
0132	SEC. MANAGER	144 SF	100	2
0133	SDF	195 SF	100	2
0134	SECURITY OFFICE	582 SF	100	6
0135	ARMORY	106 SF	100	2
0136	CORRIDOR	1859 SF	300	7
0150	DOCK	1894 SF	300	6
0151	RR	86 SF	100	1
0152	DOCK STORAGE	273 SF	300	1
0153	TRASH	288 SF	300	1
0154	ELEV ROOM	138 SF	300	1
0160	FREIGHT ELEV.	240 SF	300	1
0161	STORAGE	1430 SF	300	5
0162	STORAGE	53 SF	300	1
0163	STAIR 01	463 SF	100	5
0164	RISER	374 SF	300	2
0165	TENANT STORAGE	424 SF	300	2
0166	ELEC ROOM	677 SF	300	3
0180	FLEX	1493 SF	300	25
0181	STAIR 11	224 SF	100	3
0190	FLEX	9537 SF	300	32
0191	CORRIDOR	4314 SF	300	15
0192	DCIM	280 SF	300	1
0193	MMR1A	600 SF	300	3
0194	EF	183 SF	300	1
0195	STAIR 03	509 SF	100	6
0196	STORAGE	757 SF	300	3
1100	DATA HALL	42082 SF	300	141
1200	DATA HALL	41948 SF	300	140
1300	CORRIDOR	10801 SF	300	37
1300	GALLERY	9112 SF	300	31
1300	DATA HALL	46596 SF	300	156
1300	CORRIDOR	18296 SF	300	61
1300	CORRIDOR	791 SF	300	3
1301	STAIR 04	461 SF	100	5
1302	STAIR 05	458 SF	100	5
1303	STAIR 06	488 SF	100	5
1305	STAIR 08	224 SF	100	3
1306	STAIR 09	224 SF	100	3
1307	STAIR 10	224 SF	100	3
1400	MMR1B	557 SF	300	2
1401	EF	134 SF	300	1
1402	HOUSE ELEC.	700 SF	300	3
1403	ELI	627 SF	300	3
1404	FREIGHT ELEV.	362 SF	300	2
1405	IDF	239 SF	300	1
1406	FIRE	207 SF	300	1
1407	STORAGE	47 SF	300	1
1409	RR	63 SF	100	1
1410	ELEV. ROOM	154 SF	300	1
1500	FACILITIES OFFICE	1895 SF	100	19
1501	RR	63 SF	100	1
1502	RR	190 SF	100	2
1503	BREAK ROOM	580 SF	100	6
1504	OFFICE	131 SF	100	2
1505	OFFICE	113 SF	100	2
1506	OFFICE	113 SF	100	2
1507	OFFICE	113 SF	100	2
LEVEL 1: 79	224033 SF			905
Grand total: 79	224033 SF			905

FIRE EXTINGUISHER LEGEND

	AGENT TYPE
	MOUNTING TYPE
	FIRE EXTINGUISHER BRACKET
	FIRE EXTINGUISHER CABINET - RECESSED
	FIRE EXTINGUISHER CABINET - SEMI RECESSED
	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
	FIRE EXTINGUISHER HOOK

AGENT TYPE 'X':
CA: CLEAN AGENT

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP

TEC
DESIGN CONSULTING LLC


ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

4		
5		
6		
7		
8		
9		
10		

REVISIONS

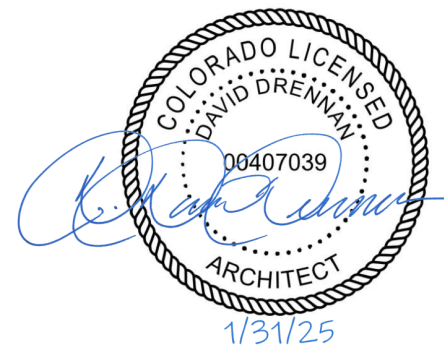

QTS DEN1 DC2
1140 N. GUN CLUB ROAD



KEYPLAN


S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT P


JOB 24464.0000
DATE 01.31.25
SHEET

G01-01P


03242 PARTITION RATING LEGEND

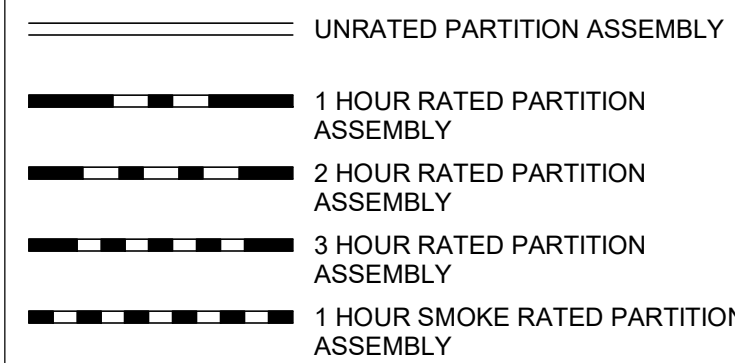

FIRE EXTINGUISHER MOUNTING LEGEND

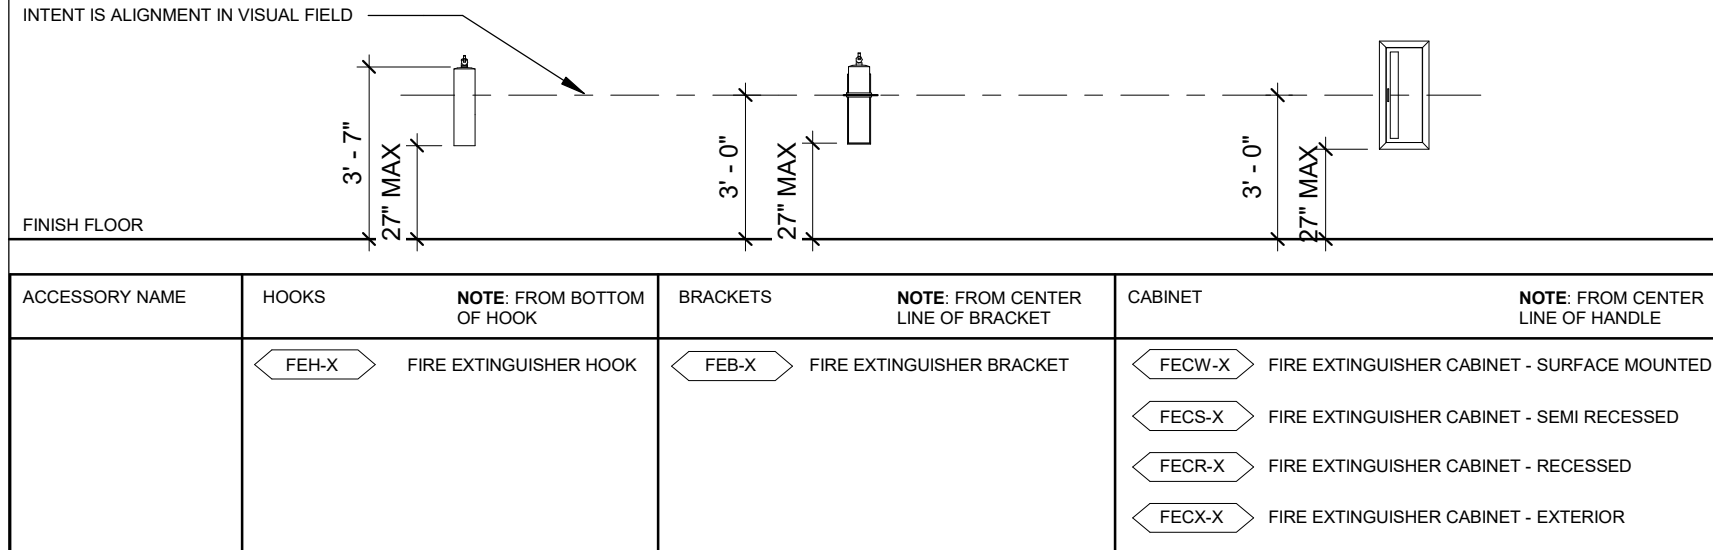

LIFE SAFETY LEGEND

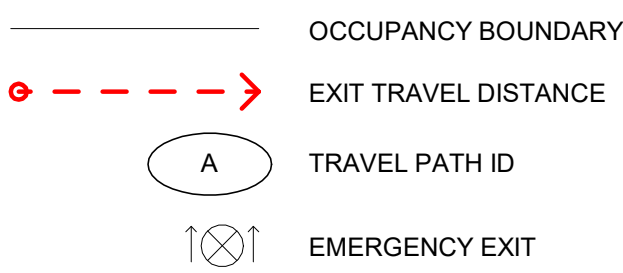


TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52° - 0"
1B	160° - 7"
1C	18° - 6"
1C.1	130° - 7"
1D	109° - 0"
1E	100° - 10"
1F	124° - 0"
1G	242° - 1"
1H	242° - 11"
1I	260° - 4"
1J	192° - 4"
1K	178° - 2"
1L	178° - 2"
1M	187° - 8"
1N	192° - 8"
1P	243° - 5"
1Q	218° - 2"
1R	200° - 0"
1S	302° - 8"
1T	245° - 0"
1U	231° - 0"
1W	98° - 3"
1X	106° - 6"
1Y	162° - 9"
1Z	93° - 9"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Load Factor		Total Occ. Calc.
			Calc.	Calc.	
LEVEL 1					
0100	VEST	120 SF	100	2	17
0101	LOBBY	1678 SF	100	17	12
0102	FREEDOM CAFE	1162 SF	100	10	12
0104	LAKE CONFERENCE	498 SF	100	5	5
0105	BREAK	116 SF	100	5	5
0106	WELL	83 SF	100	1	1
0108	VEST	103 SF	100	2	2
0108	VEST	103 SF	100	2	2
0109	TENANT OFFICE	3641 SF	100	39	39
0110	CORRIDOR	1743 SF	300	6	2
0111	ELEV ROOM	177 SF	100	2	2
0112	PLN ELEV.	98 SF	100	1	1
0113	WRR	212 SF	300	1	3
0114	MRR	212 SF	300	1	3
0115	SHOWER	122 SF	100	2	2
0116	VEST	903 SF	300	3	10
0117	STORAGE CENTER	1005 SF	300	4	4
0118	STORAGE	145 SF	300	1	1
0119	STAIR 02	523 SF	100	6	6
0120	JAN	68 SF	300	1	1
0130	VEST	67 SF	100	1	1
0131	SEC. RECEPTION	129 SF	100	2	2
0132	SEC. MANAGER	144 SF	100	2	2
0133	SOF	195 SF	100	2	2
0134	SECURITY OFFICE	592 SF	100	6	6
0135	ARMORY	106 SF	100	2	2
0136	CORRIDOR	1859 SF	300	3	3
0150	DOCK	1694 SF	600	6	6
0151	RR	86 SF	100	1	1
0152	DOCK STORAGE	273 SF	300	1	1
0153	TRASH	268 SF	300	1	1
0154	ELEV ROOM	138 SF	300	1	1
0160	FREIGHT ELEV.	240 SF	300	1	1
0161	STORAGE	1430 SF	300	3	3
0162	STORAGE	53 SF	300	1	1
0163	STAIR 01	463 SF	100	5	5
0164	RISER	374 SF	300	2	2
0165	TENANT STORAGE	424 SF	300	2	2
0166	ELEC ROOM	67 SF	300	1	1
0168	FLX	7493 SF	300	25	25
0181	STAIR 11	224 SF	100	3	3
0190	FLEX	9537 SF	300	32	32
0191	CORRIDOR	4314 SF	300	15	15
0192	DCIM	280 SF	300	1	1
0193	MMRIA	609 SF	300	3	3
0194	EF	183 SF	300	1	1
0195	STAIR 03	508 SF	100	6	6
0196	STAIR	751 SF	300	3	3
1100	DATA HALL	42068 SF	300	141	141
1300	CORRIDOR	140801 SF	300	37	37
1400	STAIR 10	91 SF	300	1	1
1300	DATA HALL	46696 SF	300	156	156
1300	CORRIDOR	18296 SF	300	61	61
1300	CORRIDOR	791 SF	300	3	3
1301	STAIR 04	481 SF	300	5	5
1302	STAIR 02	458 SF	300	5	5
1303	STAIR 06	486 SF	100	5	5
1305	STAIR 08	224 SF	300	1	1
1306	STAIR 09	224 SF	100	3	3
1307	STAIR 10	224 SF	100	3	3
1400	MMRIA	557 SF	300	2	2
1401	EF	134 SF	300	1	1
1402	HOUSE ELEC.	700 SF	300	2	2
1403	ELI	627 SF	300	3	3
1404	FREIGHT ELEV.	362 SF	300	2	2
1405	IDF	239 SF	300	1	1
1406	FIRE	207 SF	300	1	1
1407	STORAGE	47 SF	300	1	1
1409	RR	83 SF	100	1	1
1500	FACILITIES OFFICE	1895 SF	100	19	19
1501	RR	63 SF	100	1	1
1502	RR	190 SF	100	2	2
1503	BREAK ROOM	580 SF	100	6	6
1504	OFFICE	131 SF	100	1	1
1505	OFFICE	113 SF	100	2	2
1506	OFFICE	113 SF	100	2	2
1507	OFFICE	113 SF	100	2	2
LEVEL 1: 79		22403 SF			905
Grand Total:		22403 SF			905

FIRE EXTINGUISHER LEGEND

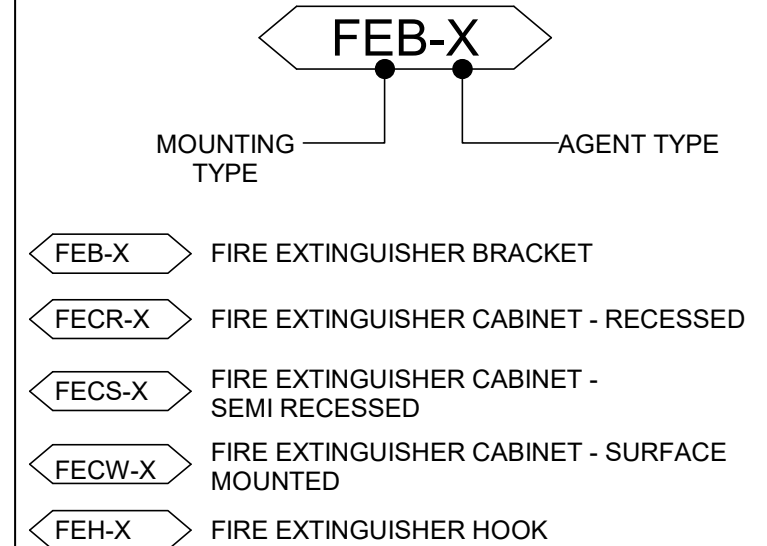

CA: CLEAN AGENT

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000



SYSKA HENNESSY
GROUP




DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

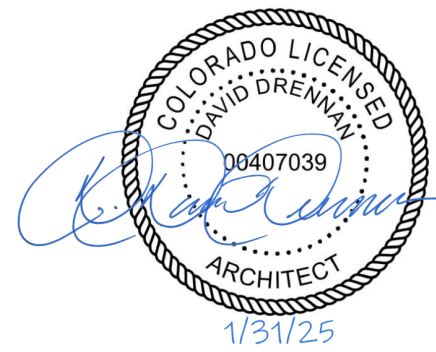

QTS DEN1 DC2

1140 N. GUN CLUB ROAD



KEYPLAN

	Q	N	L	J	G	E	C	A
S								
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT R

JOB 24464.0000
DATE 01.31.25
SHEET

G01-01R Page 13 of 58

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

PARTITION RATING LEGEND

UNRATED PARTITION ASSEMBLY
1 HOUR RATED PARTITION ASSEMBLY
2 HOUR RATED PARTITION ASSEMBLY
3 HOUR SMOKE RATED PARTITION ASSEMBLY
1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER MOUNTING LEGEND

INTENT IS ALIGNMENT IN VISUAL FIELD					
FINISH FLOOR					
ACCESSORY NAME	HOOKS	NOTE FROM BOTTOM OF HOOK	BRACKETS	NOTE FROM CENTER LINE OF BRACKET	CABINET
	FEH-X	FIRE EXTINGUISHER HOOK	FEB-X	FIRE EXTINGUISHER BRACKET	FECHW-X
					FECS-X
					FECH-X
					FECH-X

LIFE SAFETY LEGEND

OCCUPANCY BOUNDARY
EXIT TRAVEL DISTANCE
TRAVEL PATH ID
EMERGENCY EXIT

TRAVEL DISTANCES 1

Travel Path ID	Travel Path Distance
1A	52' - 0"
1B	160' - 7"
1C	187' - 6"
1C.1	130' - 7"
1D	109' - 0"
1E	100' - 10"
1F	124' - 0"
1G	234' - 7"
1H	261' - 10"
1I	258' - 2"
1J	192' - 8"
1K	175' - 2"
1L	185' - 8"
1M	192' - 7"
1N	192' - 7"
1P	251' - 8"
1Q	215' - 8"
1R	199' - 1"
1S	296' - 10"
1T	253' - 7"
1U	231' - 2"
1W	92' - 0"
1X	107' - 1"
1Y	100' - 5"
1Z	114' - 8"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 1

Number	Name	Area	Occ. Load Factor	Calc	Total Occ.
LEVEL 1					
0100	VEST	120 SF	150	1	
0101	LOBBY	1666 SF	150	12	
0102	FREEDOM CAFE	1233 SF	150	9	
0104	LARGE CONFERENCE	498 SF	150	4	
0105	BREAK VEST.	114 SF	150	1	
0106	WELL	83 SF	150	1	
0107	VEST	154 SF	150	2	
0108	VEST	155 SF	150	2	
0109	TENANT OFFICE	3841 SF	150	26	
0110	CORRIDOR	3992 SF	300	14	
0111	STORAGE	182 SF	150	2	
0112	PASS ELEV.	98 SF	150	1	
0113	WRR	212 SF	150	2	
0114	MRR	212 SF	150	2	
0115	SHOWER	122 SF	150	1	
0116	FITNESS CENTER	857 SF	150	6	
0117	STORAGE	1005 SF	300	4	
0118	ELEC ROOM	145 SF	300	1	
0119	STAIR 02	523 SF	150	4	
120	JAN	68 SF	300	1	
0130	VEST	67 SF	150	1	
0131	SEC. RECEPTION	129 SF	150	1	
0132	SEC. MANAGER	144 SF	150	1	
0133	SDF	195 SF	150	2	
0134	SECURITY OFFICE	392 SF	150	4	
0135	ARMORY	108 SF	150	1	
0136	CORRIDOR	1951 SF	300	7	
0150	DOCK	1894 SF	300	6	
0151	RR	86 SF	150	1	
0152	DOCK STORAGE	273 SF	300	1	
0153	TRASH	268 SF	300	1	
0154	ELEV MACH	138 SF	300	1	
0160	FREIGHT ELEV.	240 SF	300	1	
0161	STORAGE	1430 SF	300	5	
0162	STORAGE	53 SF	300	1	
0163	STAIR 01	463 SF	150	4	
0164	RISER	374 SF	300	2	
0165	ELI	424 SF	300	2	
0166	ELEC ROOM	677 SF	300	3	
0180	FLEX	7493 SF	300	25	
0181	STAIR 11	224 SF	150	2	
0190	FLEX	8937 SF	300	30	
0191	CORRIDOR	2586 SF	300	9	
0192	DCIM	280 SF	300	1	
0193	MMRIA	600 SF	300	3	
0194	EF	183 SF	300	1	
0195	STAIR 03	509 SF	150	4	
0196	STORAGE	757 SF	300	3	
1000	DATA HALL	42062 SF	300	141	
1100	DATA HALL	41861 SF	300	140	
1133	RR	53 SF	300	1	
1200	DATA HALL	46596 SF	300	156	
1300	CORRIDOR	10801 SF	300	37	
1300	CORRIDOR	9109 SF	300	31	
1300	CORRIDOR	18343 SF	300	62	
1300	CORRIDOR	721 SF	300	3	
1301	STAIR 04	461 SF	150	4	
1302	STAIR 05	458 SF	150	4	
1303	STAIR 06	488 SF	150	4	
1305	STAIR 08	224 SF	150	2	
1306	STAIR 09	224 SF	150	2	
1307	STAIR 10	224 SF	150	2	
1400	MMR1B	575 SF	300	2	
1401	EF	138 SF	300	1	
1402	HOUSE ELEC.	719 SF	300	3	
1403	ELI	324 SF	300	2	
1404	FREIGHT ELEV.	362 SF	300	2	
1405	IDF	153 SF	300	1	
1406	FIRE	134 SF	300	1	
1407	JAN.	47 SF	300	1	
1408	LOADING DOCK	1956 SF	300	7	
1409	RR	63 SF	150	1	
1410	ELEV. MACH	154 SF	300	1	
1500	FACILITIES OFFICE	2348 SF	150	16	
1501	RR	63 SF	150	1	
1502	RR	131 SF	150	1	
1503	BREAK ROOM	580 SF	150	4	
1504	OFFICE	113 SF	150	1	
1505	OFFICE	113 SF	150	1	
1506	OFFICE	113 SF	150	1	
1507	OFFICE	115 SF	150	1	
LEVEL 1: 81		225987 SF		854	
Grand total: 81		225987 SF		854	

FIRE EXTINGUISHER LEGEND

AGENT TYPE	AGENT TYPE
FEH-X	FIRE EXTINGUISHER HOOK
FECH-X	FIRE EXTINGUISHER CABINET - RECESSED
FECH-X	FIRE EXTINGUISHER CABINET - SEMI RECESSED
FECH-X	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
FEH-X	FIRE EXTINGUISHER HOOK
AGENT TYPE 'X':	
CA: CLEAN AGENT	

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP


TD
DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

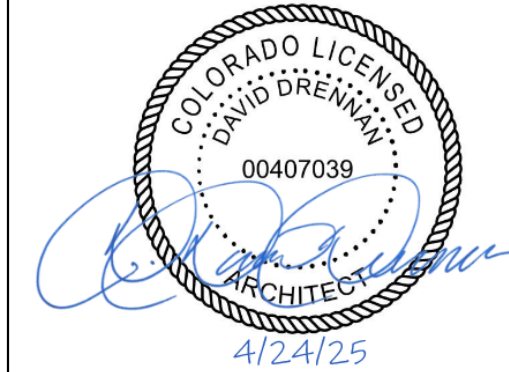

Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL ONE -
SEGMENT S & T

JOB 24464.0000
DATE 04.24.25
SHEET

G01-01ST


2 LIFE SAFETY PLAN - LEVEL ONE - SEGMENT Q
1/8" = 1'-0"

1 LIFE SAFETY PLAN - LEVEL ONE - SEGMENT R
1/8" = 1'-0"

LIFE SAFETY PLAN - LEVEL TWO - OVERALL
1" = 40'-0"

100% 2002


FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

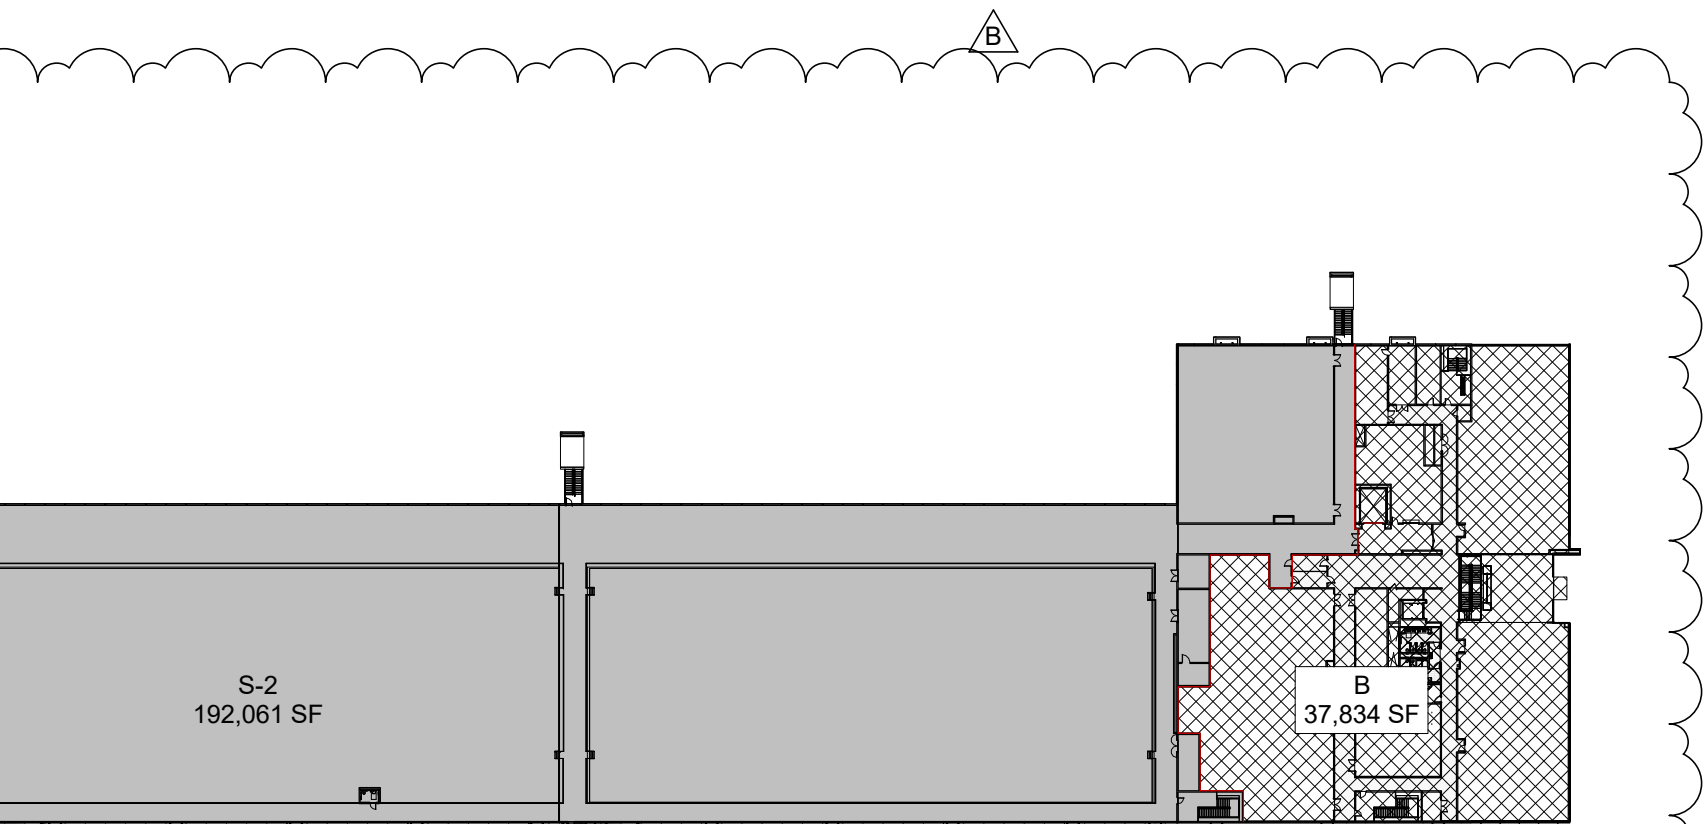


THIS SHEET IS FOR
REFERENCE ONLY




G02-02

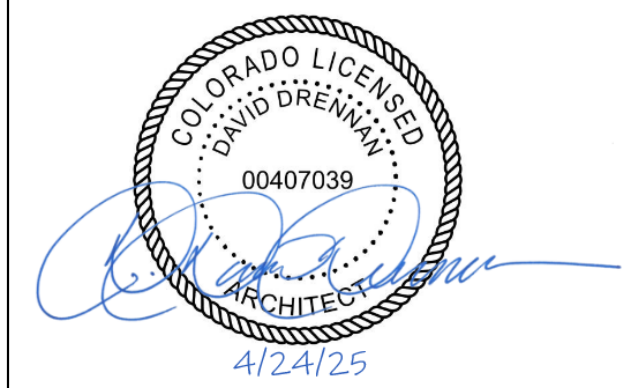


PARTITION RATING LEGEND

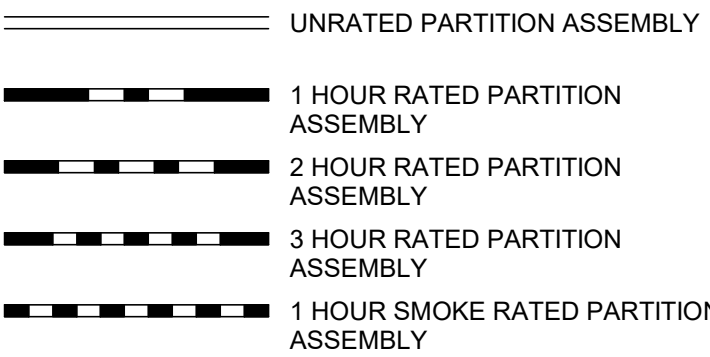

FIRE EXTINGUISHER MOUNTING LEGEND

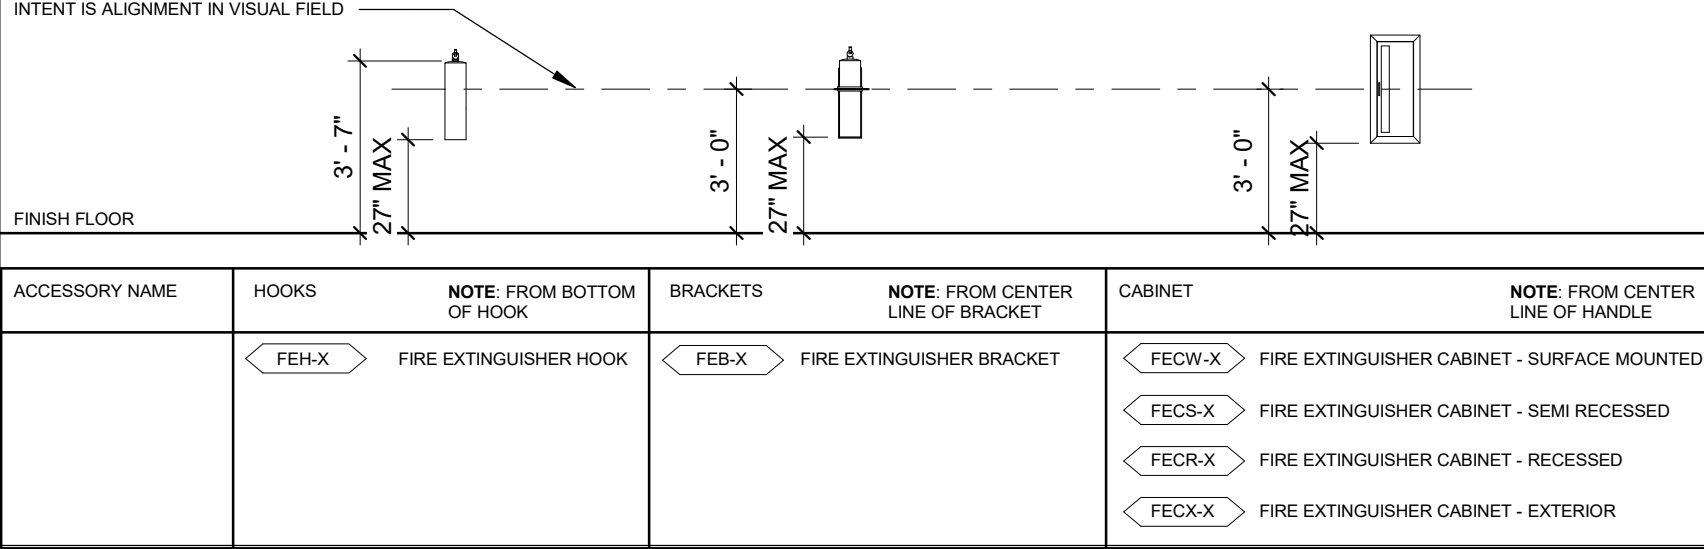

LIFE SAFETY LEGEND

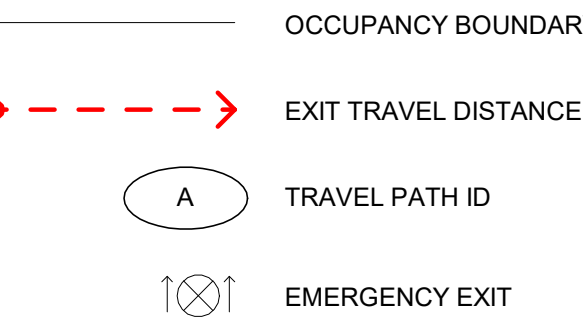


TRAVEL DISTANCES LVL 2

Travel Path ID	Travel Path Distance
2A	171' - 7"
2B	132' - 0"
2C	181' - 8"
2E	158' - 0"
2F	139' - 10"
2G	248' - 6"
2H	242' - 8"
2I	256' - 11"
2K	175' - 2"
2L	174' - 3"
2M	187' - 4"
2P	213' - 7"
2Q	239' - 7"
2R	199' - 5"
2S	268' - 6"
2T	252' - 8"
2U	43' - 2"
2V	212' - 9"
2W	99' - 2"
2X	118' - 5"
2Y	119' - 7"
2Z	88' - 11"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 2

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 2				
0206	VEST	537 SF		
0209	TENANT FLEX	5887 SF	300	20
0210	CORRIDOR	4913 SF	300	17
0211	STORAGE	163 SF	300	1
0212	PASS. ELEV.	98 SF	150	1
0213	WRR	213 SF	150	2
0214	MRR	212 SF	150	2
0217	STORAGE	2030 SF	300	7
0218	ELEC CLOSET	145 SF	300	1
0219	STAIR 02	525 SF	150	4
0220	JAN	68 SF	300	1
0260	FREIGHT ELEV.	240 SF	150	2
0261	STORAGE	1638 SF	300	6
0262	STORAGE	54 SF	300	1
0263	STAIR 01	469 SF	150	4
0264	RISER	374 SF	300	2
0265	STORAGE	424 SF	300	2
0266	ELEC ROOM	677 SF	300	3
0267	FLEX	5922 SF	300	20
0269	PRE ACTION	70 SF	300	1
0280	FLEX	7453 SF	300	25
0281	STAIR 11	224 SF	150	2
0290	FLEX	8569 SF	300	29
0291	CORRIDOR	2586 SF	300	9
0292	IDF	282 SF	300	1
0293	MMR2A	617 SF	300	3
0294	VAULT	187 SF	300	1
0295	STAIR 03	517 SF	150	4
0296	STORAGE	803 SF	300	3
0297	WATER	324 SF		
2100	DATA HALL	36131 SF	300	121
2200	DATA HALL	36311 SF	300	122
2201	RR	86 SF	150	1
2202	SHELL	1348 SF	300	5
2203	JAN.	114 SF	300	1
2204	WATER	143 SF		
2205	QTS STORAGE	1613 SF	300	6
2233	RR	55 SF		
2300	CORRIDOR	16731 SF	300	56
2300	CORRIDOR	14507 SF	300	49
2300	CORRIDOR	18313 SF	300	62
2300	DATA HALL	46586 SF	300	156
2301	STAIR 04	461 SF	150	4
2301	CORRIDOR	721 SF	300	3
2301	CORRIDOR	207 SF		
2302	STAIR 05	458 SF	150	4
2303	STAIR 06	488 SF	150	4
2304	STAIR 07	486 SF	150	4
2305	STAIR 08	224 SF	150	2
2306	STAIR 09	224 SF	150	2
2307	STAIR 10	224 SF	150	2
2400	MMR2B	606 SF	300	3
2401	EF	140 SF	300	1
2402	HOUSE ELEC.	764 SF	300	3
2403	FREIGHT ELEV.	363 SF	300	2
2404	IDF	239 SF	300	1
2405	FIRE	207 SF	300	1
2406	SHELL	2264 SF	300	8
3003	VEST	155 SF	150	2
3004	VEST	154 SF	150	2
LEVEL 2: 60		226554 SF		797
Grand total: 60		226554 SF		797

FIRE EXTINGUISHER LEGEND

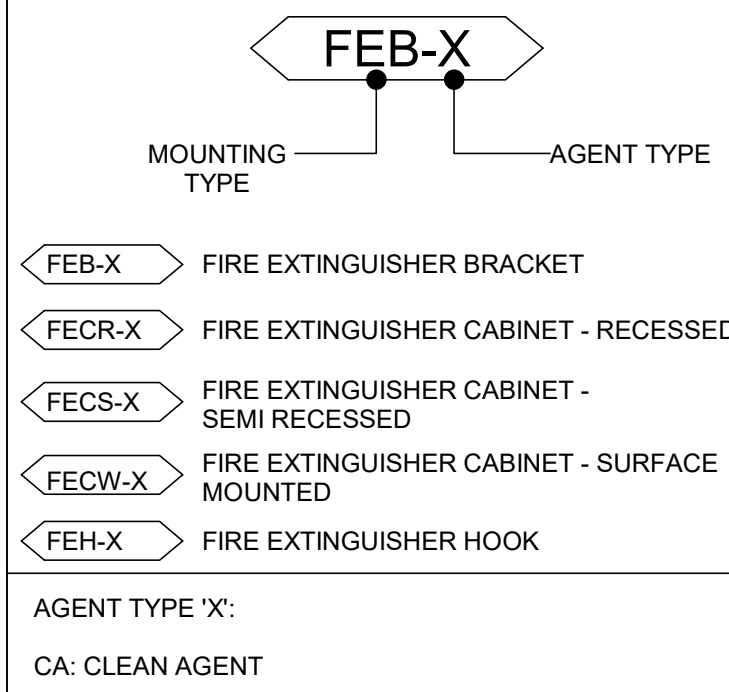

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP

TD
DESIGN CONSULTING LLC

ISSUES


1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

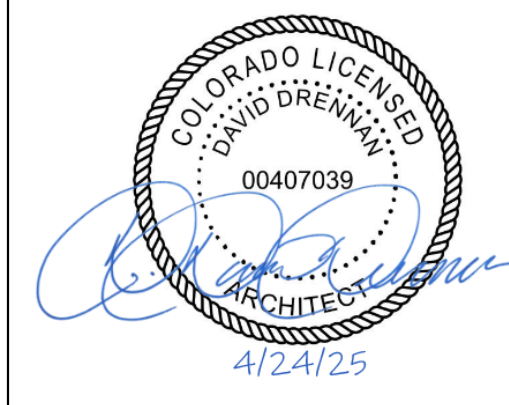

Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL TWO -
SEGMENT B


JOB 24464.0000
DATE 04.24.25
SHEET

G02-02B

2/4/2025 9:00:43 PM G02-02C LIFE SAFETY PLAN - LEVEL TWO - SEGMENT C

- PROVIDE FIRE TREATED PLYWOOD PUNCH DOWN BOARDS / BACKERBOARDS ON FACE OF GYP DB. WALL.
 - INSTALL 8'-0" x 8'-0" PLYWOOD AREA ON TWO DIFFERENT (PERPENDICULAR) WALLS OF MUR AND DCIMDMF ROOMS.
 - ENTRANCE FACILITY ROOMS, TELECOM RISER ROOMS AND DIT'S TO RECEIVE OILS 6'-0" x 8'-0" AREA.
 - PLYWOOD SHALL BE 3'-0" SHEETS. MOUNT BOTTOM OF PLYWOOD STARTING AT 2'-0" ABOVE FINISH FLOOR WITH 8'-0" DIMENSION VERTICALLY. PAINT PLYWOOD TO MATCH ROOM WALL COLOR.
 - DO NOT PLACE PLYWOOD BELOW MECHANICAL SPLIT SYSTEM(S).
 - COORDINATE WITH TLD CONSULTING.


FIRE EXTINGUISHER MOUNTING LEGEND

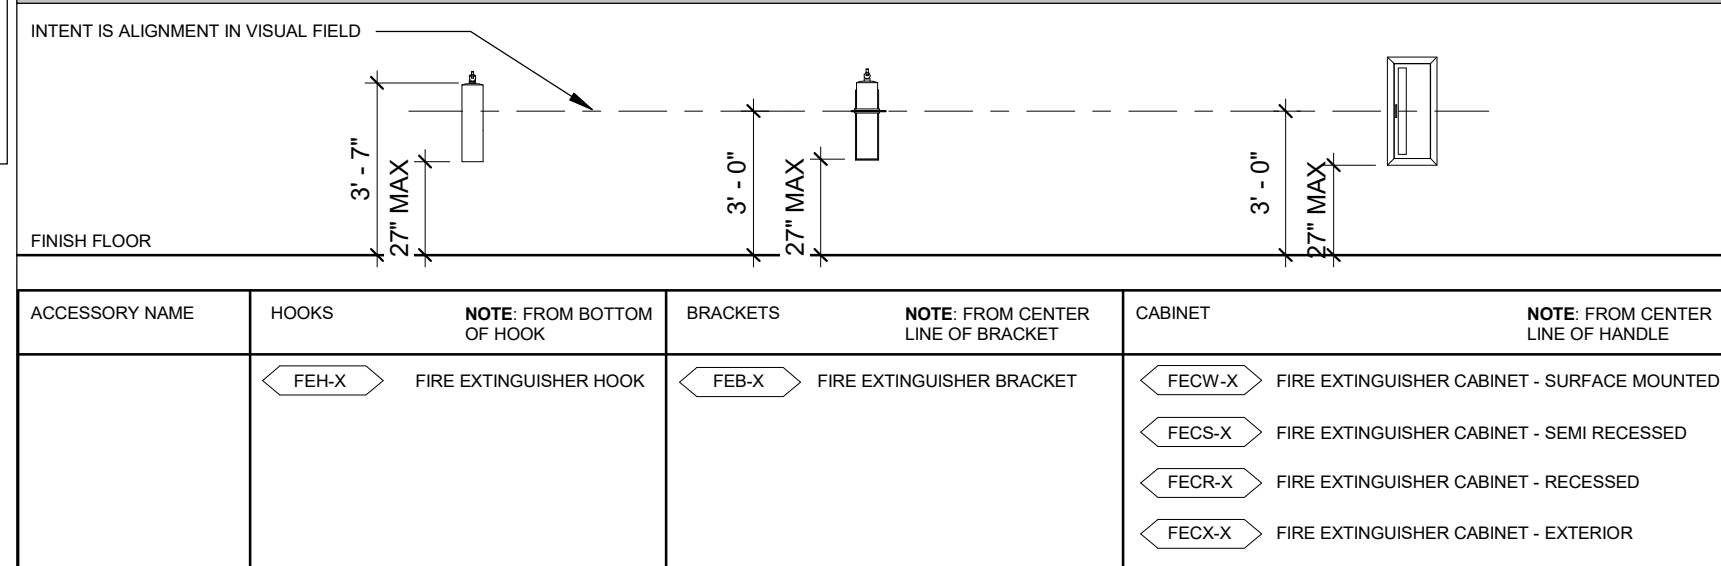

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

THIS SHEET IS FOR
REFERENCE ONLY

LIFE SAFETY LEGEND

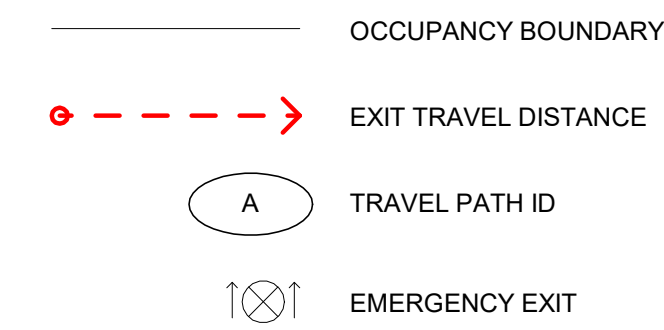


TRAVEL DISTANCES LVL 2

Travel Path ID	Travel Path Distance
2E	114' - 6"
2F	128' - 4"
2G	101' - 0"
2H	58' - 0"
2J	259' - 4"
2L	45' - 0"
2K	170' - 2"
2L	170' - 9"
2M	189' - 6"
2N	44' - 3"
2P	80' - 2"
2Q	73' - 4"
2R	201' - 9"
2S	44' - 3"
2T	54' - 3"


OCCUPANCY SCHEDULE BY ROOM - LEVEL 2

Number	Name	Area	Occ.	Total
			Load	Calc
Calc	Calc	Calc	Calc	Calc
0207	VEST	105 SF	100	2
0208	STAIR 01	105 SF	100	2
0209	TENANT FLEX	5895 SF	300	20
0210	CORRIDOR	2682 SF	300	9
0211	ELEV. ROOM	163 SF	300	1
0212	PASS. ELEV.	98 SF	100	1
0213	WTR	212 SF	100	1
0214	MRR	212 SF	100	3
0217	STORAGE	2032 SF	300	7
0218	STORAGE	145 SF	300	1
0219	STAIR 02	522 SF	300	1
0220	JAN.	68 SF	300	1
0260	FREIGHT ELEV.	240 SF	100	3
0261	STORAGE	1638 SF	300	6
0262	STORAGE	54 SF	300	1
0263	STAIR 1	469 SF	300	2
0264	RISER	374 SF	300	2
0265	STORAGE	424 SF	300	2
0266	STORAGE	677 SF	300	3
0267	FLEX	5942 SF	300	20
0269	PRE ACTION	70 SF	300	1
0280	FLEX	7453 SF	300	25
0281	STAIR 11	224 SF	100	3
0290	FLEX	9518 SF	300	32
0291	CORRIDOR	4303 SF	300	15
0292	IDF	282 SF	300	1
0293	MMR2A	617 SF	300	3
0294	VAULT	187 SF	300	1
0295	STAIR 03	517 SF	100	6
0296	STORAGE	803 SF	300	3
2100	DATA HALL	3613 SF	300	121
2101	DATA HALL	36304 SF	300	122
2201	RR	86 SF	100	1
2202	STORAGE	1740 SF	300	6
2203	JAN.	110 SF	300	1
2204	STORAGE	426 SF	300	2
2205	FACILITIES SHOP	706 SF	300	3
2300	CORRIDOR	1673 SF	300	56
2300	GALLERY	14507 SF	300	49
2300	CORRIDOR	1831 SF	300	62
2300	DATA HALL	46586 SF	300	156
2301	STAIR 04	461 SF	100	5
2302	CORRIDOR	754 SF	300	3
2302	STAIR 05	458 SF	100	5
2303	STAIR 06	488 SF	100	5
2304	STAIR 07	486 SF	100	5
2305	STAIR 08	224 SF	100	3
2306	STAIR 09	224 SF	100	3
2307	STAIR 10	224 SF	100	3
2400	MMR2B	606 SF	300	3
2401	BF	146 SF	300	1
2402	CORRIDOR	764 SF	300	3
2403	FREIGHT ELEV.	362 SF	300	2
2404	IDF	239 SF	300	1
2405	FIRE	207 SF	300	1
2406	SHELL	2264 SF	300	8
Level 2: 56		22567 SF		816
Level 2: 56		22567 SF		816

PARTITION RATING LEGEND

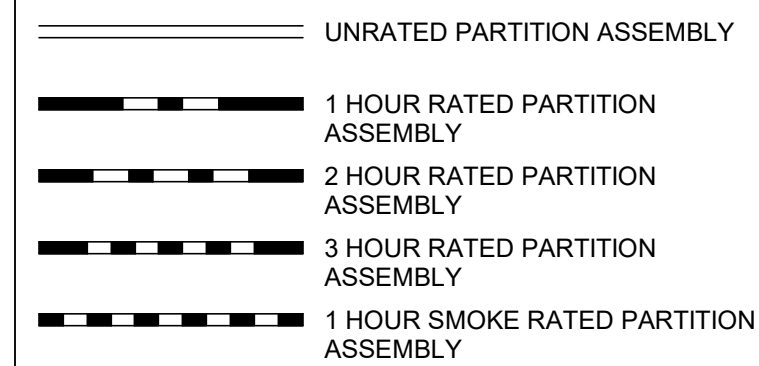

FIRE EXTINGUISHER LEGEND

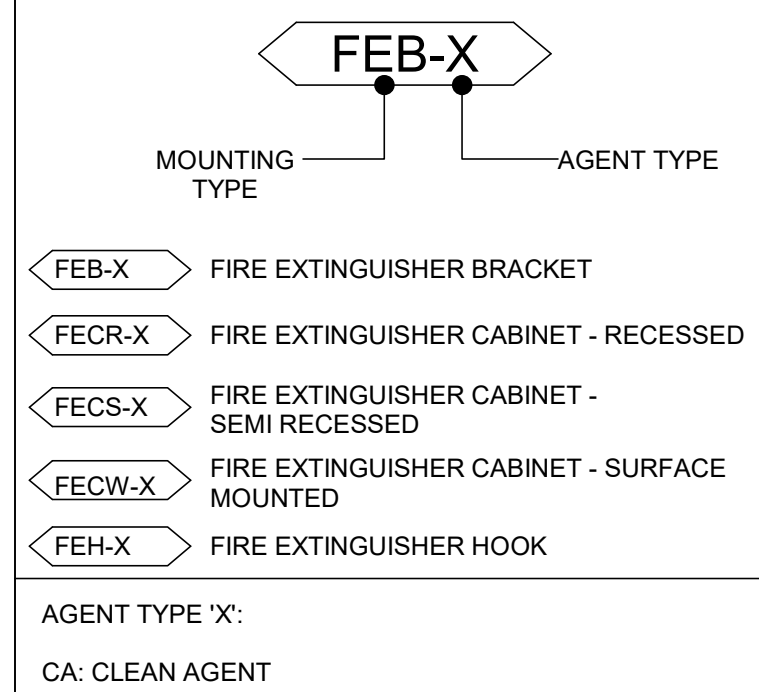

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000




SYSKA HENNESSY
GROUP



ISSUES

[illegible]

REVISIONS

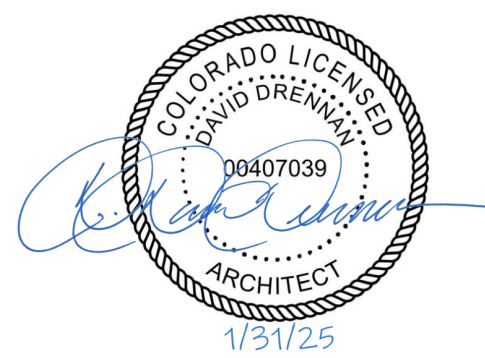

QTS DEN1 DC2

1140 N. GUN CLUB ROAD




KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B


LIFE SAFETY PLAN
- LEVEL TWO -
SEGMENT C

JOB 24464.0000
DATE 01.31.25
SHEET


G02-02C Page 17 of 58




PARTITION RATING LEGEND

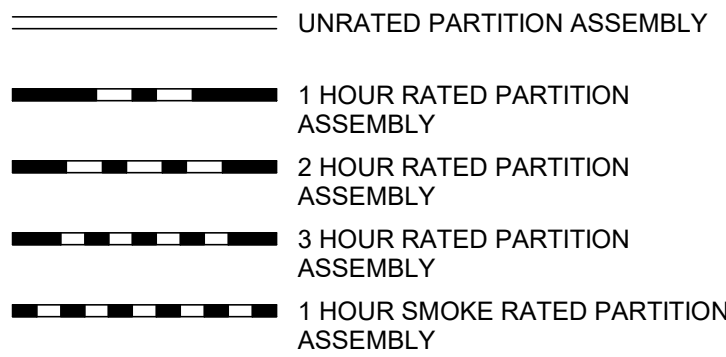

FIRE EXTINGUISHER MOUNTING LEGEND

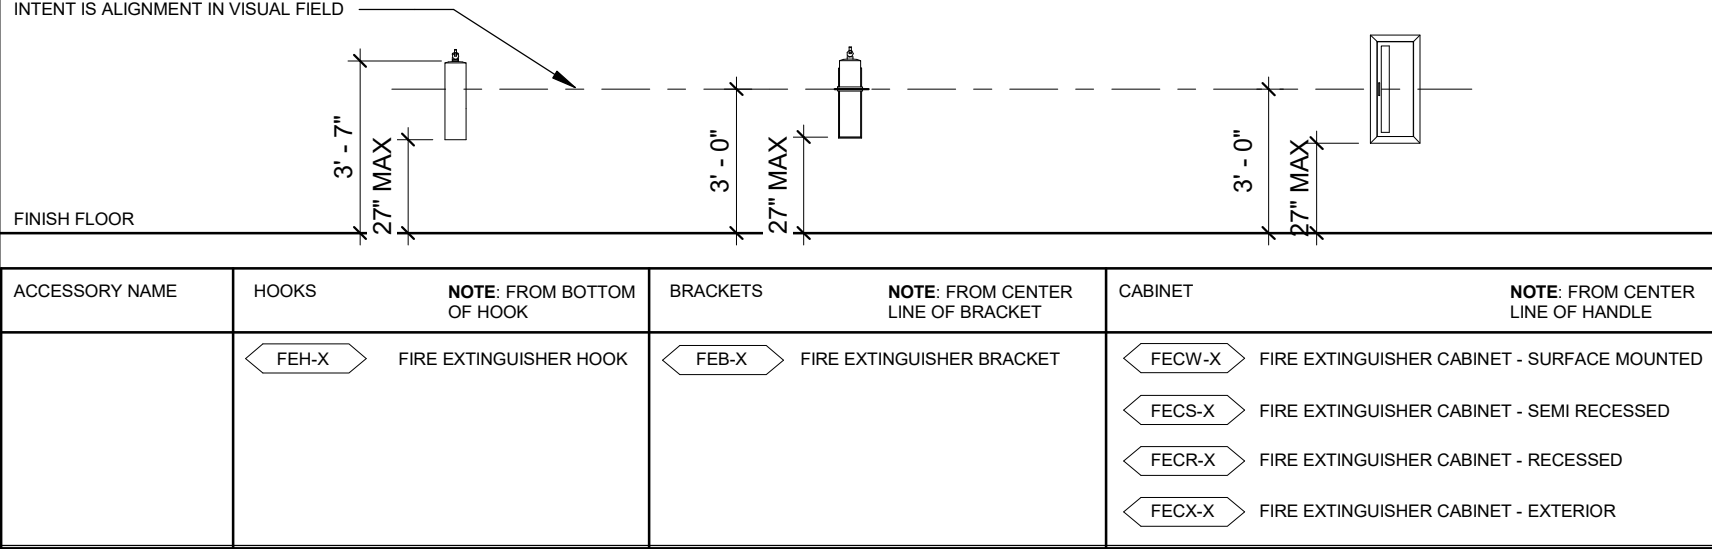

LIFE SAFETY LEGEND

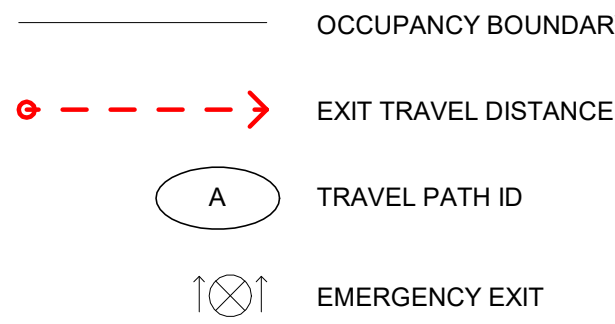


TRAVEL DISTANCES LVL 2

Travel Path ID	Travel Path Distance
2A	171' - 7"
2B	132' - 0"
2C	181' - 8"
2E	158' - 0"
2F	130' - 10"
2G	248' - 6"
2H	242' - 8"
2I	256' - 11"
2K	175' - 2"
2L	174' - 3"
2M	187' - 4"
2P	213' - 7"
2Q	239' - 7"
2R	199' - 5"
2S	268' - 6"
2T	252' - 8"
2U	43' - 2"
2V	212' - 9"
2W	99' - 2"
2X	118' - 5"
2Y	119' - 7"
2Z	88' - 11"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 2

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 2				
0206	VEST	537 SF		
0209	TENANT FLEX	5887 SF	300	20
0210	CORRIDOR	4913 SF	300	17
0211	STORAGE	163 SF	300	1
0212	PASS. ELEV.	98 SF	150	1
0213	WRR	213 SF	150	2
0214	MRR	212 SF	150	2
0217	STORAGE	2030 SF	300	7
0218	ELEC CLOSET	145 SF	300	1
0219	STAIR 02	525 SF	150	4
0220	JAN	68 SF	300	1
0260	FREIGHT ELEV.	240 SF	150	2
0261	STORAGE	1638 SF	300	6
0262	STORAGE	54 SF	300	1
0263	STAIR 01	468 SF	150	4
0264	RISER	374 SF	300	2
0265	STORAGE	424 SF	300	2
0266	ELEC ROOM	677 SF	300	3
0267	FLEX	5922 SF	300	20
0269	PRI ACTION	70 SF	300	1
0280	FLEX	7453 SF	300	25
0281	STAIR 11	224 SF	150	2
0290	FLEX	8569 SF	300	29
0291	CORRIDOR	2586 SF	300	9
0292	IDF	282 SF	300	1
0293	MMR2A	617 SF	300	3
0294	VAULT	187 SF	300	1
0295	STAIR 03	517 SF	150	4
0296	STORAGE	803 SF	300	3
0297	WATER	324 SF		
2100	DATA HALL	36131 SF	300	121
2200	DATA HALL	36311 SF	300	122
2201	RR	86 SF	150	1
2202	SHELL	1348 SF	300	5
2203	JAN.	114 SF	300	1
2204	WATER	143 SF		
2205	QTS STORAGE	1613 SF	300	6
2233	RR	55 SF		
2300	CORRIDOR	16731 SF	300	56
2300	CORRIDOR	14507 SF	300	49
2300	CORRIDOR	18313 SF	300	62
2300	DATA HALL	46586 SF	300	156
2301	STAIR 04	461 SF	150	4
2301	CORRIDOR	721 SF	300	3
2301	CORRIDOR	207 SF		
2302	STAIR 05	458 SF	150	4
2303	STAIR 06	488 SF	150	4
2304	STAIR 07	486 SF	150	4
2305	STAIR 08	224 SF	150	2
2306	STAIR 09	224 SF	150	2
2307	STAIR 10	224 SF	150	2
2400	MMR2B	606 SF	300	3
2401	EF	140 SF	300	1
2402	HOUSE ELEC.	764 SF	300	3
2403	FREIGHT ELEV.	363 SF	300	2
2404	IDF	239 SF	300	1
2405	FIRE	207 SF	300	1
2406	SHELL	2264 SF	300	8
3003	VEST	155 SF	150	2
3004	VEST	154 SF	150	2
LEVEL 2: 60		226554 SF		797
Grand total: 60		226554 SF		797

FIRE EXTINGUISHER LEGEND

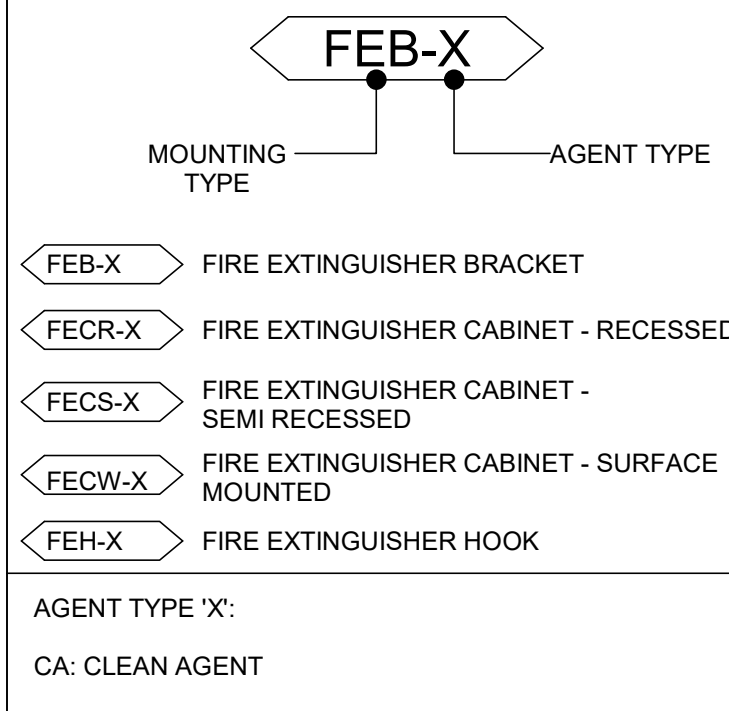

CORGAN

401 N. Houston Street Dallas, TX 75202
T: 214.748.2000

AG-E

SYSKA HENNESSY GROUP


TEC DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

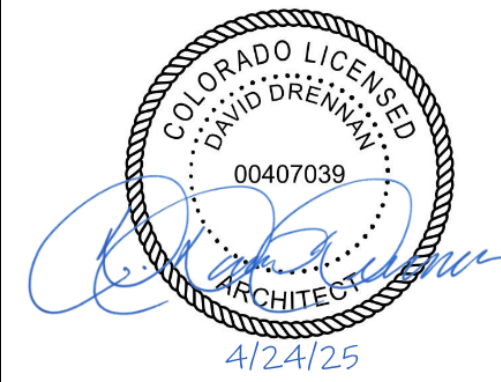

Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL TWO -
SEGMENT D

JOB 24464.0000
DATE 04.24.25
SHEET

G02-02D


[illegible]

CORGAN 

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000



כלל

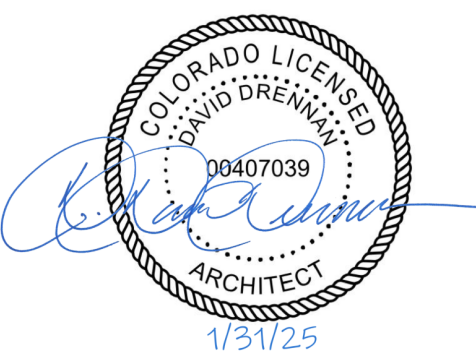[illegible]

UNRATED PARTITION ASSEMBLY

1 HOUR RATED PARTITION ASSEMBLY

2 HOUR RATED PARTITION ASSEMBLY

3 HOUR RATED PARTITION ASSEMBLY

1 HOUR SMOKE RATED PARTITION ASSEMBLY

Code	Description
FEB-X	FIRE EXTINGUISHER BRACKET
FECR-X	FIRE EXTINGUISHER CABINET - RECESSED
FECS-X	FIRE EXTINGUISHER CABINET - SEMI RECESSED
FECW-X	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
FEH-X	FIRE EXTINGUISHER HOOK

KEYPLAN


S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 01.31.25
SHEET

G02-02F

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

THIS SHEET IS FOR
REFERENCE ONLY

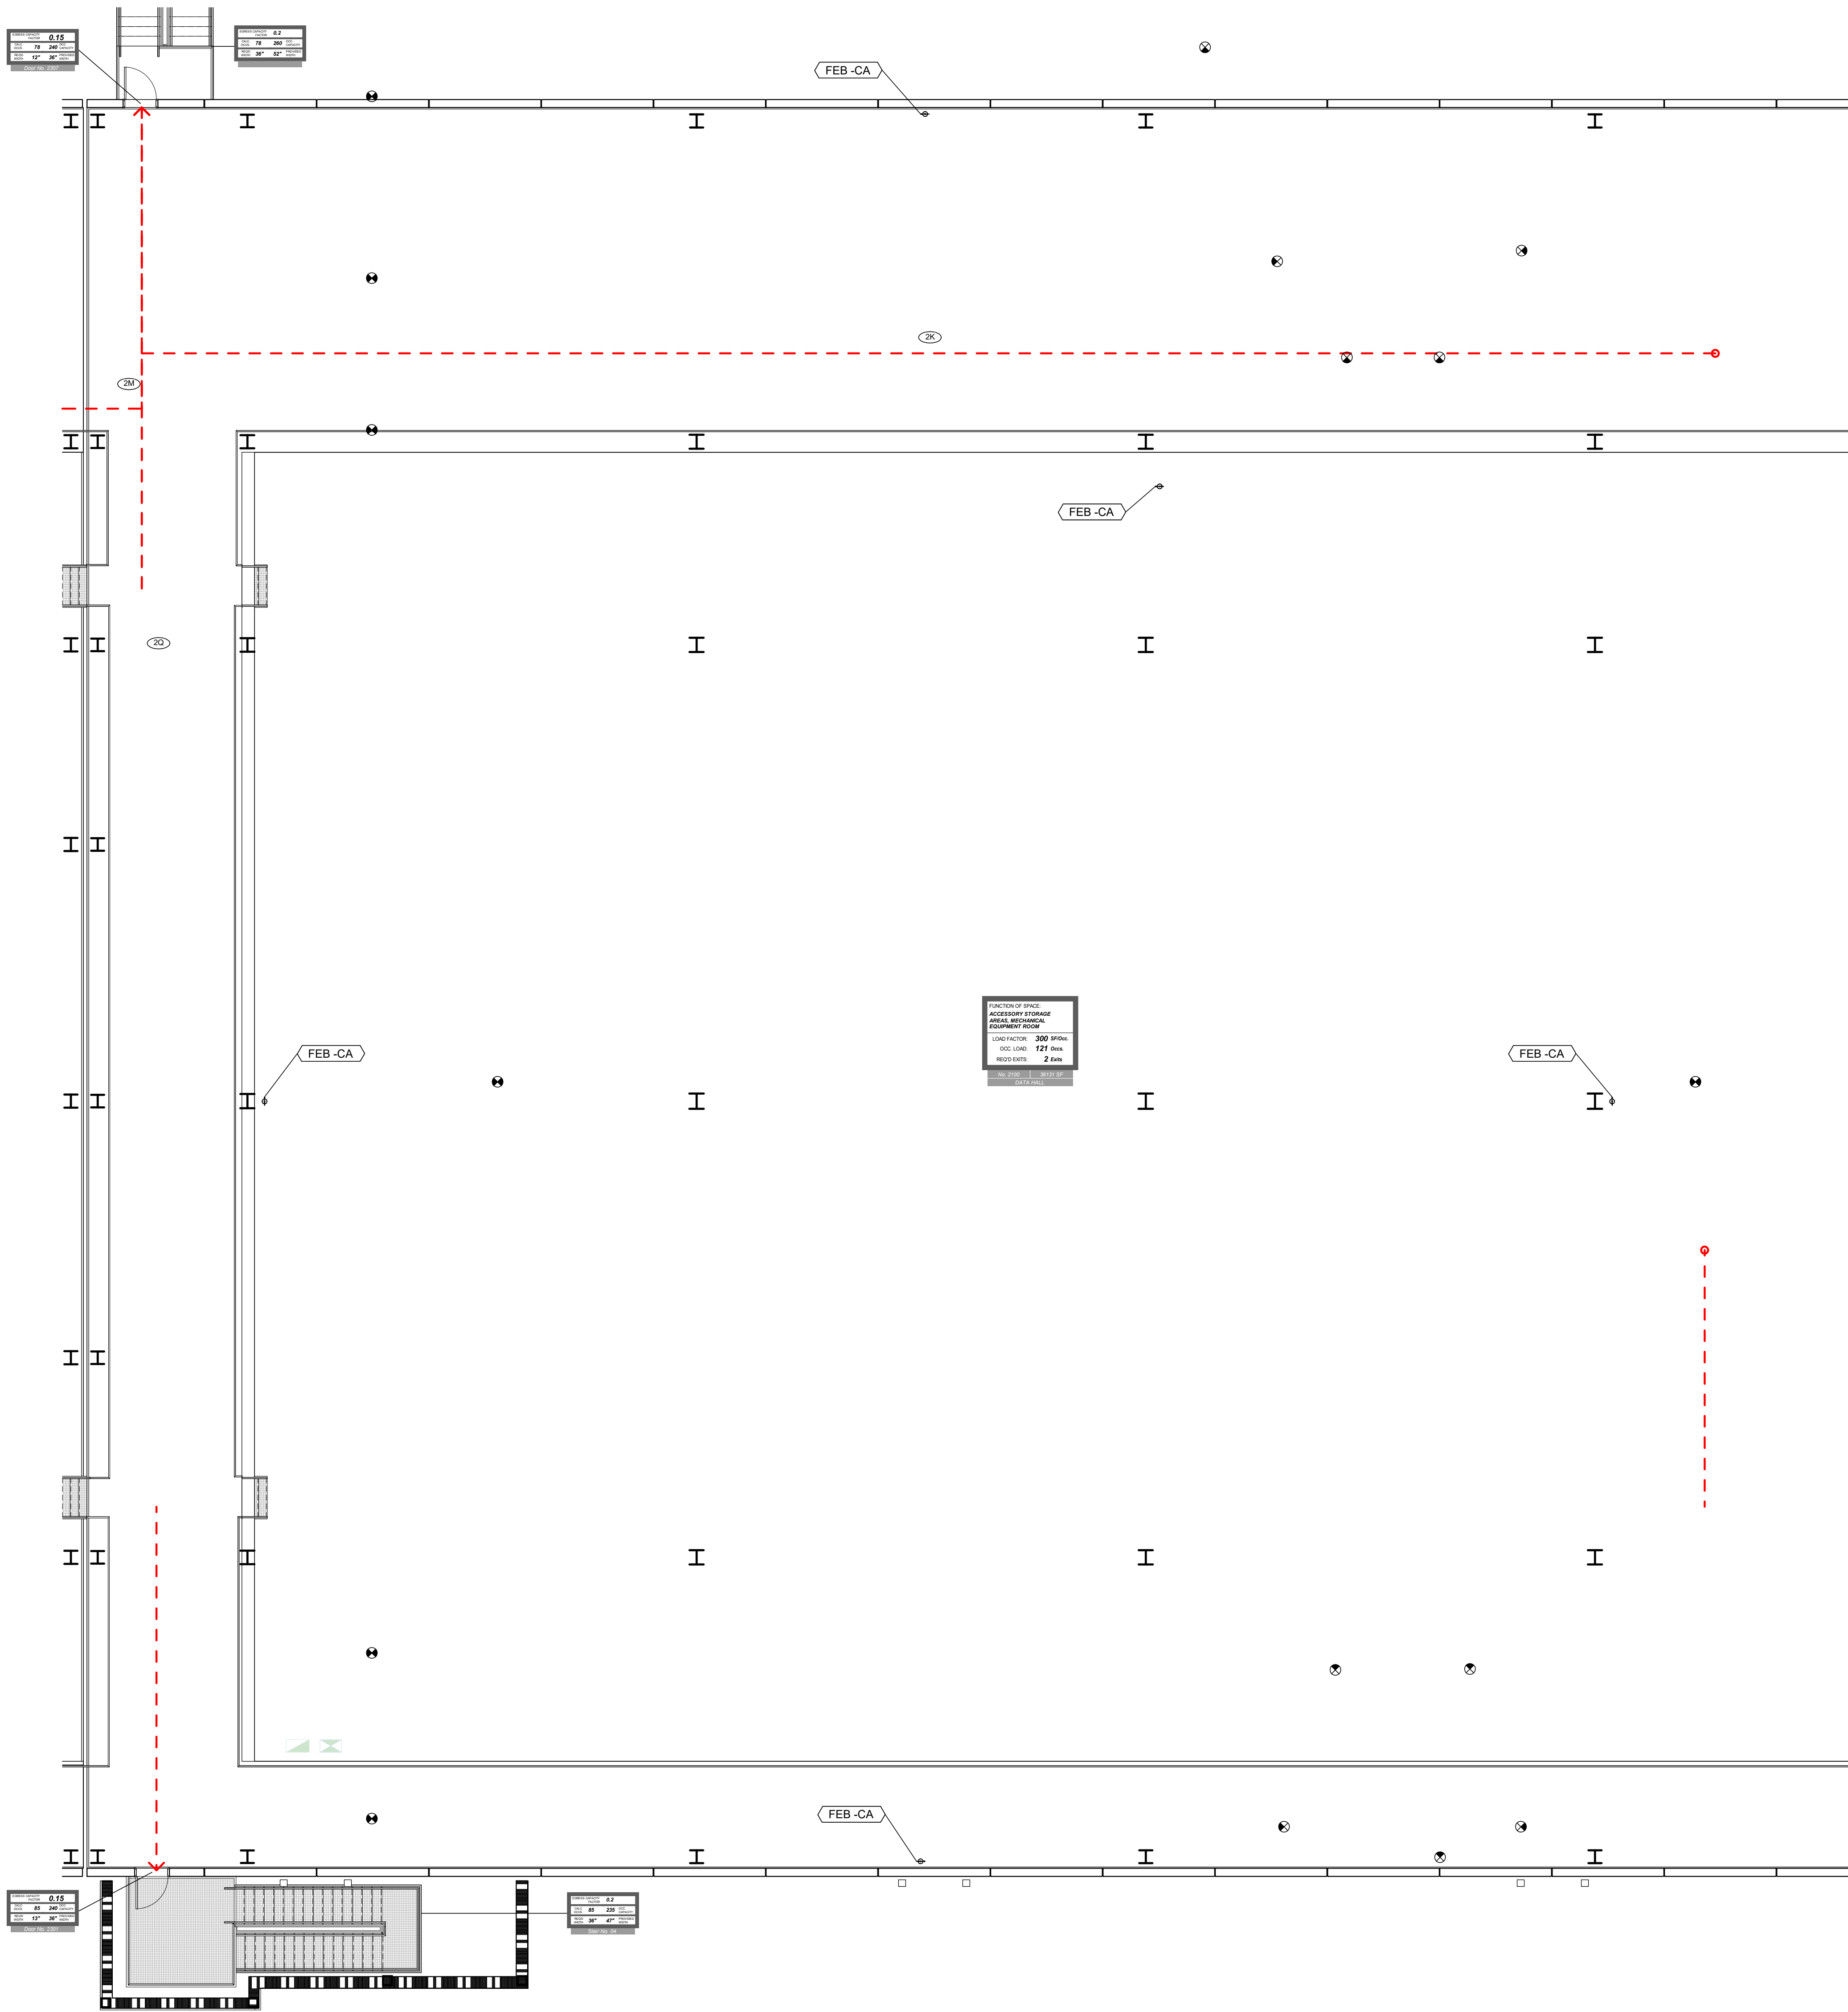

FIRE EXTINGUISHER MOUNTING LEGEND						
INTENT IS ALIGNMENT IN VISUAL FIELD						
ACCESSORY NAME	HOOKS	NOTE FROM BOTTOM OF HOOK	BRACKETS	NOTE FROM CENTER LINE OF BRACKET	CABINET	NOTE FROM CENTER LINE OF HANDLE
	FEH-X	FIRE EXTINGUISHER HOOK	FEB-X	FIRE EXTINGUISHER BRACKET	FECW-X	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
					FECR-X	FIRE EXTINGUISHER CABINET - SEMI RECESSED
					FECR-X	FIRE EXTINGUISHER CABINET - RECESSED
					FECX-X	FIRE EXTINGUISHER CABINET - EXTERIOR

LIFE SAFETY LEGEND	
	OCCUPANCY BOUNDARY
	EXIT TRAVEL DISTANCE
	TRAVEL PATH ID
	EMERGENCY EXIT

TRAVEL DISTANCES LVL 2	
Travel Path ID	Travel Path Distance
2E	114' - 6"
2F	126' - 4"
2G	101' - 0"
2H	58' - 0"
2I	259' - 4"
2J	45' - 0"
2K	170' - 2"
2L	170' - 9"
2M	189' - 8"
2N	44' - 3"
2P	60' - 2"
2Q	73' - 4"
2R	201' - 9"
2S	44' - 3"
2T	54' - 3"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 2

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 2				
0207	VEST	105 SF	100	2
0208	VEST	105 SF	100	2
0209	TENANT FLEX	5985 SF	300	20
0210	CORRIDOR	2682 SF	300	9
0211	ELEV. ROOM	183 SF	300	1
0212	PASS. ELEV.	98 SF	100	1
0213	WRR	213 SF	100	3
0214	MRR	212 SF	100	3
0217	STORAGE	2032 SF	300	7
0218	STORAGE	145 SF	300	1
0219	STAIR 02	525 SF	100	6
0220	JAN	68 SF	300	1
0260	FREIGHT ELEV.	240 SF	100	3
0261	STORAGE	1638 SF	300	6
0262	STORAGE	54 SF	300	1
0263	STAIR 01	468 SF	100	5
0264	RISER	374 SF	300	2
0265	STORAGE	424 SF	300	2
0266	STORAGE	677 SF	300	3
0267	FLEX	5942 SF	300	20
269	FIRE ACTION	70 SF	300	1
0280	FLEX	7453 SF	300	25
0281	STAIR 11	224 SF	100	3
0290	FLEX	9518 SF	300	32
0291	CORRIDOR	4303 SF	300	15
0292	IDF	282 SF	300	1
0293	MMR2A	617 SF	300	3
0294	VAULT	187 SF	300	1
0295	STAIR 03	517 SF	100	6
0296	STORAGE	803 SF	300	3
2100	DATA HALL	36131 SF	300	121
2200	DATA HALL	36403 SF	300	122
2201	RR	86 SF	100	1
2202	SHELL	1740 SF	300	6
2203	JAN	110 SF	300	1
2204	STORAGE	426 SF	300	2
2205	FACILITIES SHOP	706 SF	300	3
2300	CORRIDOR	16731 SF	300	56
2300	GALLERY	14507 SF	300	49
2300	CORRIDOR	18313 SF	300	62
2300	DATA HALL	46586 SF	300	156
2301	STAIR 04	461 SF	100	5
2301	CORRIDOR	754 SF	300	3
2302	STAIR 05	458 SF	100	5
2303	STAIR 06	486 SF	100	5
2304	STAIR 07	486 SF	100	5
2305	STAIR 08	224 SF	100	3
2306	STAIR 09	224 SF	100	3
2307	STAIR 10	224 SF	100	3
2400	MMR2B	606 SF	300	3
2401	EF	146 SF	300	1
2402	HOUSE ELEC.	764 SF	300	3
2403	FREIGHT ELEV.	362 SF	300	2
2404	IDF	239 SF	300	1
2405	FIRE	207 SF	300	1
2406	SHELL	2264 SF	300	8
LEVEL 2: 56		225679 SF		816
Grand total: 56		225679 SF		816

PARTITION RATING LEGEND	
	UNRATED PARTITION ASSEMBLY
	1 HOUR RATED PARTITION ASSEMBLY
	2 HOUR RATED PARTITION ASSEMBLY
	3 HOUR RATED PARTITION ASSEMBLY
	1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER LEGEND	
	FIRE EXTINGUISHER BRACKET
	FIRE EXTINGUISHER CABINET - RECESSED
	FIRE EXTINGUISHER CABINET - SEMI RECESSED
	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
	FIRE EXTINGUISHER HOOK
AGENT TYPE 'X': CA: CLEAN AGENT	

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E


SYSKA HENNESSY
GROUP

TEC
DESIGN CONSULTING LLC

ISSUES	
1	12.20.24 DESIGN DEVELOPMENT
2	01.31.25 ISSUE FOR PERMIT
3	05.30.25 FOUNDATIONS ONLY IFF

REVISIONS	
4	
5	
6	
7	
8	
9	
10	

REVISIONS

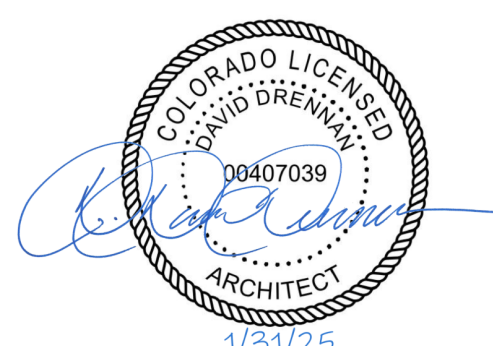

QTS DEN1 DC2
1140 N. GUN CLUB ROAD
QTS

KEYPLAN									
S	Q	N	L	J	G	E	C	A	
T	R	P	M	K	H	F	D	B	


LIFE SAFETY PLAN
- LEVEL TWO -
SEGMENT H

JOB 24464.0000
DATE 01.31.25
SHEET


G02-02H

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION


THIS SHEET IS FOR
REFERENCE ONLY

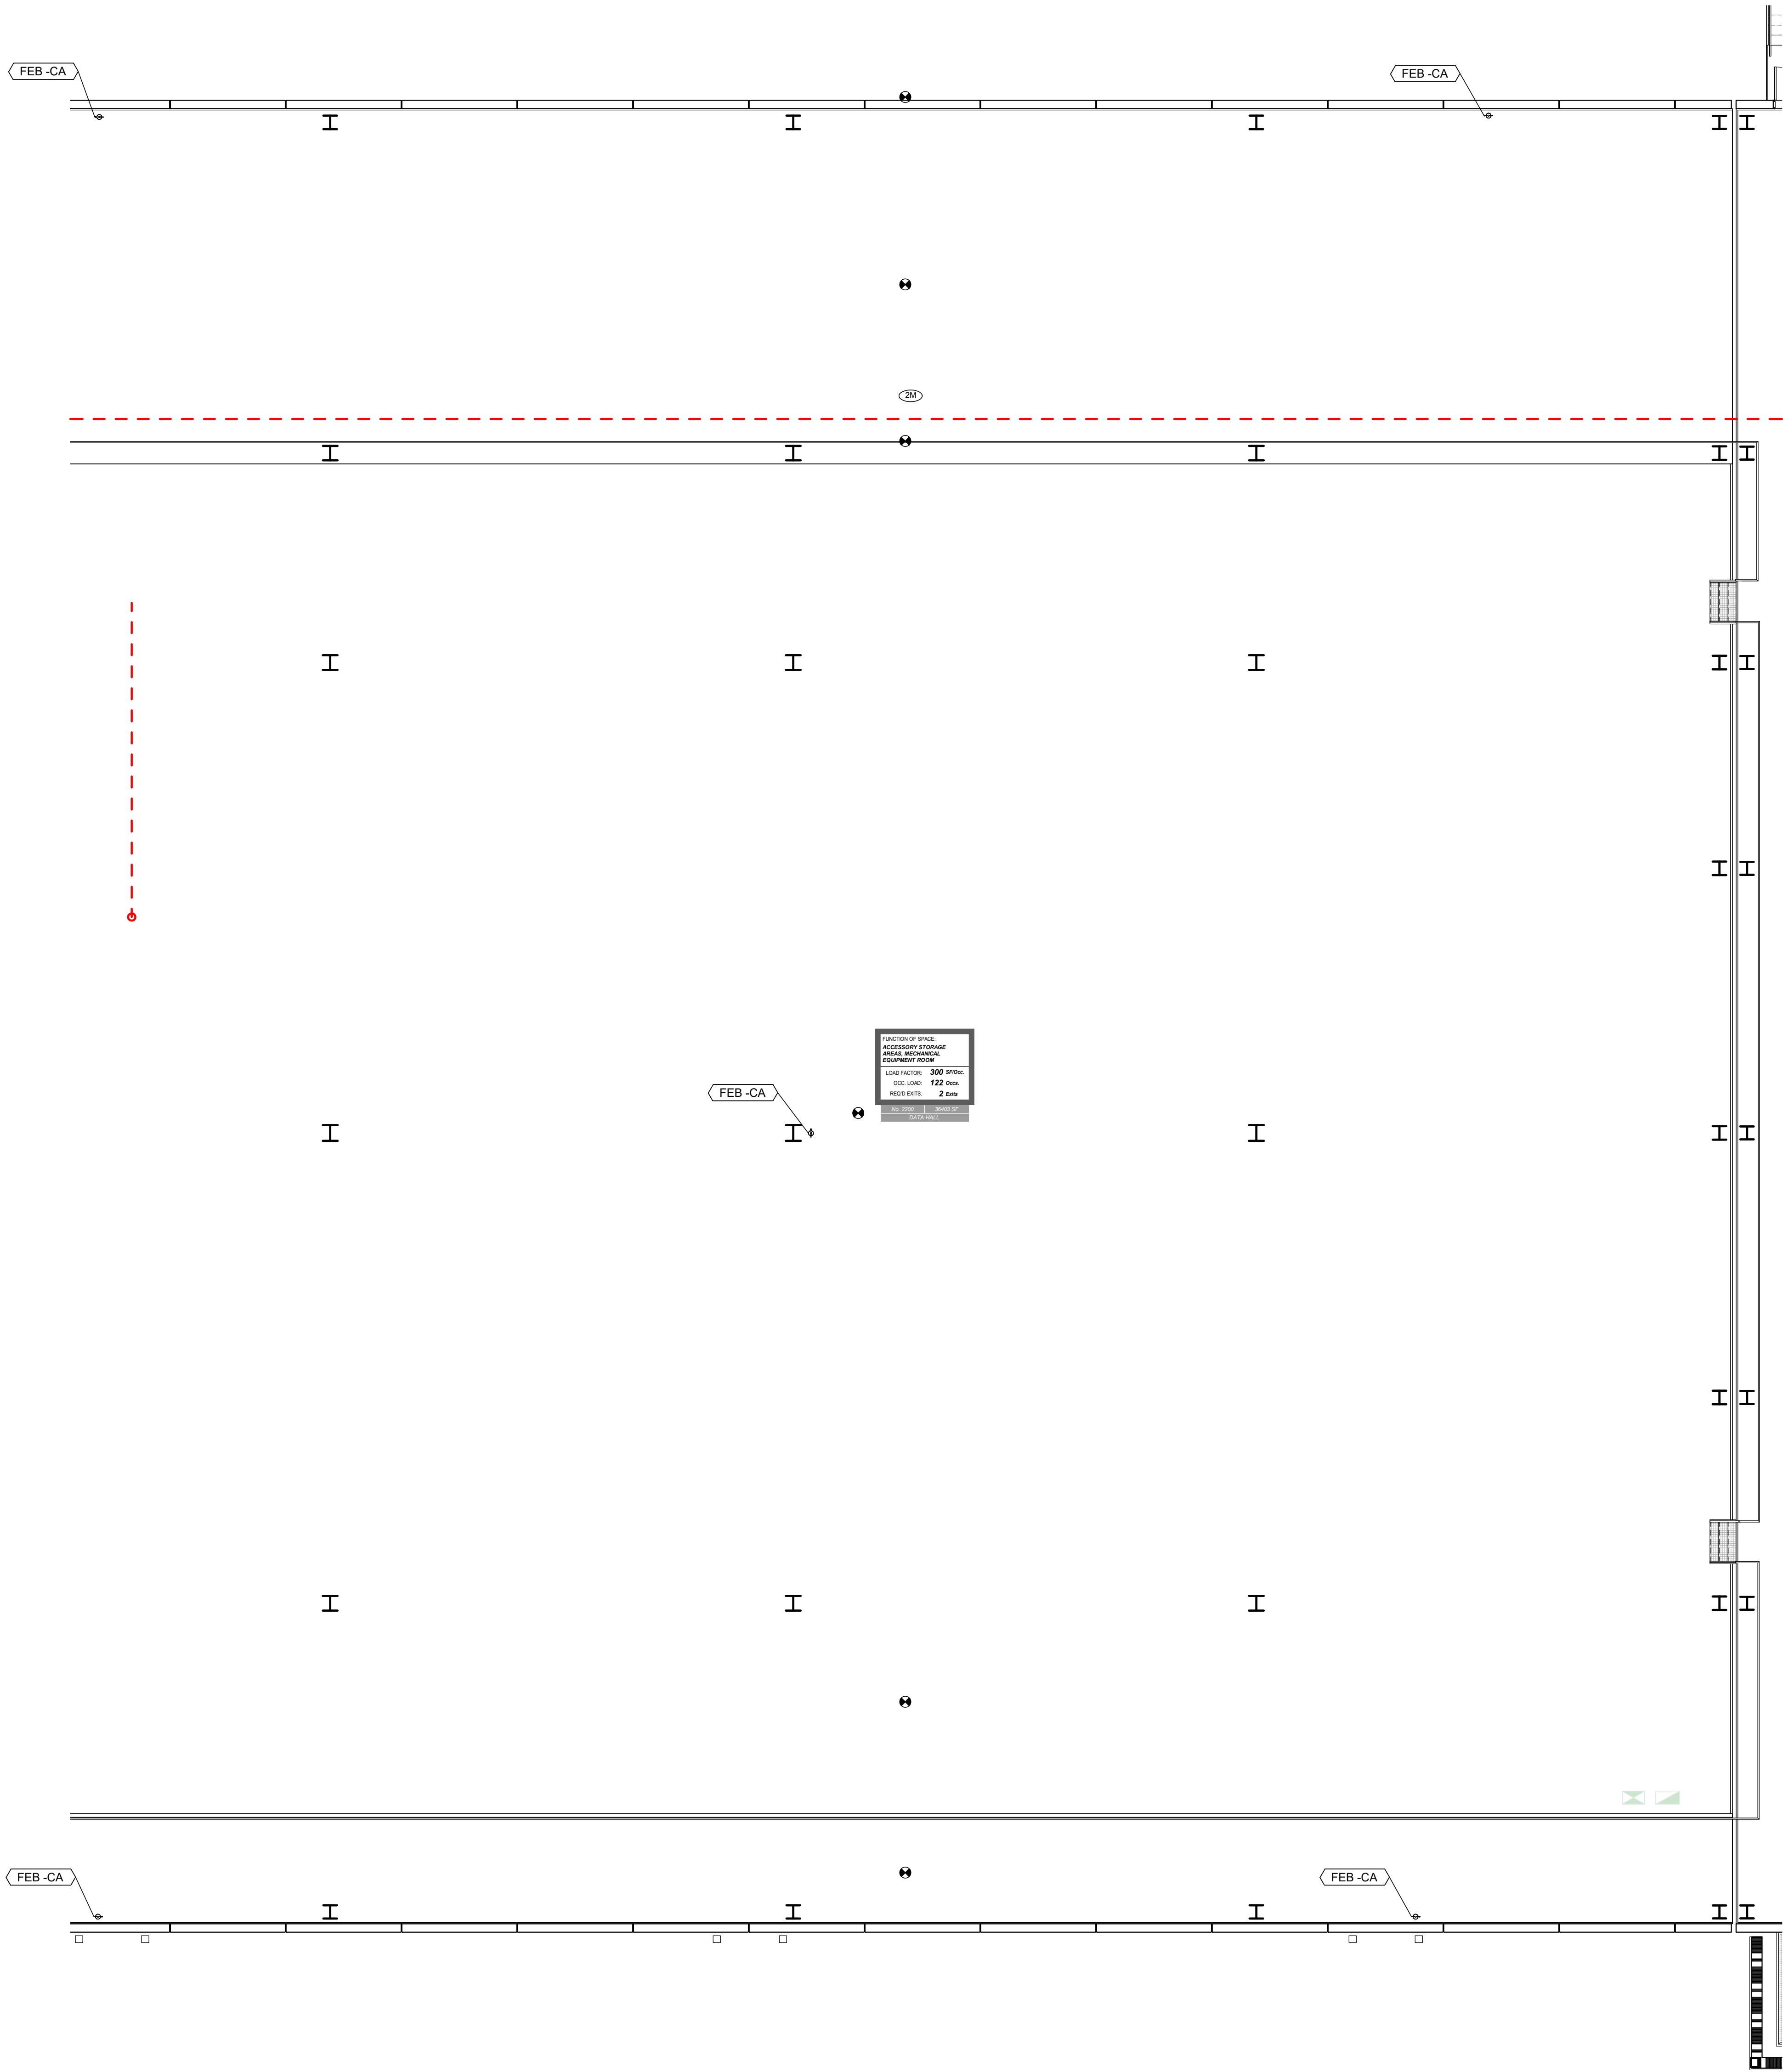

FIRE EXTINGUISHER MOUNTING LEGEND

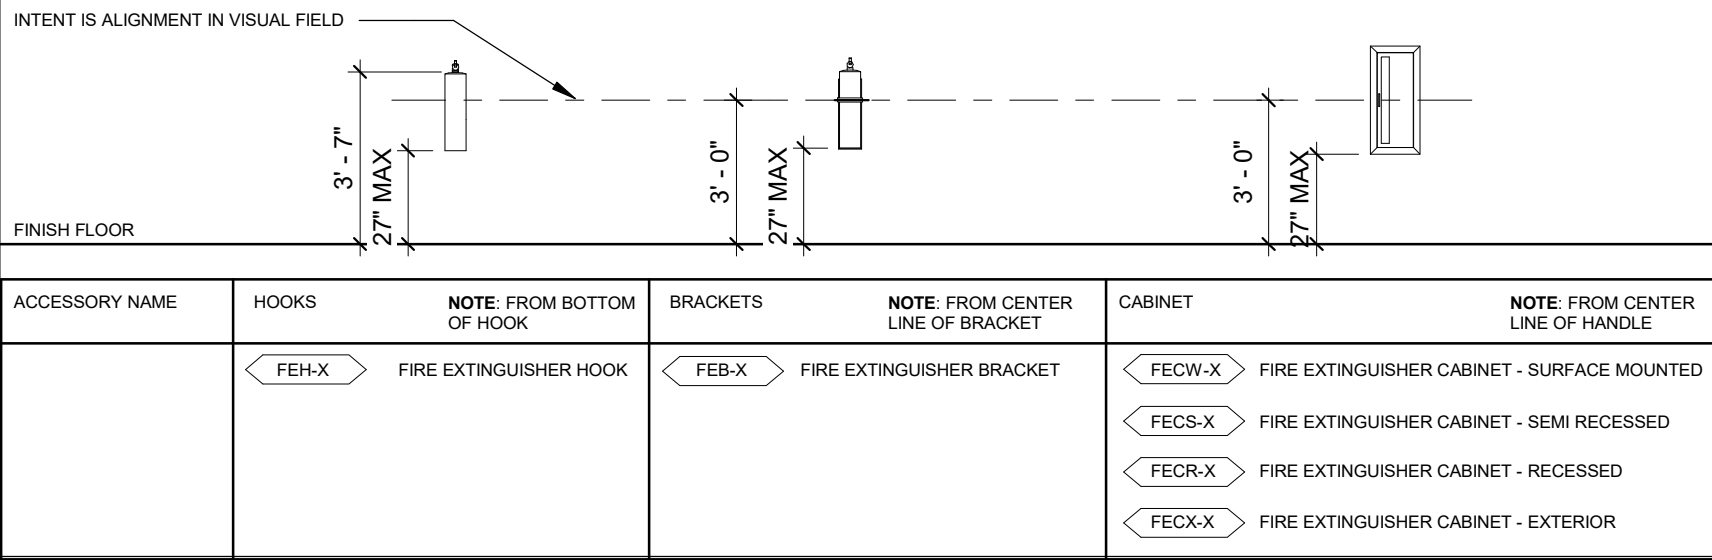

LIFE SAFETY LEGEND

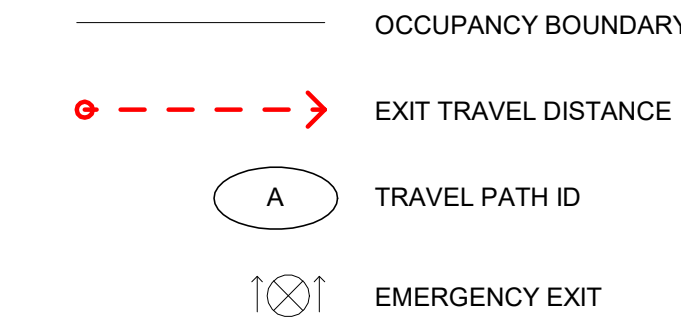


TRAVEL DISTANCES LVL 2

Travel Path ID	Travel Path Distance
2E	114' - 6"
2F	126' - 4"
2G	101' - 0"
2H	58' - 0"
2I	259' - 4"
2J	45' - 0"
2K	170' - 2"
2L	170' - 9"


OCCUPANCY SCHEDULE BY ROOM - LEVEL 2

Room Number	Room Name	Area	Calc	Calc
0207	VEST	105 SF	100	2
0208	VEST	105 SF	100	2
0209	TENANT FLEX	5895 SF	300	20
0210	CORRIDOR	2682 SF	300	9
0211	ELEV. ROOM	163 SF	300	1
0212	PASS. ELEV.	98 SF	100	1
0213	WRR	213 SF	100	3
0214	WRR	212 SF	100	3
0217	STORAGE	2032 SF	300	7
0218	STORAGE	145 SF	300	1
0219	STAIR 02	525 SF	100	6
0220	JAN	68 SF	300	1
0260	FREIGHT ELEV.	240 SF	100	3
0261	STORAGE	1638 SF	300	6
0262	STORAGE	54 SF	300	1
0263	STAIR 01	468 SF	100	5
0264	RISER	374 SF	300	2
0265	STORAGE	424 SF	300	2
0266	STORAGE	677 SF	300	3
0267	FLEX	5942 SF	300	20
269	PRE ACTION	70 SF	300	1
0280	FLEX	7453 SF	300	25
0281	STAIR 11	224 SF	100	3
0290	FLEX	9518 SF	300	32
0291	CORRIDOR	4303 SF	300	15
0292	IDF	282 SF	300	1
0293	MMR2A	817 SF	300	3
0294	Vault	187 SF	300	1
0295	STAIR 03	517 SF	100	6
0296	STORAGE	803 SF	300	3
2100	DATA HALL	36131 SF	300	121
2200	DATA HALL	36403 SF	300	122
2201	RR	86 SF	100	1
2202	SHELL	1740 SF	300	6
2203	JAN.	110 SF	300	1
2204	STORAGE	426 SF	300	2
2205	FACILITIES SHOP	706 SF	300	3
2300	CORRIDOR	16731 SF	300	56
2300	GALLERY	14507 SF	300	49
2300	CORRIDOR	18313 SF	300	62
2300	DATA HALL	46586 SF	300	156
2301	STAIR 04	461 SF	100	5
2301	CORRIDOR	754 SF	300	3
2302	STAIR 05	458 SF	100	5
2303	STAIR 06	488 SF	100	5
2304	STAIR 07	486 SF	100	5
2305	STAIR 08	224 SF	100	3
2306	STAIR 09	224 SF	100	3
2307	STAIR 10	224 SF	100	3
2400	MMR2B	606 SF	300	3
2401	EF	146 SF	300	1
2402	HOUSE ELEC.	784 SF	300	3
2403	FREIGHT ELEV.	362 SF	300	2
2404	IDF	239 SF	300	1
2405	FIRE	207 SF	300	1
2406	SHELL	2264 SF	300	8
LEVEL 2: 56		225679 SF		816
Grand total: 56		225679 SF		816

PARTITION RATING LEGEND

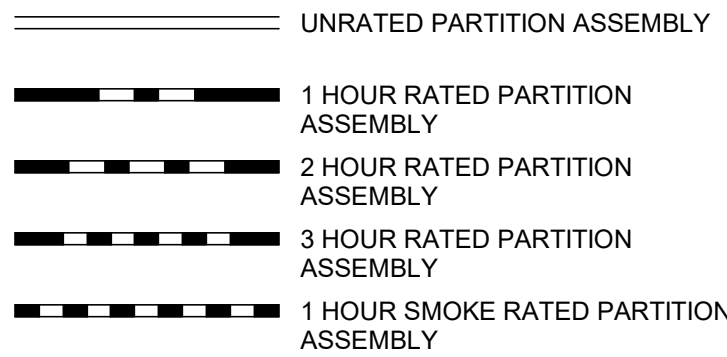

FIRE EXTINGUISHER LEGEND

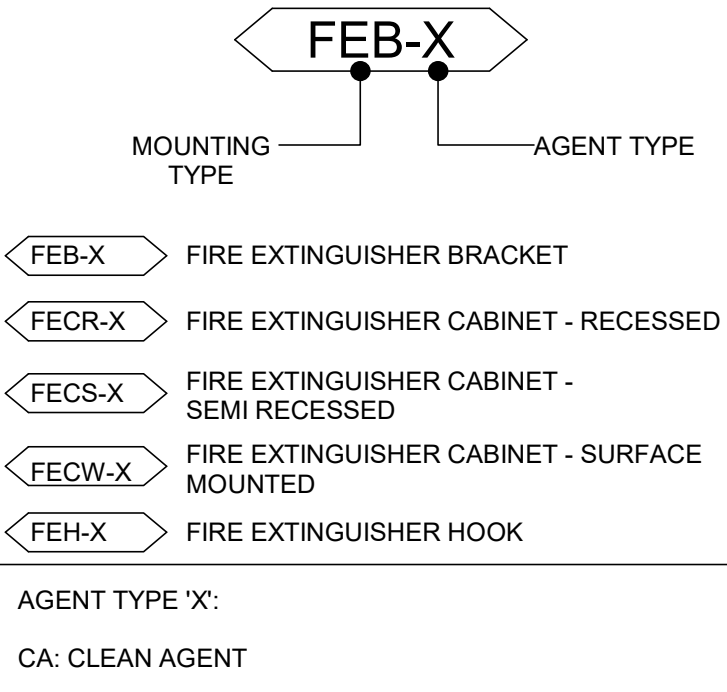

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E


SYSKA HENNESSY
GROUP

TEC
DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

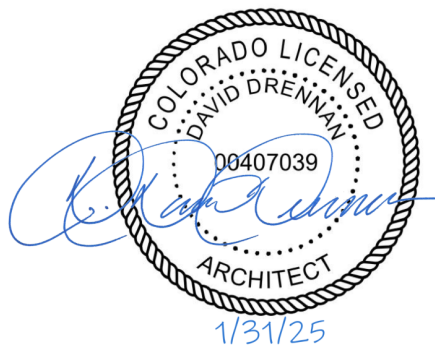

QTS DEN1 DC2

1140 N. GUN CLUB ROAD






KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL TWO -
SEGMENT K

JOB 24464.0000
DATE 01.31.25
SHEET

G02-02K

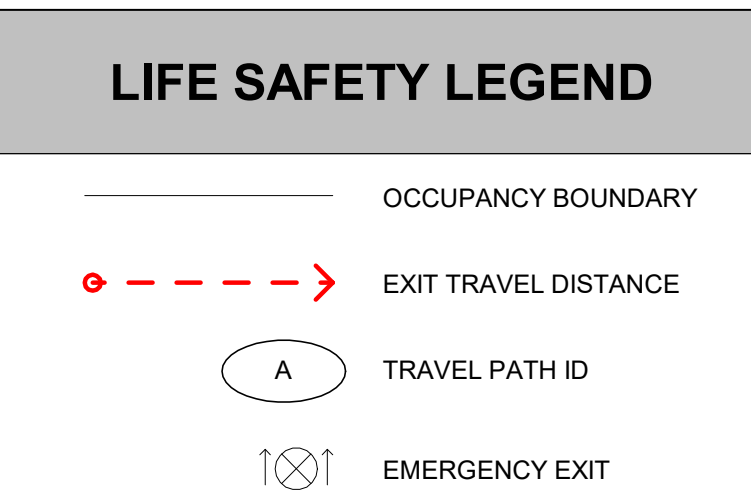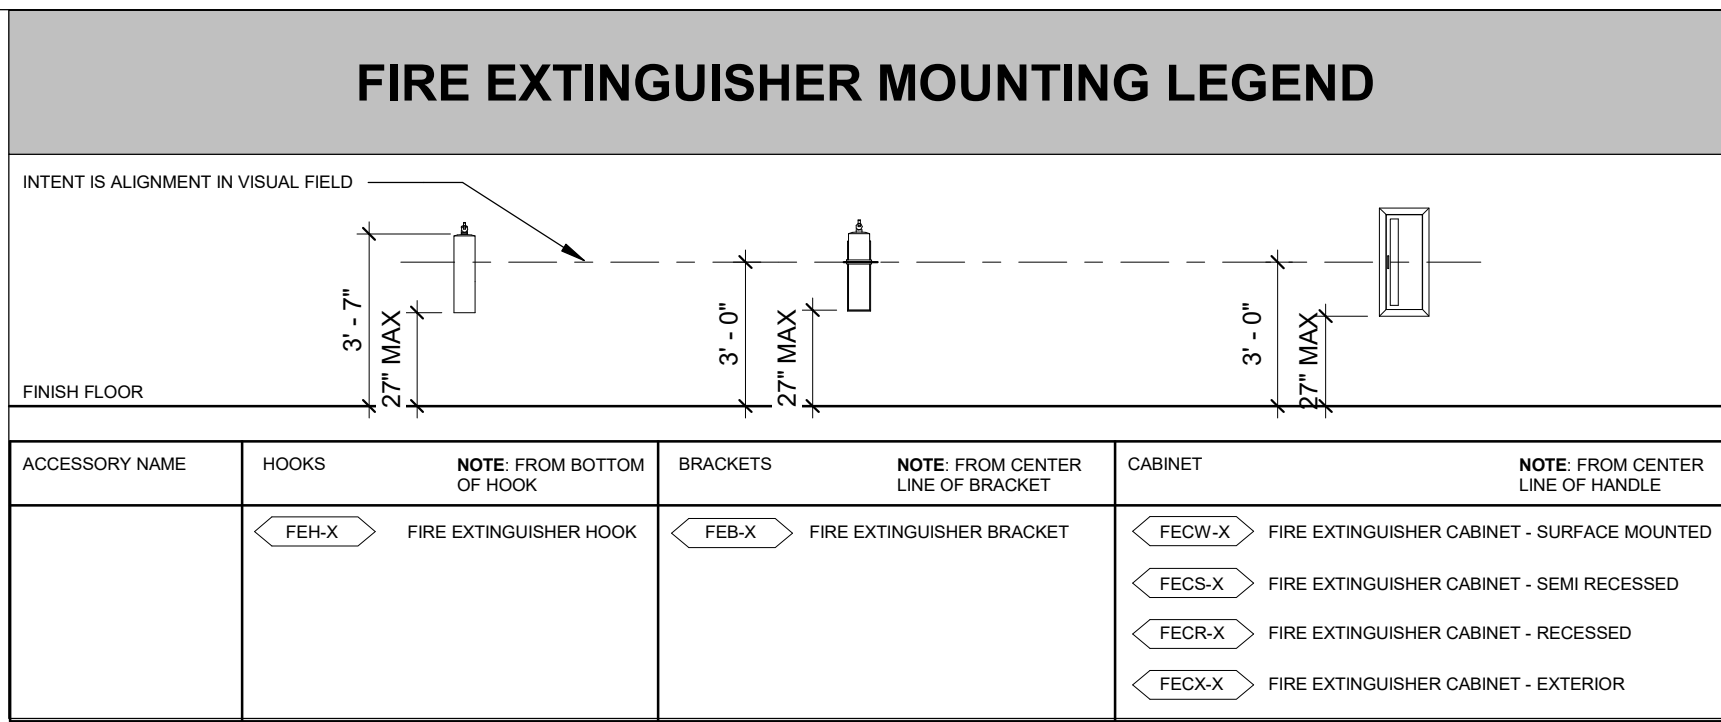
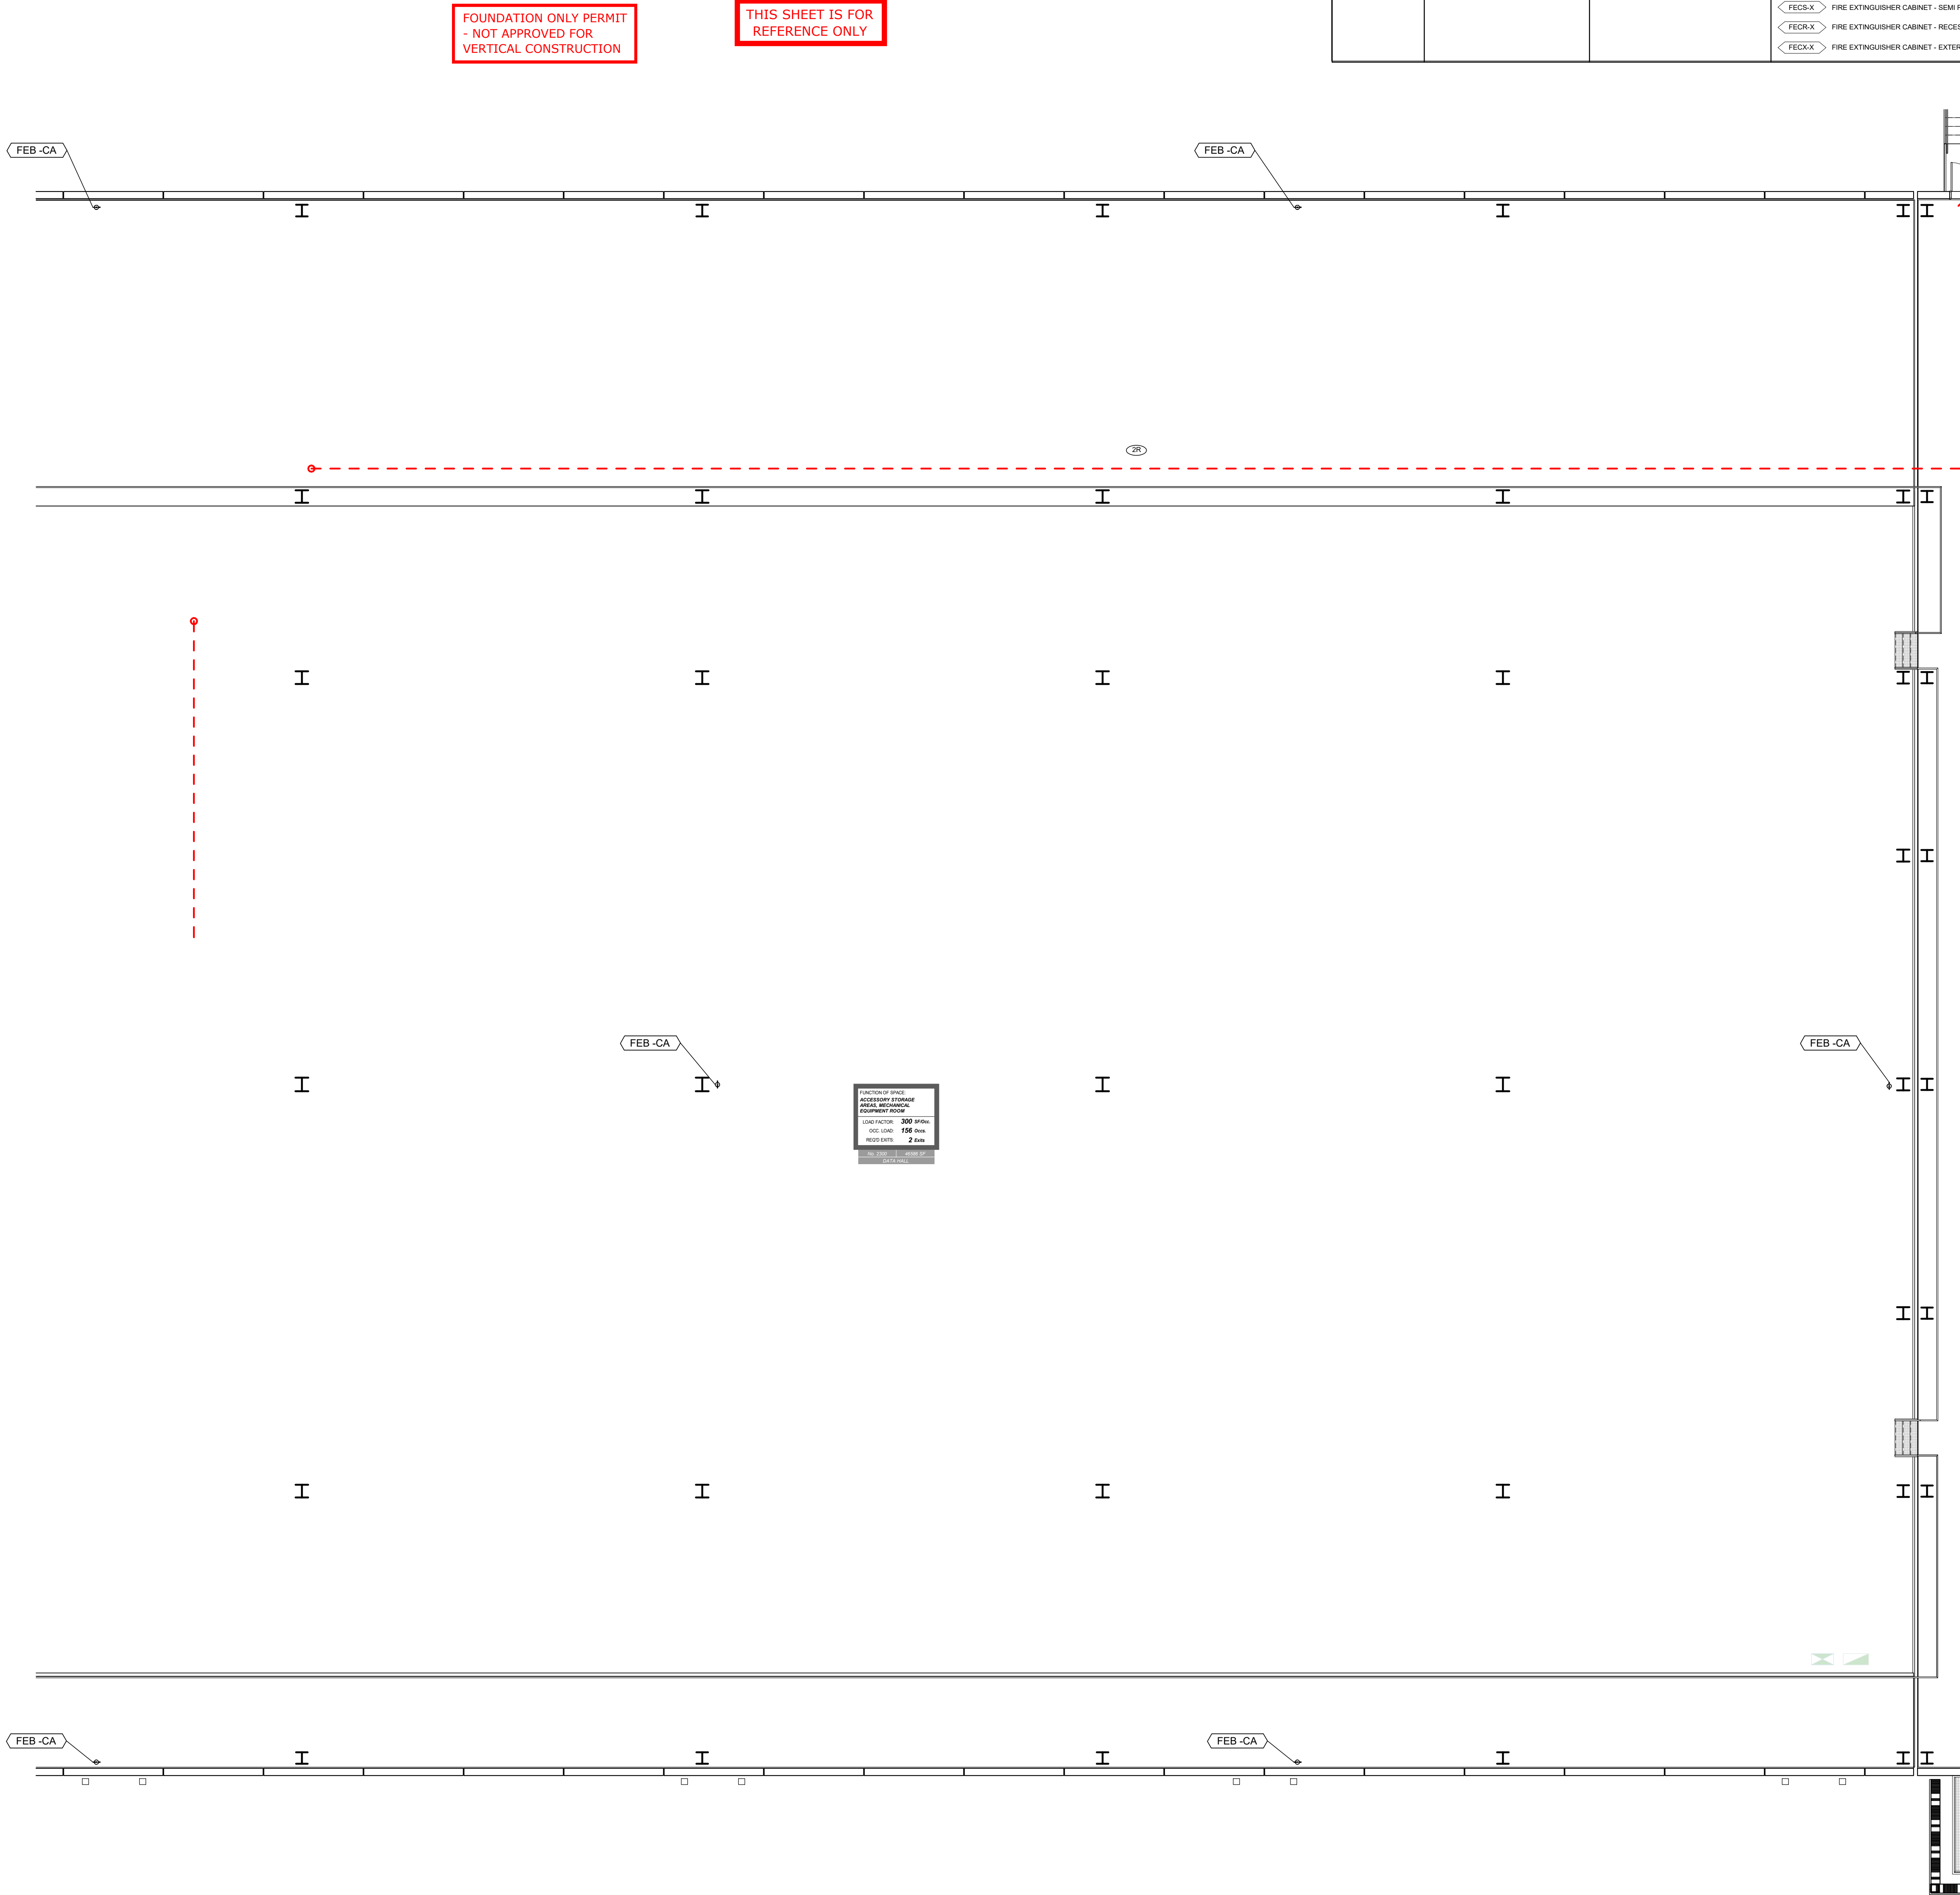


TRAVEL DISTANCES LVL 2

Travel Path ID	Travel Path Distance
2E	114' - 6"
2F	126' - 4"
2G	101' - 0"
2H	58' - 0"
2I	259' - 4"
2J	45' - 0"
2K	170' - 2"
2L	170' - 9"
2M	189' - 8"
2N	44' - 3"
2P	60' - 2"
2Q	73' - 4"
2R	201' - 9"
2S	44' - 3"
2T	54' - 3"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 2

Number	Name	Area	Occ. Load Factor	Total Occ.
LEVEL 2				
0207	VEST	105 SF	100	2
0208	VEST	105 SF	100	2
0209	TENANT FLEX	5985 SF	300	20
0210	CORRIDOR	2682 SF	300	9
0211	ELEV. ROOM	183 SF	300	1
0212	PASS. ELEV.	98 SF	100	1
0213	WRR	213 SF	100	3
0214	MRR	212 SF	100	3
0217	STORAGE	2032 SF	300	7
0218	STORAGE	145 SF	300	1
0219	STAIR 02	525 SF	100	6
0220	JAN	68 SF	300	1
0260	FREIGHT ELEV.	240 SF	100	3
0261	STORAGE	1638 SF	300	6
0262	STORAGE	54 SF	300	1
0263	STAIR 01	468 SF	100	5
0264	RISER	374 SF	300	2
0265	STORAGE	424 SF	300	2
0266	STORAGE	677 SF	300	3
0267	FLEX	5942 SF	300	20
269	FIRE ACTION	70 SF	300	1
0280	FLEX	7453 SF	300	25
0281	STAIR 11	224 SF	100	3
0290	FLEX	9518 SF	300	32
0291	CORRIDOR	4303 SF	300	15
0292	IDF	282 SF	300	1
0293	MMR2A	617 SF	300	3
0294	VAULT	187 SF	300	1
0295	STAIR 03	517 SF	100	6
0296	STORAGE	803 SF	300	3
2100	DATA HALL	36131 SF	300	121
2200	DATA HALL	36403 SF	300	122
2201	RR	86 SF	100	1
2202	SHELL	1740 SF	300	6
2203	JAN.	110 SF	300	1
2204	STORAGE	426 SF	300	2
2205	FACILITIES SHOP	706 SF	300	3
2300	CORRIDOR	16731 SF	300	56
2300	GALLERY	14507 SF	300	49
2300	CORRIDOR	18313 SF	300	62
2300	DATA HALL	46586 SF	300	156
2301	STAIR 04	461 SF	100	5
2301	CORRIDOR	754 SF	300	3
2302	STAIR 05	458 SF	100	5
2303	STAIR 06	488 SF	100	5
2304	STAIR 07	488 SF	100	5
2305	STAIR 08	224 SF	100	3
2306	STAIR 09	224 SF	100	3
2307	STAIR 10	224 SF	100	3
2400	MMR2B	606 SF	300	3
2401	EF	146 SF	300	1
2402	HOUSE ELEC.	764 SF	300	3
2403	FREIGHT ELEV.	362 SF	300	2
2404	IDF	239 SF	300	1
2405	FIRE	207 SF	300	1
2406	SHELL	2264 SF	300	8
LEVEL 2: 56		225679 SF		816
Grand total: 56		225679 SF		816

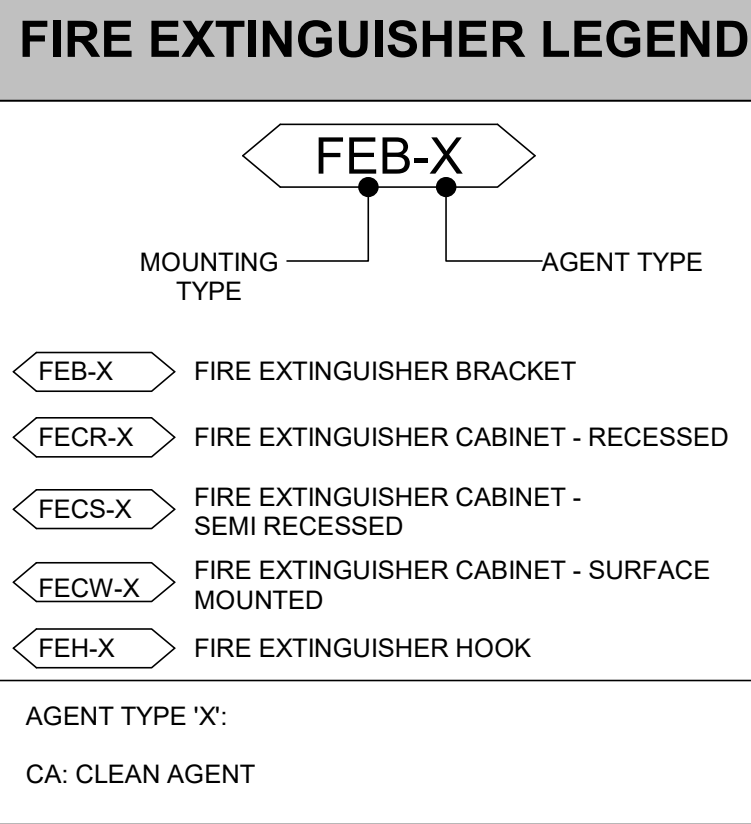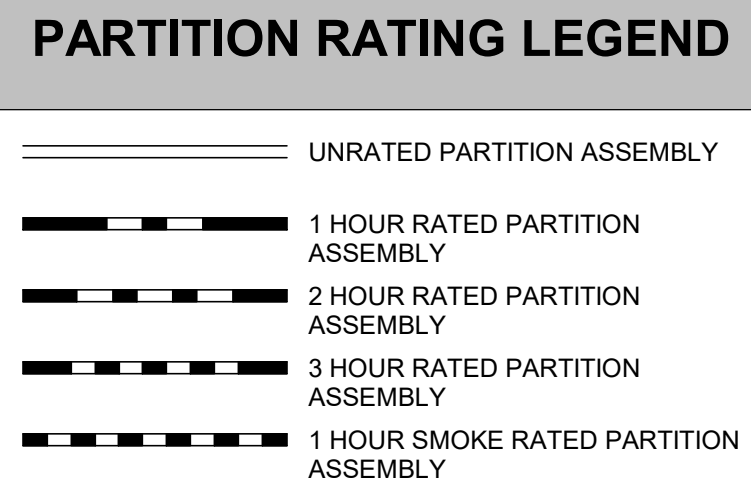

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP


TEC
DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

4		
5		
6		
7		
8		
9		
10		

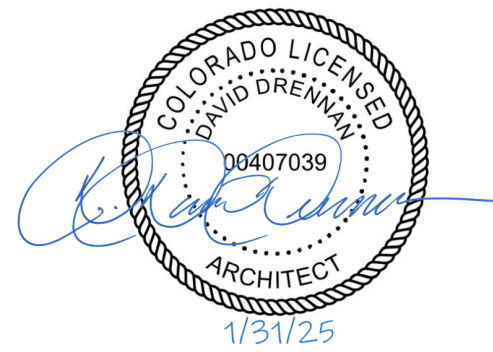

QTS DEN1 DC2
1140 N. GUN CLUB ROAD
QTS

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

LIFE SAFETY PLAN
- LEVEL TWO -
SEGMENT P

JOB 24464.0000
DATE 01.31.25
SHEET

G02-02P

PARTITION RATING LEGEND

	UNRATED PARTITION ASSEMBLY
	1 HOUR RATED PARTITION ASSEMBLY
	2 HOUR RATED PARTITION ASSEMBLY
	3 HOUR RATED PARTITION ASSEMBLY
	1 HOUR SMOKE RATED PARTITION ASSEMBLY

FIRE EXTINGUISHER MOUNTING LEGEND

INTENT IS ALIGNMENT IN VISUAL FIELD						
FINISH FLOOR						
ACCESSORY NAME	HOOXS	NOTE FROM BOTTOM OF HOOK	BRACKETS	NOTE FROM CENTER LINE OF BRACKET	CABINET	NOTE FROM CENTER LINE OF HANDLE
	FEH-X	FIRE EXTINGUISHER HOOK	FEB-X	FIRE EXTINGUISHER BRACKET	FECH-X	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
					FECS-X	FIRE EXTINGUISHER CABINET - SEMI RECESSED
					FECS-X	FIRE EXTINGUISHER CABINET - RECESSED
					FECS-X	FIRE EXTINGUISHER CABINET - EXTERIOR

LIFE SAFETY LEGEND

	OCCUPANCY BOUNDARY
	EXIT TRAVEL DISTANCE
	TRAVEL PATH ID
	EMERGENCY EXIT

TRAVEL DISTANCES LVL 2

Travel Path ID	Travel Path Distance
2A	171' - 7"
2B	132' - 0"
2C	181' - 8"
2E	158' - 0"
2F	139' - 10"
2G	248' - 6"
2H	242' - 8"
2I	256' - 11"
2K	175' - 2"
2L	174' - 3"
2M	187' - 4"
2P	213' - 7"
2Q	239' - 7"
2R	199' - 5"
2S	268' - 6"
2T	252' - 8"
2U	43' - 2"
2V	212' - 9"
2W	99' - 2"
2X	118' - 5"
2Y	119' - 7"
2Z	88' - 11"

OCCUPANCY SCHEDULE BY ROOM - LEVEL 2

Number	Name	Area	Occ. Load Factor	Total Occ.
			Calc	Calc
LEVEL 2				
0206	VEST	537 SF		
0209	TENANT FLEX	5887 SF	300	20
0210	CORRIDOR	4913 SF	300	17
0211	STORAGE	163 SF	300	1
0212	PASS. ELEV.	98 SF	150	1
0213	WRR	213 SF	150	2
0214	MRR	212 SF	150	2
0217	STORAGE	2030 SF	300	7
0218	ELEC CLOSET	145 SF	300	1
0219	STAIR 02	525 SF	150	4
0220	JAN	68 SF	300	1
0260	FREIGHT ELEV.	240 SF	150	2
0261	STORAGE	1638 SF	300	6
0262	STORAGE	54 SF	300	1
0263	STAIR 01	469 SF	150	4
0264	RISER	374 SF	300	2
0265	STORAGE	424 SF	300	2
0266	ELEC ROOM	677 SF	300	3
0267	FLEX	5822 SF	300	20
0269	PRE ACTION	70 SF	300	1
0280	FLEX	7453 SF	300	25
0281	STAIR 11	224 SF	150	2
0290	FLEX	8569 SF	300	29
0291	CORRIDOR	2586 SF	300	9
0292	IDF	282 SF	300	1
0293	MMR2A	617 SF	300	3
0294	VAULT	187 SF	300	1
0295	STAIR 03	517 SF	150	4
0296	STORAGE	803 SF	300	3
0297	WATER	324 SF		
2100	DATA HALL	36131 SF	300	121
2200	DATA HALL	36311 SF	300	122
2201	RR	86 SF	150	1
2202	SHELL	1348 SF	300	5
2203	JAN.	114 SF	300	1
2204	WATER	143 SF		
2205	QTS STORAGE	1613 SF	300	6
2233	RR	55 SF		
2300	CORRIDOR	16731 SF	300	56
2300	CORRIDOR	14507 SF	300	49
2300	CORRIDOR	18313 SF	300	62
2300	DATA HALL	46586 SF	300	156
2301	STAIR 04	461 SF	150	4
2301	CORRIDOR	721 SF	300	3
2301	CORRIDOR	207 SF		
2302	STAIR 05	458 SF	150	4
2303	STAIR 06	488 SF	150	4
2304	STAIR 07	486 SF	150	4
2305	STAIR 08	224 SF	150	2
2306	STAIR 09	224 SF	150	2
2307	STAIR 10	224 SF	150	2
2400	MMR2B	606 SF	300	3
2401	EF	140 SF	300	1
2402	HOUSE ELEC.	764 SF	300	3
2403	FREIGHT ELEV.	363 SF	300	2
2404	IDF	239 SF	300	1
2405	FIRE	207 SF	300	1
2406	SHELL	2264 SF	300	8
3003	VEST	155 SF	150	2
3004	VEST	154 SF	150	2
LEVEL 2: 60		226554 SF		797
Grand total: 60		226554 SF		797

FIRE EXTINGUISHER LEGEND

	FIRE EXTINGUISHER BRACKET
	FIRE EXTINGUISHER CABINET - RECESSED
	FIRE EXTINGUISHER CABINET - SEMI RECESSED
	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED
	FIRE EXTINGUISHER HOOK
AGENT TYPE 'X': CA: CLEAN AGENT	

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP


TD
DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

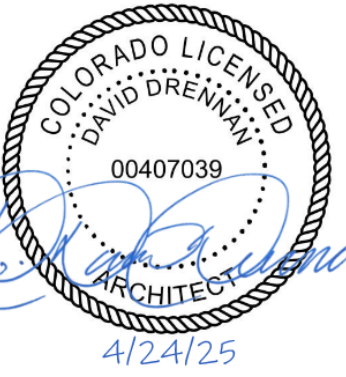

Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B


LIFE SAFETY PLAN
- LEVEL TWO -
SEGMENT S & T

JOB 24464.0000
DATE 04.24.25
SHEET


G02-02ST

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION


THIS SHEET IS FOR
REFERENCE ONLY

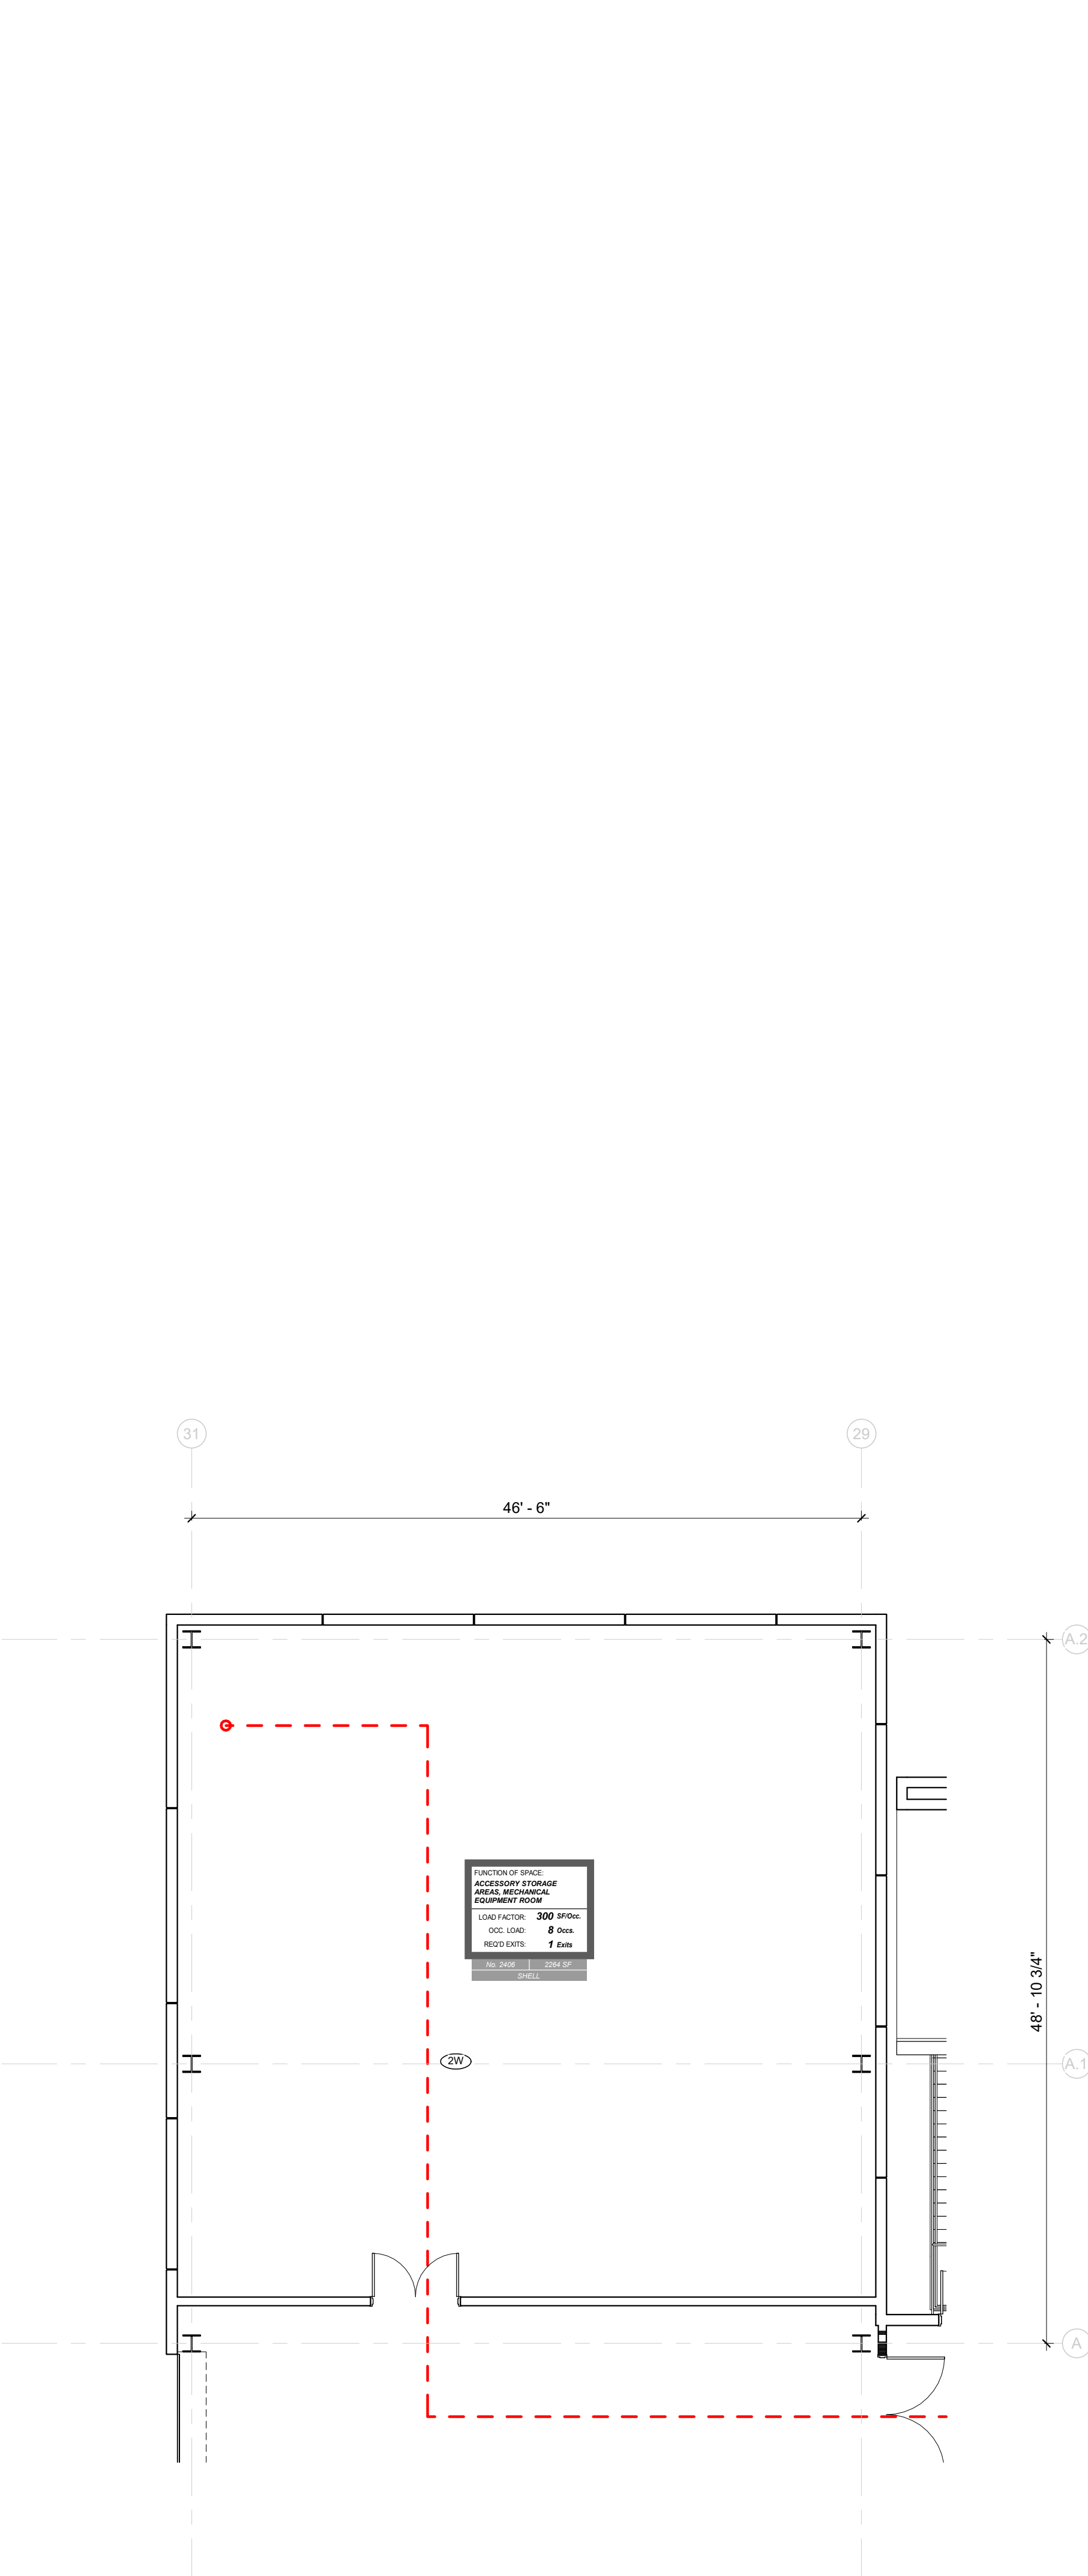

2 LIFE SAFETY PLAN - LEVEL TWO - SEGMENT Q
1/8" = 1'-0"

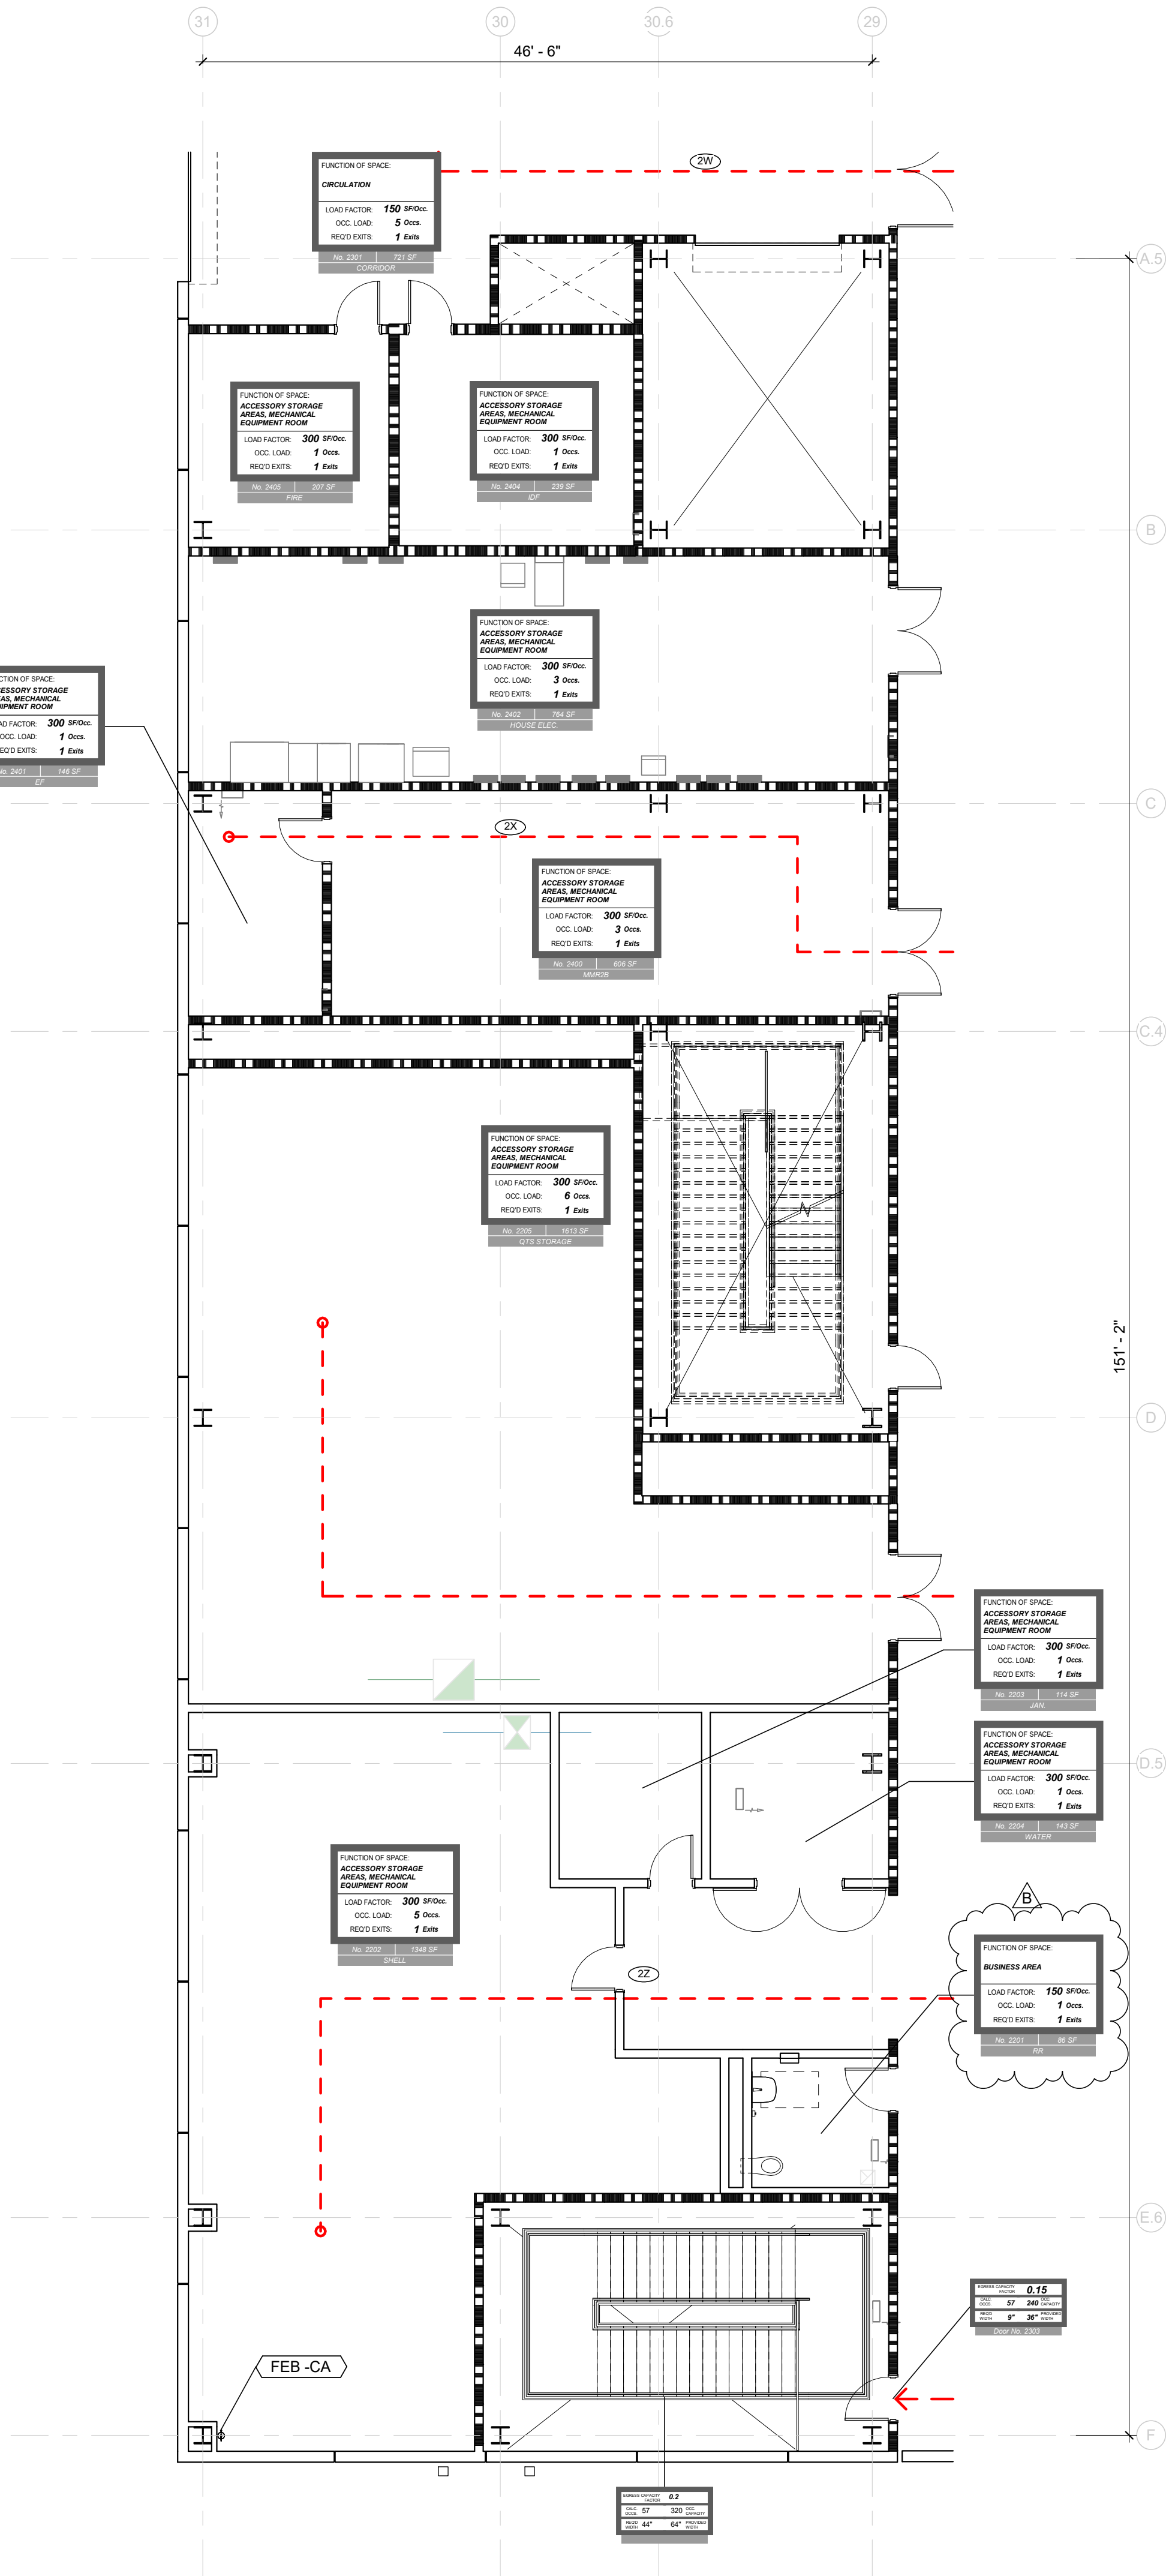

1 LIFE SAFETY PLAN - LEVEL TWO - SEGMENT R
1/8" = 1'-0"

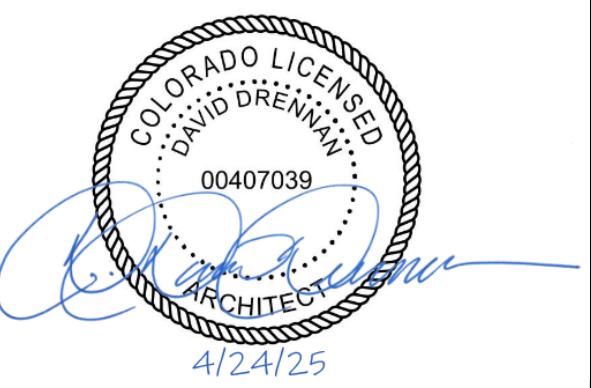[illegible]


Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

CAMPUS SITE PLAN

JOB 24464.0000
DATE 04.24.25
SHEET

A01-00

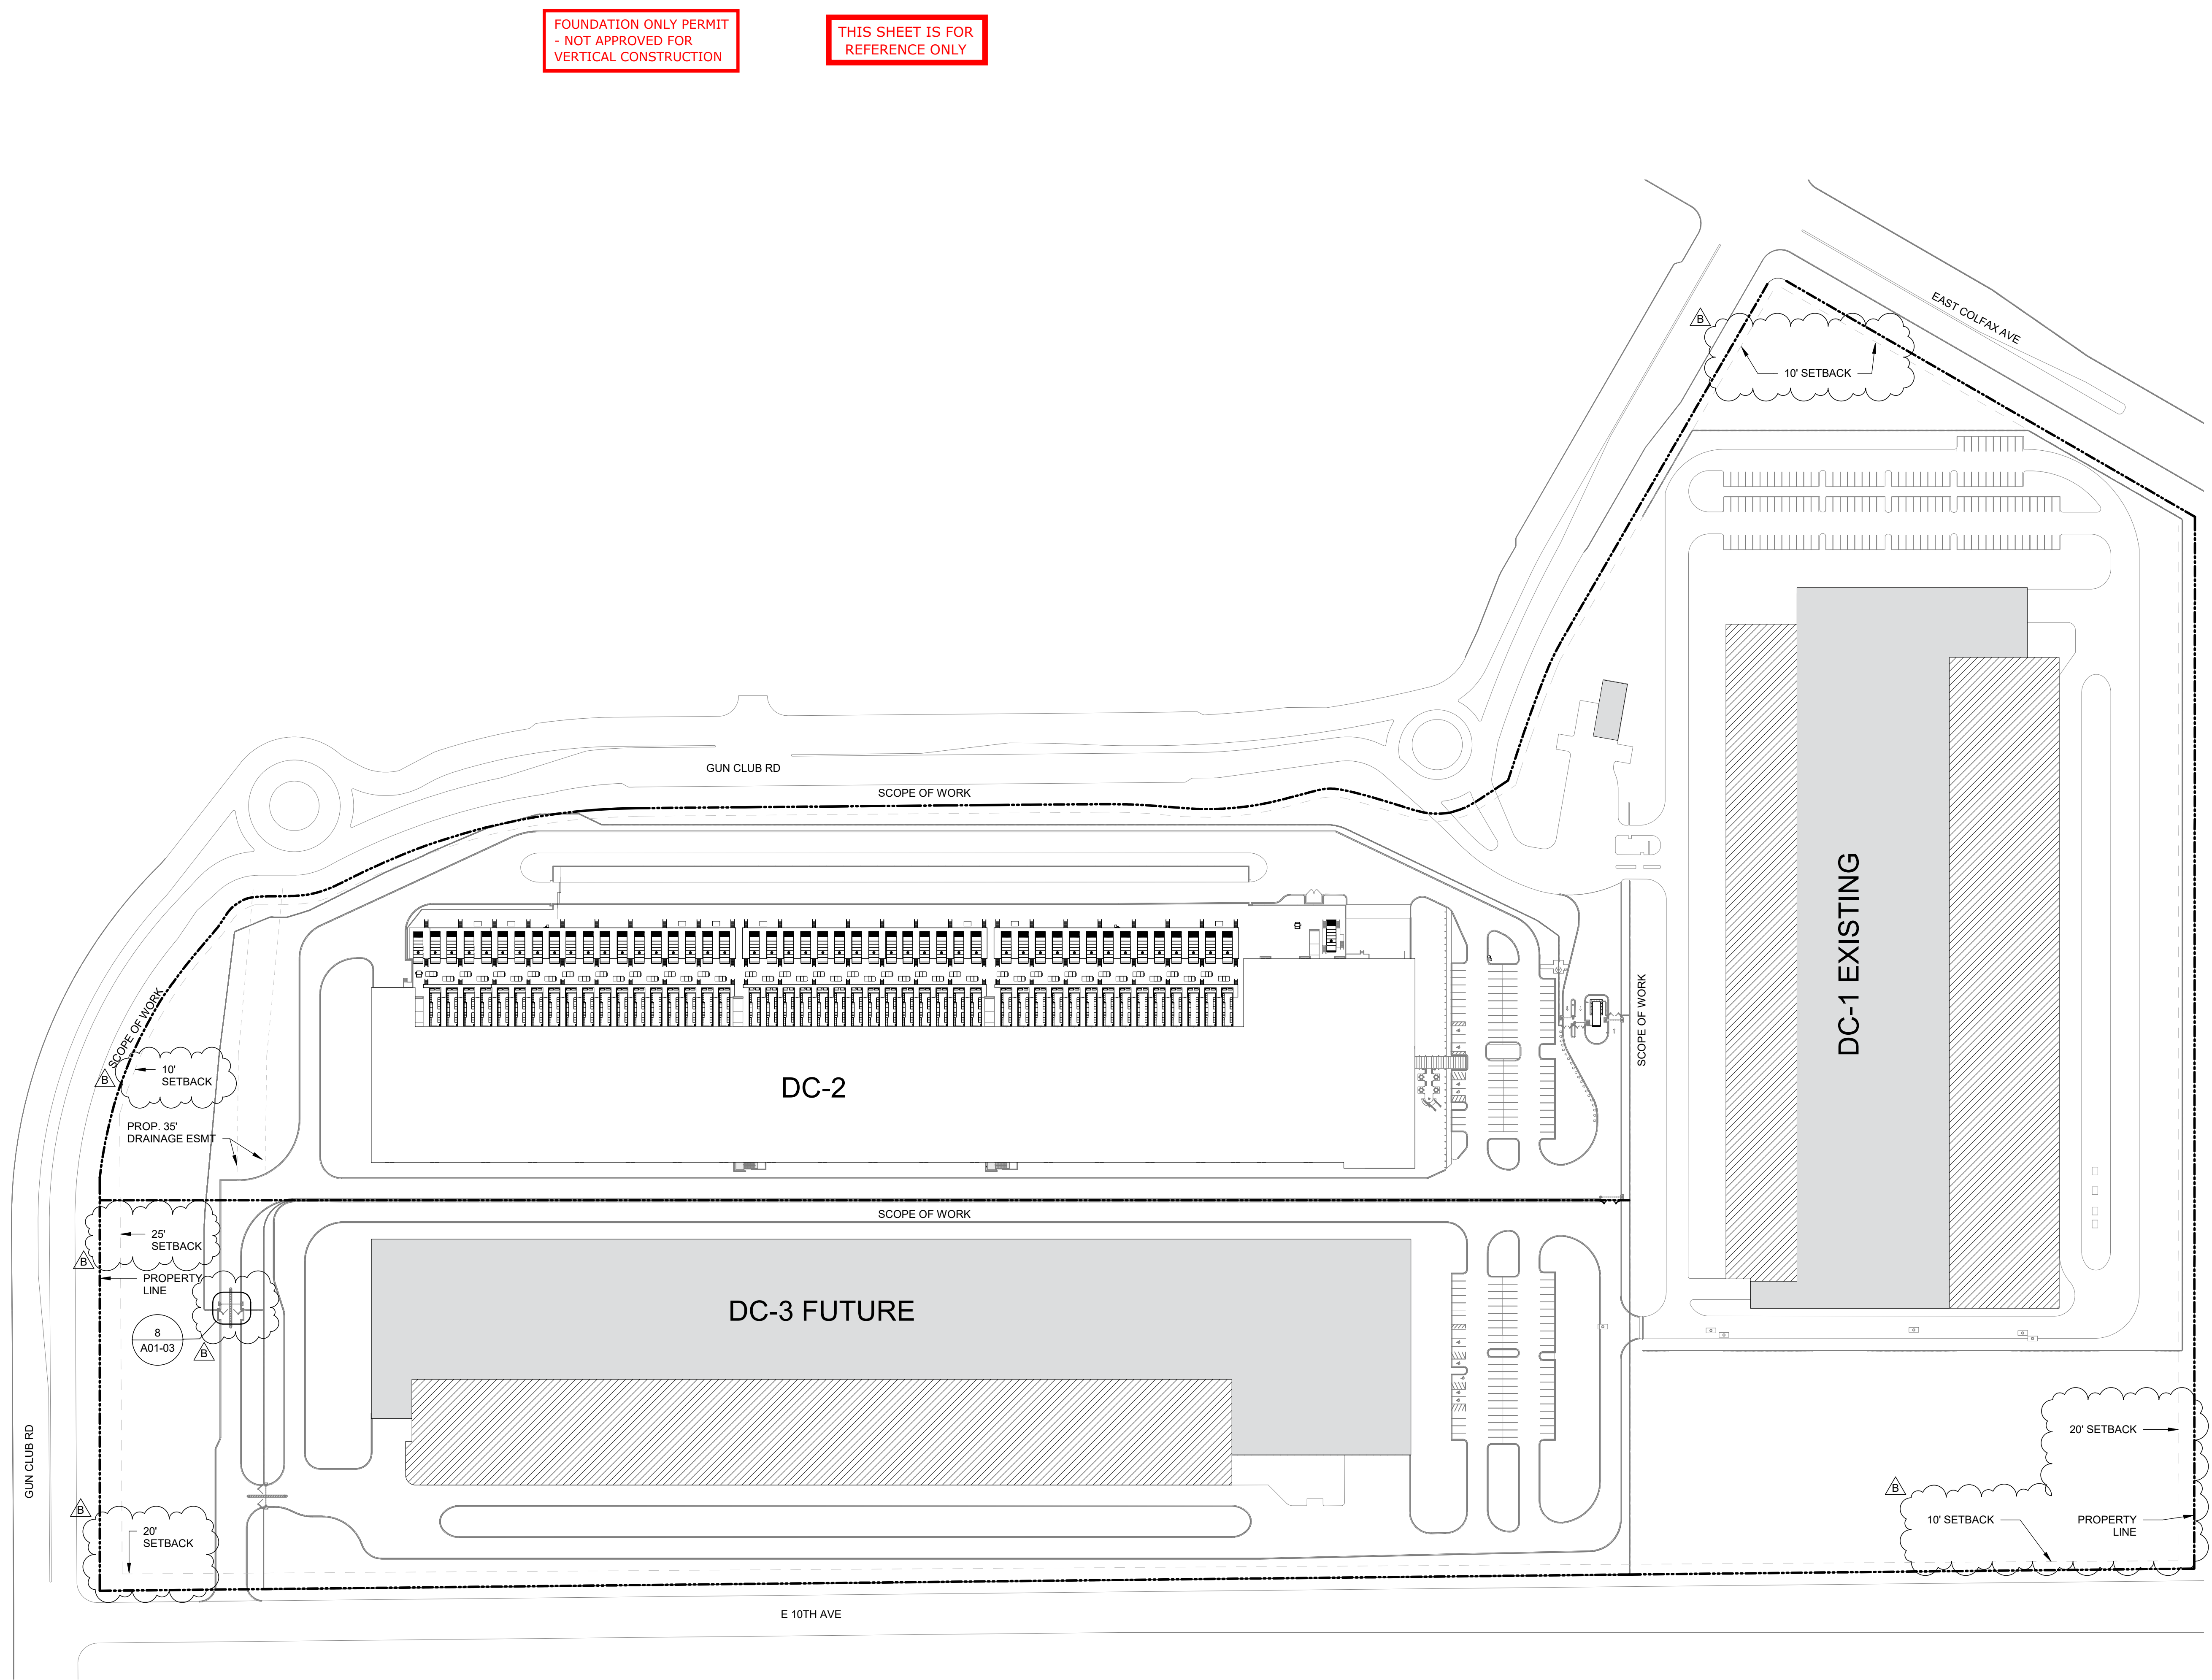



A circular professional seal for David Drinnan, a Colorado Licensed Professional Engineer. The seal contains the text "COLORADO LICENSED", "DAVID DRINNAN", "00407039", and "ARCHITECT". A blue ink signature is written across the seal, and the date "4/24/25" is handwritten below it.

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B


JOB 24464.0000
DATE 04.24.25
SHEET

A02-01 Page 27 of 58


1. G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. PROVIDE 1/2" FOMEN CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
3. ALL FOMEN TO BE 1/2" MIN. THICK. FOMEN ACCEPTABLE DIMENSION, MOST "MIN" DIMENSIONS WILL BE GREATER. IF "MIN" DIMENSIONS FALL SHORT, PROVIDE 1/2" MIN. THICK DRAINAGE DRAINAGE MOISTURE ARCHITECT IMMEDIATELY.
4. PROVIDE CORNER JOINTS IN GYPSUM BOARD WALLS HAVE THE CORNER OF ALL INTERIOR DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30" IN LENGTH OR GREATER OR CORNER JOINTS IN INTERIOR PARTITIONS PROVIDE HORIZONTAL CORNER JOINTS AT 10'-0" A.F.F.
5. G.C. SHALL PROVIDE ALL NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO MANUFACTURE CORNER JOINTS.
6. ALL PENETRATIONS IN FIRE RATED PARTITION SHALL BE SEALED WITH FIRE RATED CAULK.
7. ALL PARTITIONS ON CORNERS OF 90 DEGREE WALLS TO BE PROVIDED WITH INSULATION AND VAPOR BARRIER AND CONTAINMENT.
8. ALL MOUNTED PARTITION HANGERS TO BE MOUNTED AT 45" MAX TO EXTINGUISHER HANDLE U.N.O.
9. PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL EXTERIOR WINDOWS (EXCEPT CLOSETORY WINDOWS).
10. ALL PARTITIONS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
11. PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXTERIOR CORNERS. PARTITIONS MOUNTED AT 4" A.F.F. TO BOTTOM REF. SPECS.
12. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION TO EXTERIOR WALLS. PROVIDE TO COMPLY WITH CURRENT ENERGY CODE.
13. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING AND/OR CONSTRUCTION ONLY. PROVIDE TO COMPLY WITH CURRENT ENERGY CODE.
14. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
15. PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
16. ALL GENERAL NOTES APPLY UNLESS NOTES TO THE CONTRARY.
17. ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
18. DO NOT SCALE THESE DRAWINGS. DIMENSIONS GOVERN.
19. PROVIDE ALL NECESSARY FIRE RETARDANT WOOD TREATING ON ALL EXPOSED WOOD. PROVIDE SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES.
20. ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PROVIDED TO MATCH THE WALL TO WHICH THEY ARE MOUNTED ON.
21. PAINT COLUMNS, BEAMS, GRIDDERS AND OTHER EXPOSED STRUCTURE NOT SHOWN AS FURRED OUT TYP.
22. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AFF-2.
23. ALL PARTITIONS AND METALS SHALL BE HOT-DIPPED GALVANIZED.

1. G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. PROVIDE 1/2" FOMEN CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
3. ALL FOMEN TO BE 1/2" MIN. THICK. FOMEN ACCEPTABLE DIMENSION, MOST "MIN" DIMENSIONS WILL BE GREATER. IF "MIN" DIMENSIONS FALL SHORT, PROVIDE 1/2" MIN. THICK DRAINAGE DRAINAGE MOISTURE ARCHITECT IMMEDIATELY.
4. PROVIDE CORNER JOINTS IN GYPSUM BOARD WALLS. WALLS HAVE THE CENTER OF ALL INTERIOR DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30" IN LENGTH OR GREATER OR CENTER OF INTERIOR CORNER JOINTS PROVIDE HORIZONTAL CORNER JOINTS AT 10'-0" A.F.F.
5. G.C. SHALL PROVIDE ALL NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO MANUFACTURE CORNER JOINTS.
6. ALL PENETRATIONS IN FIRE RATED PARTITION SHALL BE SEALED WITH FIRE RATED CAULK.
7. ALL PENETRATIONS IN 2" MIN. THICK CONCRETE WALLS TO BE PROVIDED WITH INSULATION AND VAPOR BARRIER AND CONTAINMENT.
8. ALL MOUNTED UTILITY UTILITY HANGERS TO BE MOUNTED AT 45" MAX TO EXTINGUISHER HANDLE U.N.O.
9. PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL EXTERIOR WINDOWS (EXCEPT CLOSETTERY WINDOWS).
10. ALL WINDOWS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
11. PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXTERIOR CORNERS. CORNER GUARDS MOUNTED AT 4" A.F.F. TO BOTTOM REEF. SPECS.
12. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION TO EXTERIOR WALLS. PROVIDE TO COMPLY WITH CURRENT ENERGY CODE.
13. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING PURPOSES ONLY. PROVIDE TO COMPLY WITH CURRENT ENERGY CODE.
14. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
15. PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
16. ALL GENERAL NOTES APPLY UNLESS NOTES TO THE CONTRARY.
17. ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
18. DO NOT SCALE THESE DRAWINGS. DIMENSIONS GOVERN.
19. PROVIDE ALL NECESSARY FIRE RETARDANT WOOD TREATING ON ALL EXPOSED WOOD. PROVIDE SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES.
20. ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PROVIDED TO MATCH THE WALL TO WHICH THEY ARE MOUNTED ON.
21. PAINT COLUMNS, BEAMS, GRIDDERS AND OTHER EXPOSED STRUCTURE NOT SHOWN AS FURRED OUT TYP.
22. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AFF-2.
23. ALL METALS SHALL BE HOT-DIPPED GALVANIZED.

THIS SHEET IS FOR
REFERENCE ONLY



FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

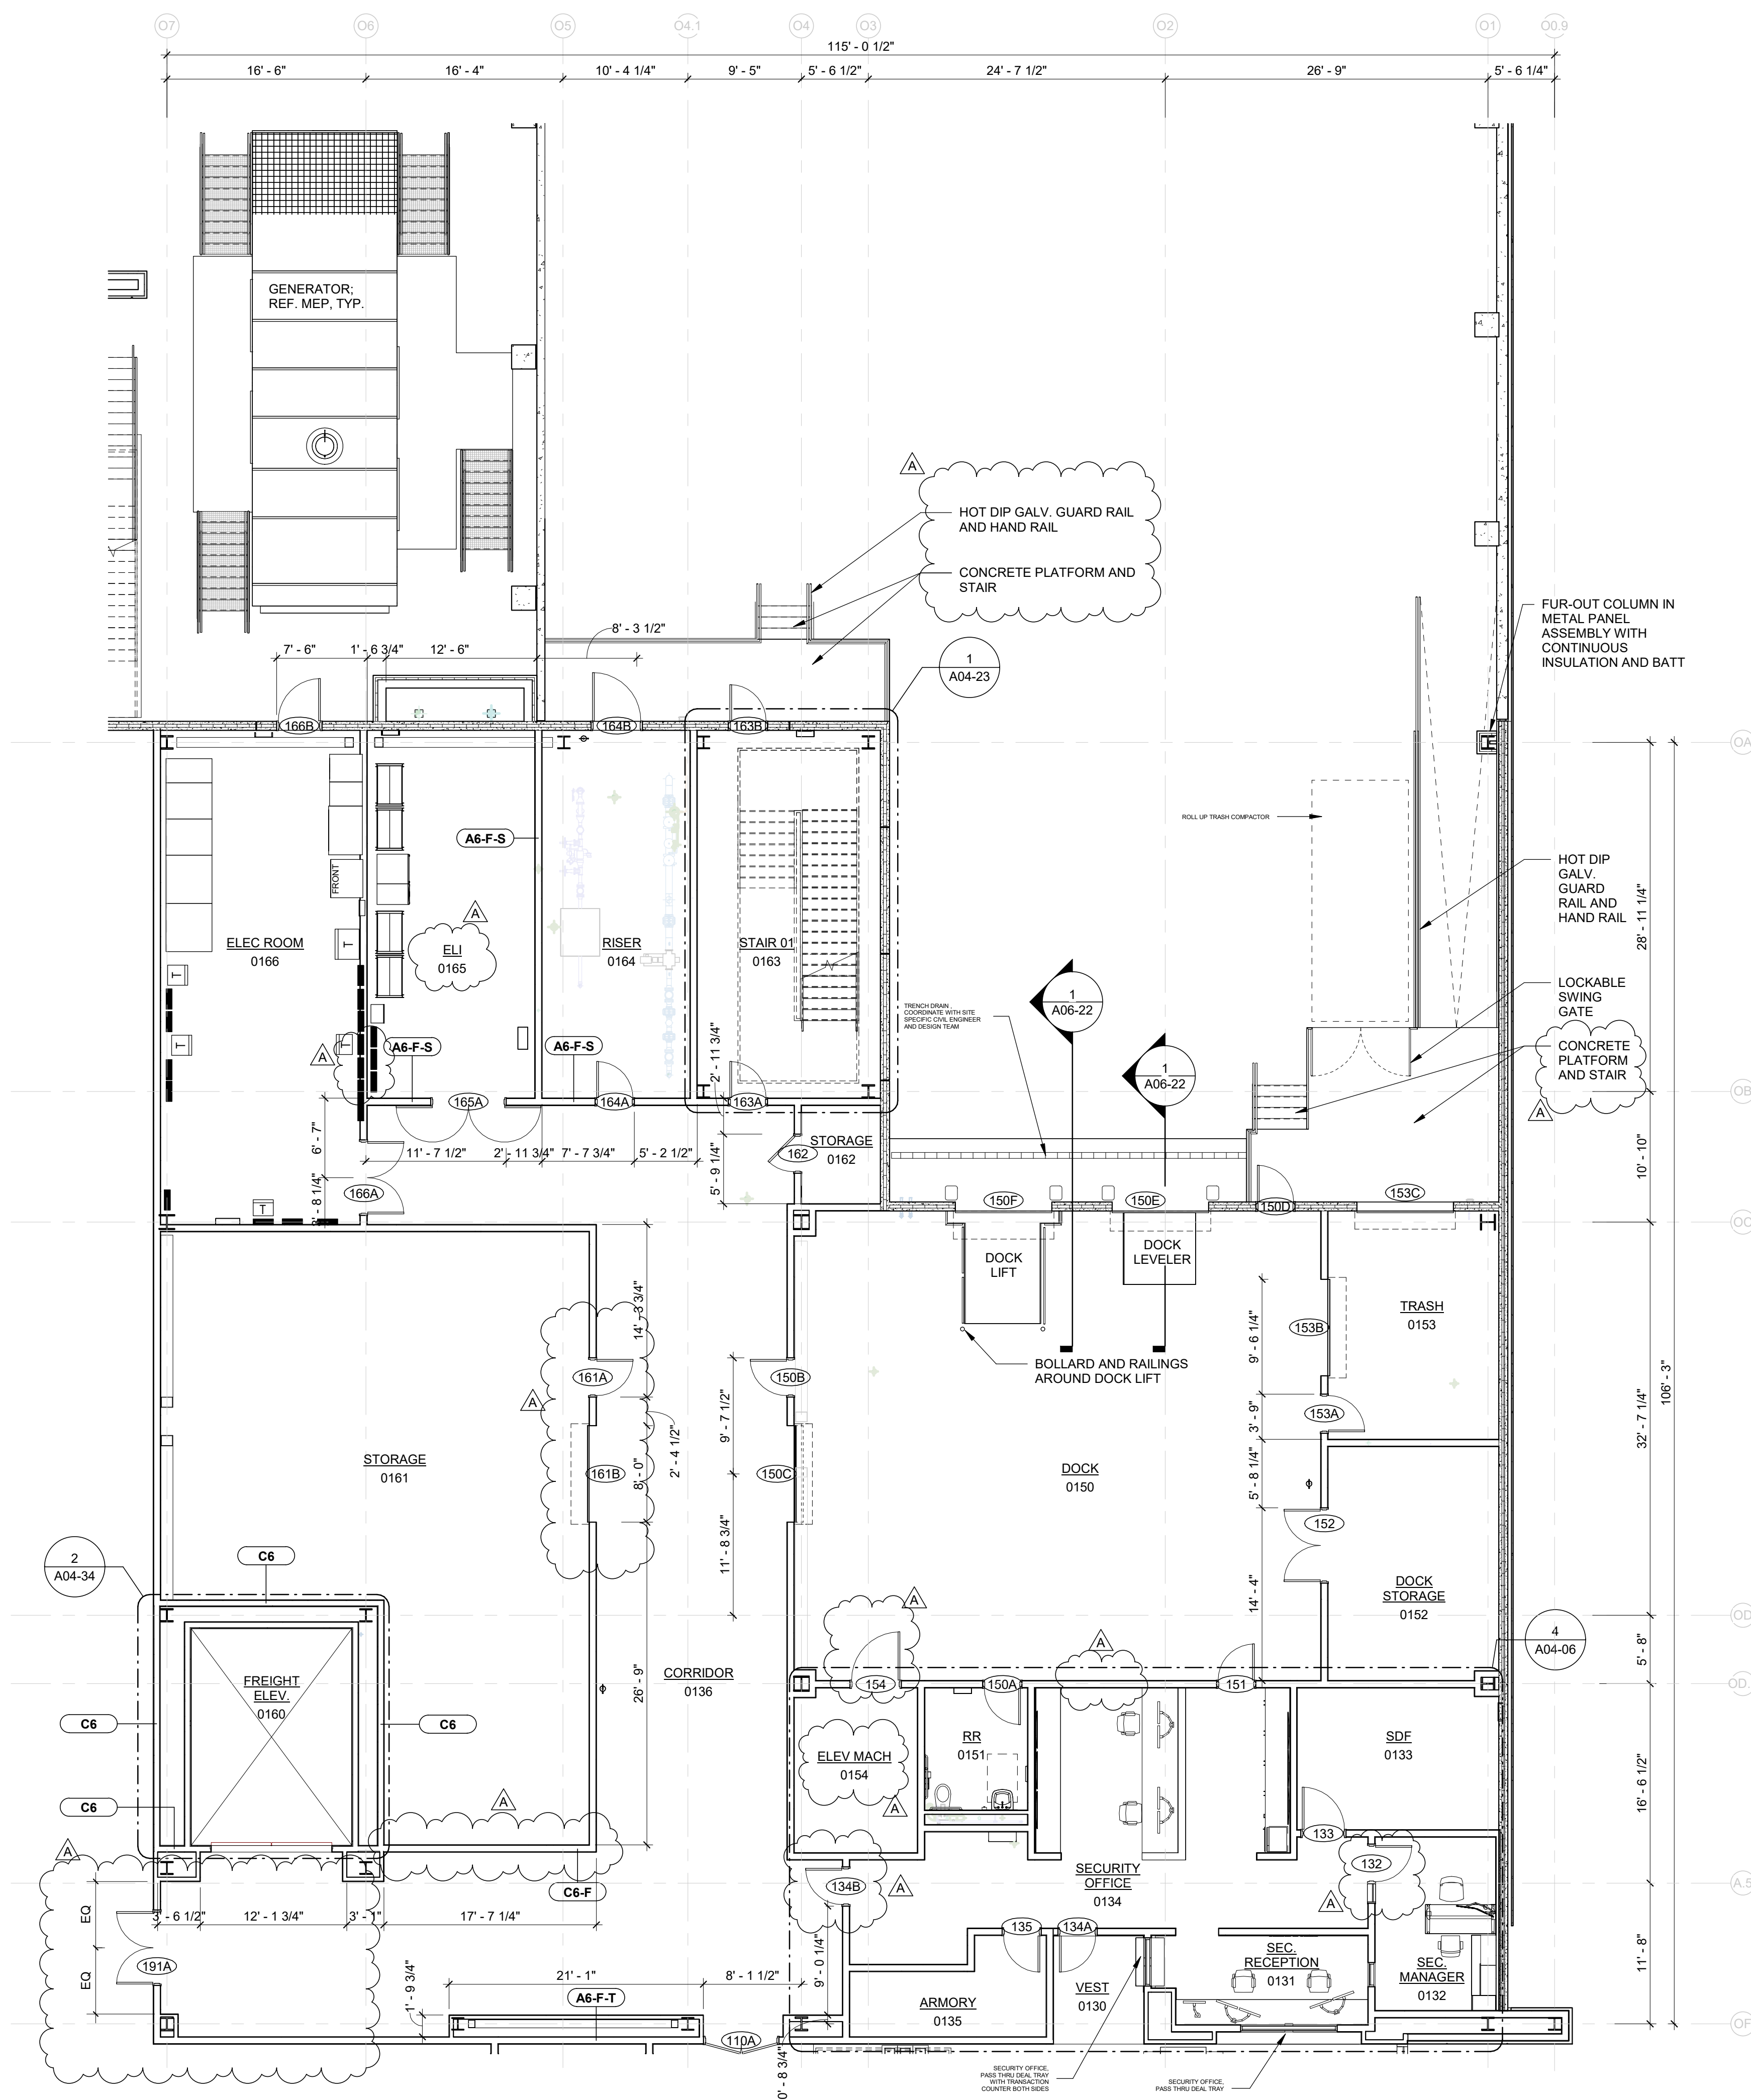

1 FLOOR PLAN - LEVEL ONE - SEGMENT A
1/8" = 1'-0"

GENERAL PLAN NOTES

1. G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. PROVIDE CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS
3. "NOT FOR DIMENSIONING" MEANS "NOT TO SCALE" ACCEPTABLE DIMENSION, MOST "MIN" DIMENSIONS WILL BE GREATER, "R" MIN" DIMENSIONS SHALL SHORT OF BEING SHOWN IN DRAWING, G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY
4. PROVIDE CONTROL JOINTS IN GYPSUM BOARD: PROVIDE THE 4" MIN. GYPSUM BOARD CONTROL JOINT AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30" IN LENGTH OR GREATER OR AS NOTED IN INTERIOR FINISH SCHEDULE. PROVIDE HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDINGS, TYP.
5. ALL WALL CROVNS IS NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HIGHER WORK
6. ALL PENETRATIONS THROUGH EXTERIOR PARTITION SHALL BE SEALED WITH FIRE RATED CAULK
7. DATA HALL AND CRAW HALL FIRE RESISTANT WALLS TO BE PROVIDED WITH 1/2" MIN. GYPSUM BARRIER AND CONTAINMENT
8. ALL WALL MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 4'-0" MAX. TO EXTINGUISHER HANDLE UNO
9. PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL CORNER WINDOWS (EXCEPT CRESTORY WINDOWS)
10. ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF PARTITION UNLESS NOTED OTHERWISE
11. PROVIDE 4"-9" HIGH CORNER GUARDS AT ALL EXPOSED GYP. BOARD CORNERS MOUNTED AT 4" FROM TOP RAIL TO TOP RAIL
12. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION EXTERIOR BLDG ENVELOPE TO COMPLY WITH CURRENT ENERGY CODE
13. FURNITURE (E.C. I.C.) SHOWN FOR SPACE PLANNING TO BE USED ONLY
14. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES
15. PROVIDE AND INSTALL PAPER TOWEL DISPENSER EACH SINK
16. ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE NOTED
17. ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS
18. NOT TO SCALE THESE DRAWINGS, DIMENSIONS GOVERN
19. PROVIDE ALL NECESSARY FIRE RETARDANT WOOD BRACING, BRACING, BRACING, BRACING, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES
20. ALL NECESSARY FIRE RETARDANT WOOD BRACING, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES
21. ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PAINTED TO MATCH THE WALLS TO WHICH THEY ARE MOUNTED ON
22. PAINT COLORED, BEAMS, GIRDERS AND OTHER PAINT COLORED STRUCTURE NOT SHOWN AS FURRED OUT, TYP.
23. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AB-F
24. ALL GALVANIZED METAL SHALL BE HOT-DIPPED GALVANIZED

[illegible]

Date of issue:
03.28.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD



KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

FLOOR PLAN -
LEVEL ONE -
SEGMENT A

JOB 24464.0000
DATE 03.28.25
SHEET

A02-01A Page 28 of 58



CORGAN

[illegible]

QTS DEN1 DC2
1140 N. GUN CLUB ROAD



S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 03.28.25
SHEET

A02-01D

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION



CORGAN ■

[illegible]

KEYPLAN

FLOOR PLAN
LEVEL ONE -
SEGMENT E

A02-01E



FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

CORGAN ■

AG/E



1	12 20 24	DESIGN DEVELOPMENT
---	----------	--------------------


10	
11	REVISIONS

[illegible]

	S	Q	N	L	J	G	E	C	A
	T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 01.31.25
SHEET

A02-01F



FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

CORGAN ■



ISSUES


REVISIONS

The QTS logo, featuring the letters "QTS" in a bold, sans-serif font, with the "Q" being significantly larger and stylized with a red outline and a red shadow.

S	Q	N	L	J	G	E	C	A	
T	R	P	M	K	H	F	D	B	

JOB 24464.0000
DATE 01.31.25
SHEET

A02-01G Page 34 of 56



CORGAN ■




QTS DEN1 DC2
1140 N. GUN CLUB ROAD

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 01.31.25
SHEET

A02-01H



CORGAN ■



1	12 20 24	DESIGN DEVELOPMENT
---	----------	--------------------

△	REVISIONS
---	-----------

1140 N. GUN CLUB ROAD



S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 01.31.25
SHEET

A02-01J

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION




CORGAN



1	12.20.24	DESIGN DEVELOPMENT
---	----------	--------------------

REVISIONS

B	04.24.25	COA - PERMIT COMMENTS
---	----------	-----------------------

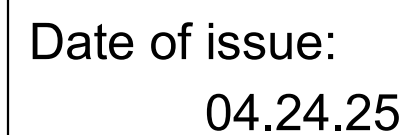

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB	24464.0000
DATE	04.24.25
SHEET	


A02-01K Page 37 of 58

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

ACCESS ROAD

Figure 1 shows a horizontal line with points 14, 15, 16, 17, 18, and 19 marked above it. Below the line, dimension lines indicate distances: 2' - 6" between 18 and 19, 14' - 0" between 17 and 18, 42' - 0" between 16 and 17, 142' - 6" between 15 and 16, 42' - 0" between 14 and 15, and 42' - 0" between 14 and 15.

EQUIPMENT YARD

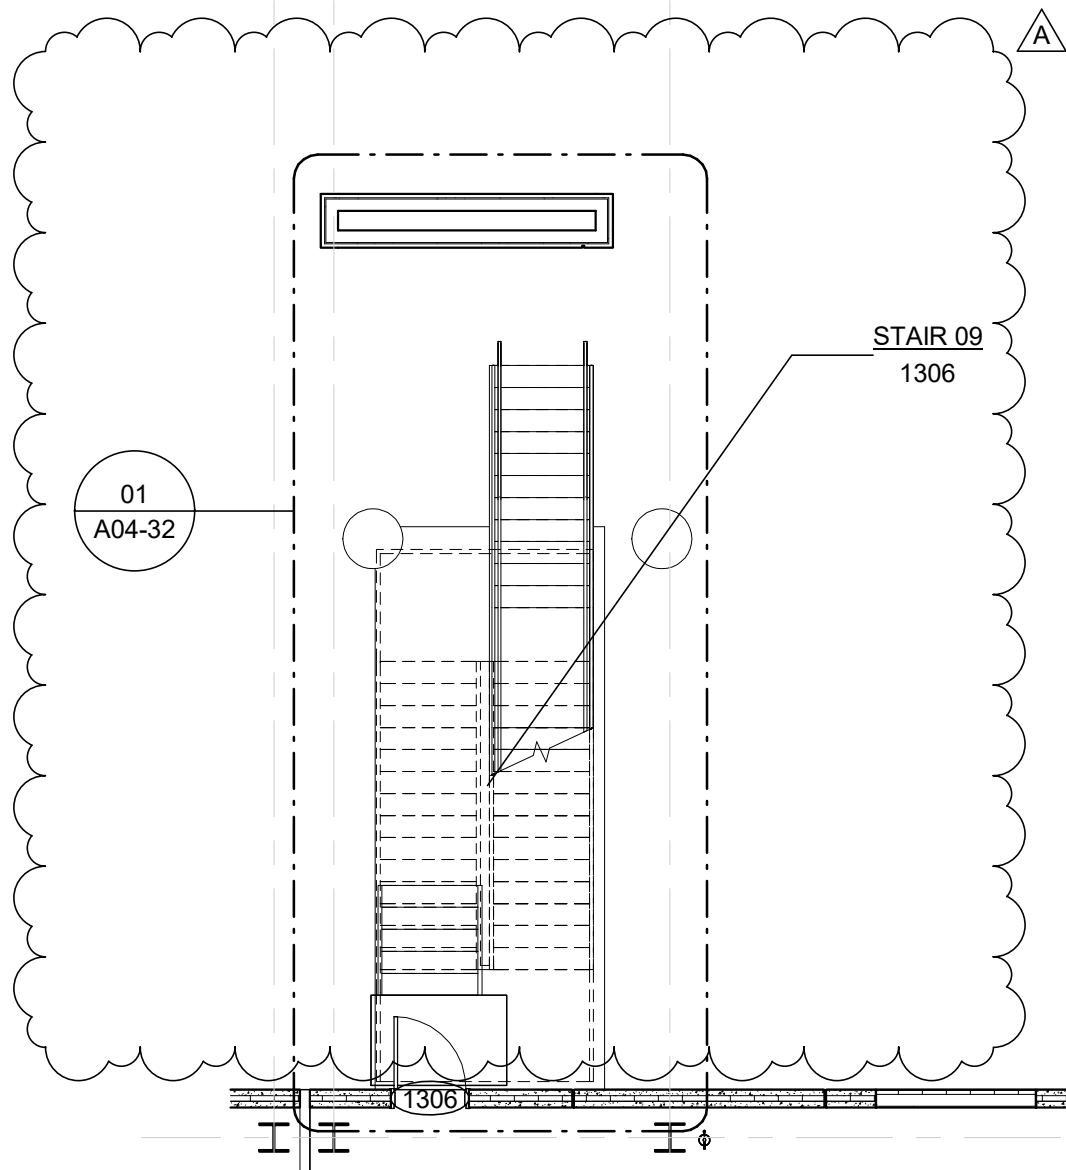

1 LEVEL ONE - SEGMENT L
1/8" = 1'-0"

GENERAL PLAN NOTES

1. G.C. TO PROVIDE DOOR STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. PROVIDE 1/2" MIN. THICK POLYURETHANE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS
3. PROVIDE 1/2" FORMED IN PLACE CONCRETE AT ALL ACCEPTABLE DIMENSION. SMALL "MIN" DIMENSIONS WILL BE GREATER IF "MIN" DIMENSION FALLS SHORT OF MINIMUM DRAWING. G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
4. PROVIDE CONTROL JOINTS IN GYPSUM BOARD PARTITION WALLS. PROVIDE CONTROL JOINTS AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30'-0" IN LENGTH OR GREATER OR AS SPECIFIED. PROVIDE CONTROL JOINTS AND WINDOW HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING. TYP.
5. PENETRATION THROUGH NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HIGHER WORK.
6. PROVIDE 1/2" MIN. THICK RATED PARTITION WALLS BE SEALED WITH FIRE RATED CAULK.
7. DATA HALL AND CRAM GALLERY PERIMETER WALLS TO BE PROTECTED WITH FIRE RATED VAPOR BARRIER AND FINISHMENT.
8. ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 4'-0" MAX. TO EXTINGUISHER HANDLE U.N.O.
9. PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL CORRIDOR WINDOWS AND ALL CLERESTORY WINDOWS.
10. ALL DOORS TO BE LOCATED FROM INSIDE FACE OF CORRIDOR WALLS NOTED ON THIS DRAWING.
11. PROVIDE 4"-0" HIGH CORNER GUARDS AT ALL EXPOSED GYP. BOARD CORNERS MOUNTED AT 4" TO 6" TO BOTTOM OF WALL.
12. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION AT EXTERIOR BLDG ENVELOPE TO COMPLY WITH EXISTING DRAWING.
13. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING PURPOSE ONLY U.N.O.
14. PROVIDE 1/2" MIN. THICK FORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
15. PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ ALL TOILETS.
16. ALL GENERAL NOTES APPLY UNLESS NOTED OTHERWISE ON DRAWINGS.
17. ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
18. DO NOT SCALE THESE DRAWINGS. DIMENSIONS GOVERN.
19. PROVIDE ALL NECESSARY FIRE RETARDANT WOOD JOINTS, BLOCKING, BLOCKING STUDS, STUDS REQUIRED TO SUPPORT DOOR AND WINDOW FRAME, MEP ROW, MILLWORK, ACCESSORIES, ETC. TO MEET ANALYSIS REQUIREMENTS.
20. ALL EXPLOD RIGID CONDUITS FOR LIGHT FIXTURES. SECURITY OF LIGHTING PROTECTION SHALL BE MAINTAINED TO MATCH THE WALL TO WHICH THEY ARE MOUNTED ON.
21. PAINT COLUMNS, BEAMS, GIRDERS AND OTHER CONCRETE STRUCTURE NOT SHOWN AS FURRED OUT TYP.
22. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AFFIXED TO WALLS.
23. ALL PARTITIONS AND METALS SHALL BE HOT-DIPPED GALVANIZED.

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFP

REVISIONS

A	03.28.25	ADDENDUM 1
---	----------	------------



Date of issue:
03.28.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD



KEYPLAN

S	Q	N	L	J	G	E	C	A	
T	R	P	M	K	H	F	D	B	

FLOOR PLAN -
LEVEL ONE -
SEGMENT L

JOB 24464.0000
DATE 03.28.25
SHEET

A02-01L

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION



CORGAN ■



1	12.20.24	DESIGN DEVELOPMENT
---	----------	--------------------

REVISIONS

QTS DEN1 DC2
1140 N. GUN CLUB ROAD




	Q	N	L	J	G	E	C	A
S								
T	R	P	M	K	H	F	D	B

JOB	24464.0000
DATE	01.31.25
SHEET	

A02-01M

THIS SHEET IS FOR
REFERENCE ONLY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

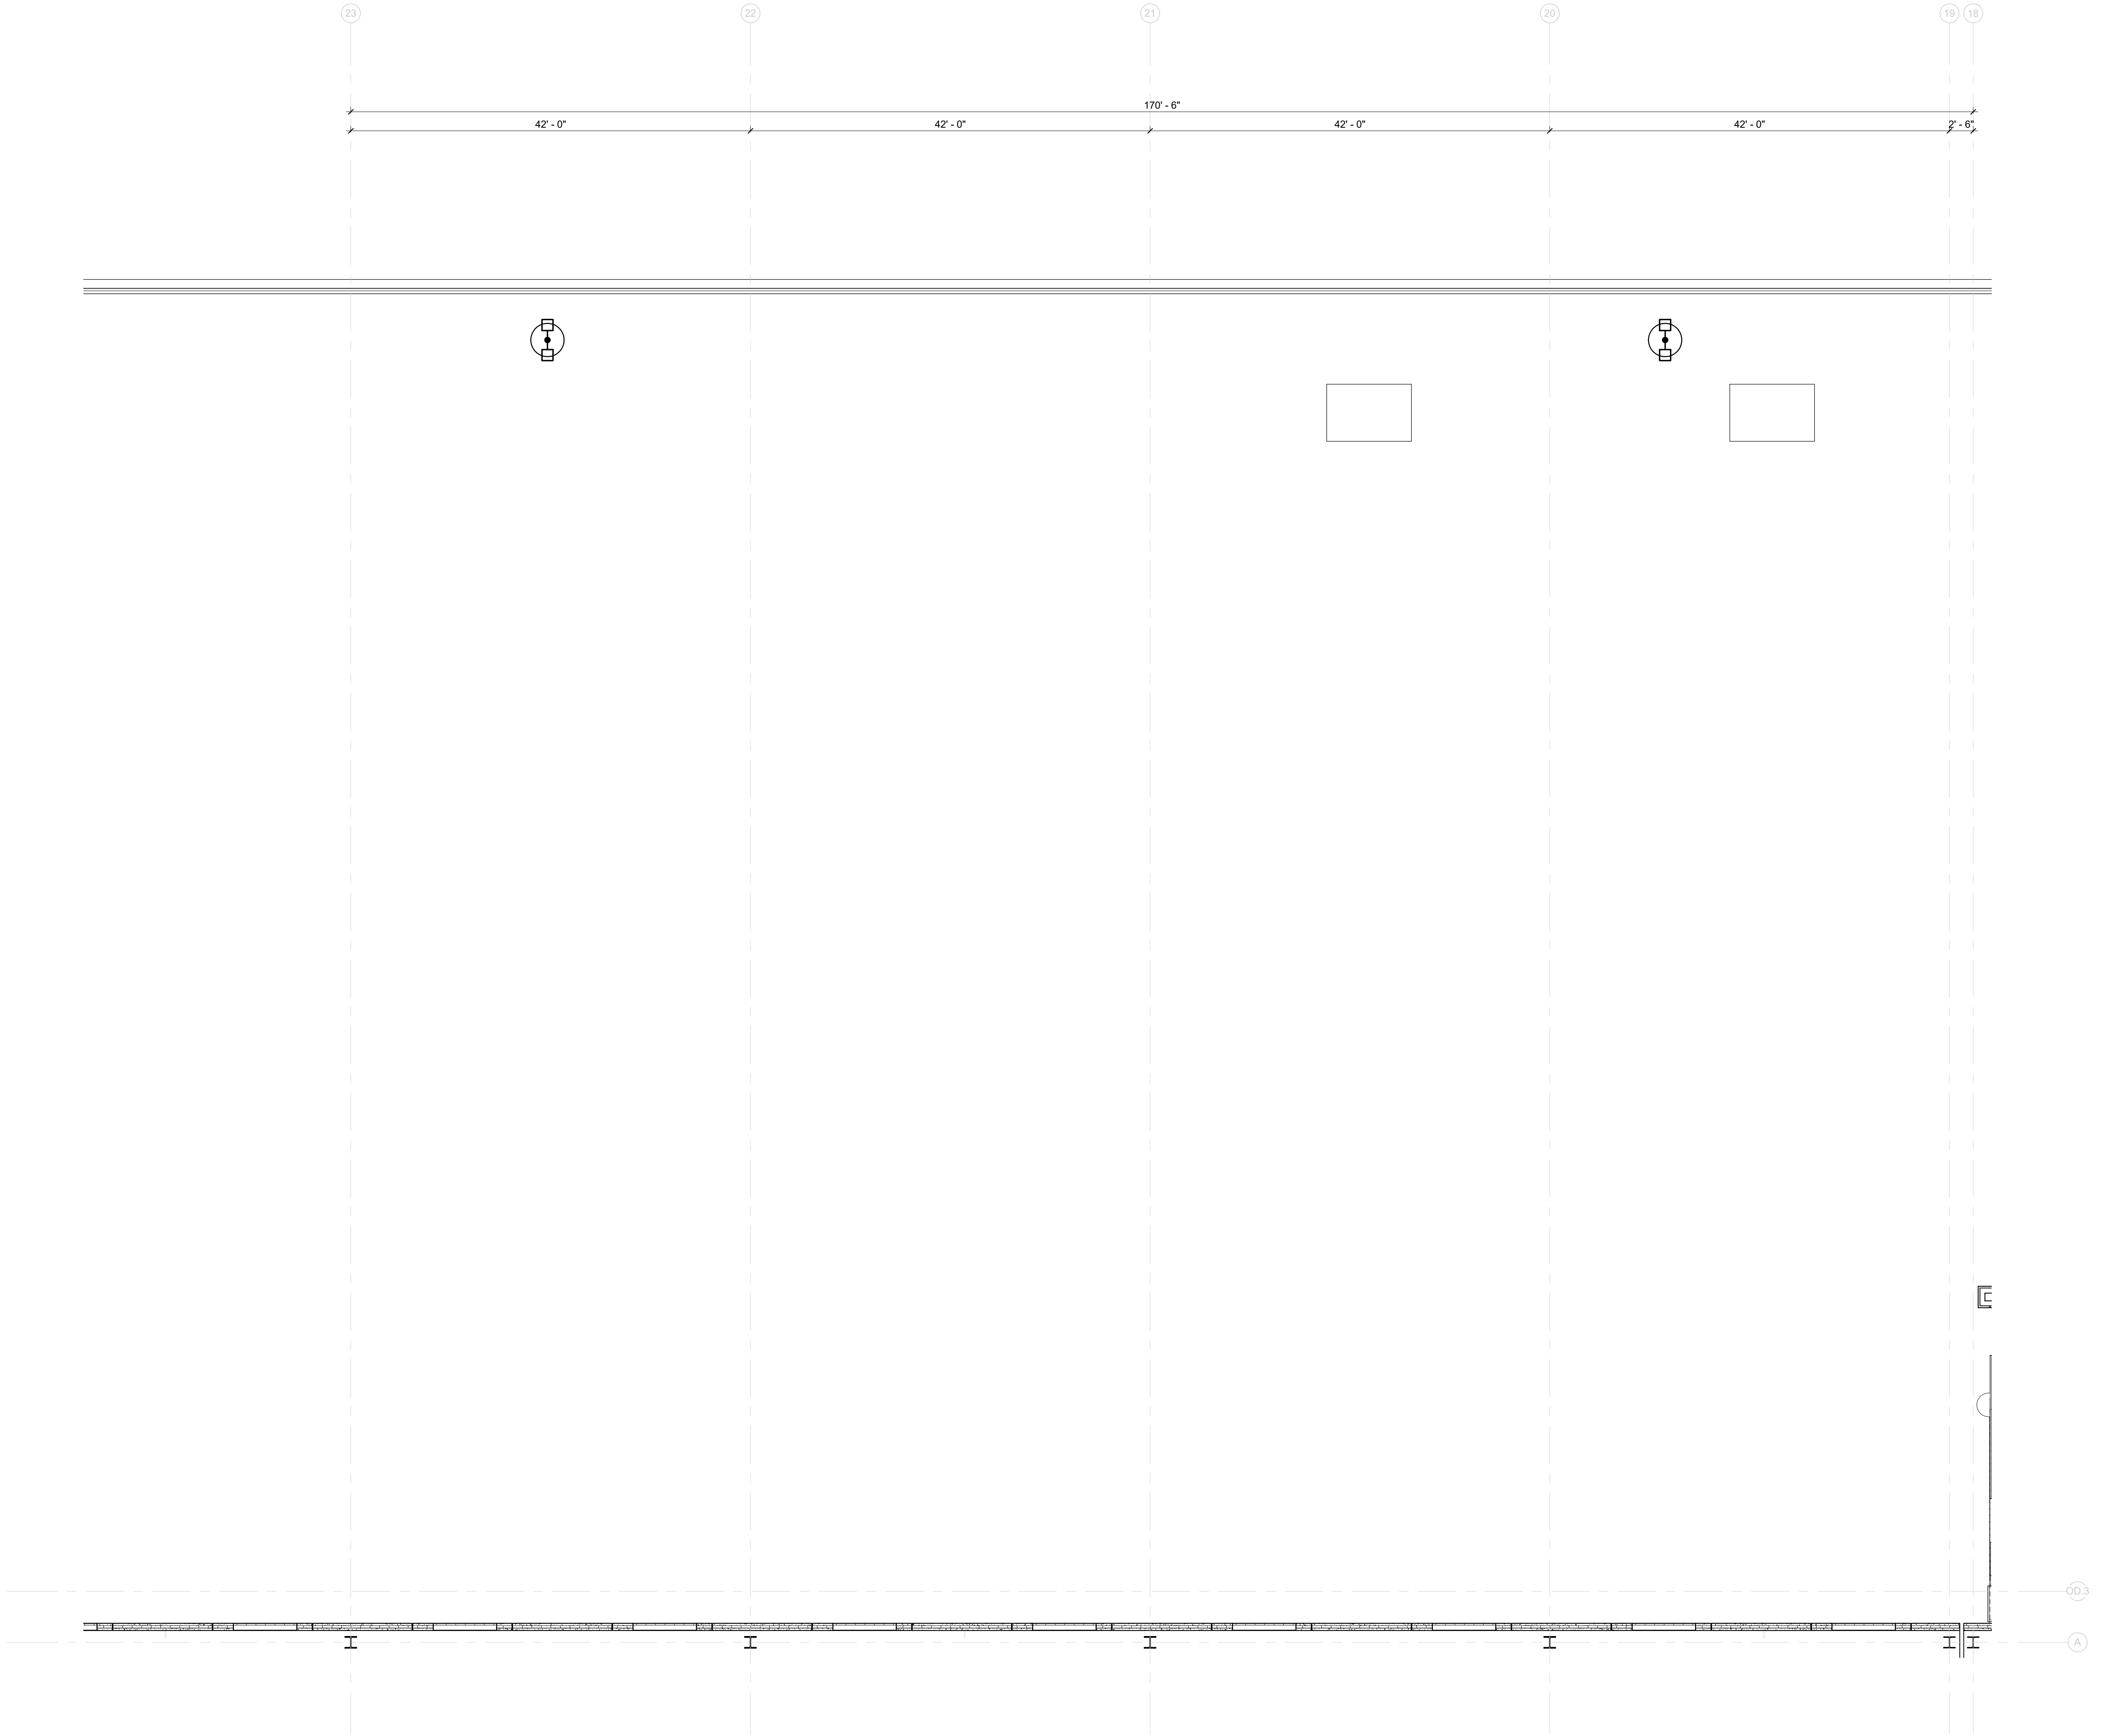

GENERAL PLAN NOTES

- G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
- G.C. TO PROVIDE CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
- "MIN." FOR DIMENSIONS INDICATES MINIMUM ACCEPTABLE DIMENSION. MOST "MIN." DIMENSIONS WILL BE GREATER. IF "MIN." DIMENSION FALLS SHORT OF WHAT IS SHOWN ON DRAWING, G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
- PROVIDE CONTROL JOINTS IN GYPSUM BOARD WALLS ABOVE THE CORNER OF ALL INTERIOR DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30'-0" IN LENGTH OR GREATER OR AS INDICATED ON INTERIOR ELEVATIONS. PROVIDE HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING, TYP.
- G.C. SHALL PROVIDE ALL NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HIS/HER WORK.
- ALL PENETRATIONS IN FIRE RATED PARTITION SHALL BE SEALED WITH FIRE RATED CAULK.
- DATA HALL AND CRAH GALLERY PERIMETER WALLS TO BE PROVIDED WITH INSULATION AND VAPOR BARRIER AND CONTAINMENT.
- ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 45" MAX. TO EXTINGUISHER HANDLE U.N.O.
- PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL EXTERIOR WINDOWS (EXCEPT CLERESTORY WINDOWS).
- ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
- PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXPOSED GYP. BOARD CORNERS MOUNTED AT 4" A.F.F. TO BOTTOM REF. SPECS.
- PROVIDE CONTINUOUS AIR BARRIER AND INSULATION AT EXTERIOR BLDG ENVELOPE TO COMPLY WITH CURRENT ENERGY CODE.
- FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING PURPOSE ONLY U.N.O.
- ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
- PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
- ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE ON DRAWINGS.
- ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
- DO NOT SCALE THESE DRAWINGS, DIMENSIONS GOVERN.
- PROVIDE ALL NECESSARY FIRE RETARDANT WOOD FRAMING, BRACING, BLOCKING, NAILERS, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES, MISCELLANEOUS FIXTURES AND FITTINGS.
- ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PAINTED TO MATCH THE WALL TO WHICH THEY ARE MOUNTED ON.
- PAINT COLUMNS, BEAMS, GIRDERS AND OTHER EXPOSED STRUCTURE NOT SHOWN AS FURRED OUT, TYP.
- ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE A6-F
- ALL GALVANIZED METALS SHALL BE HOT-DIPPED GALVANIZED

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFP

REVISIONS

4		
5		
6		
7		
8		
9		
10		



QTS DEN1 DC2

1140 N. GUN CLUB ROAD




KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

FLOOR PLAN -
LEVEL ONE -
SEGMENT N

JOB 24464.0000
DATE 01.31.25
SHEET

A02-01N

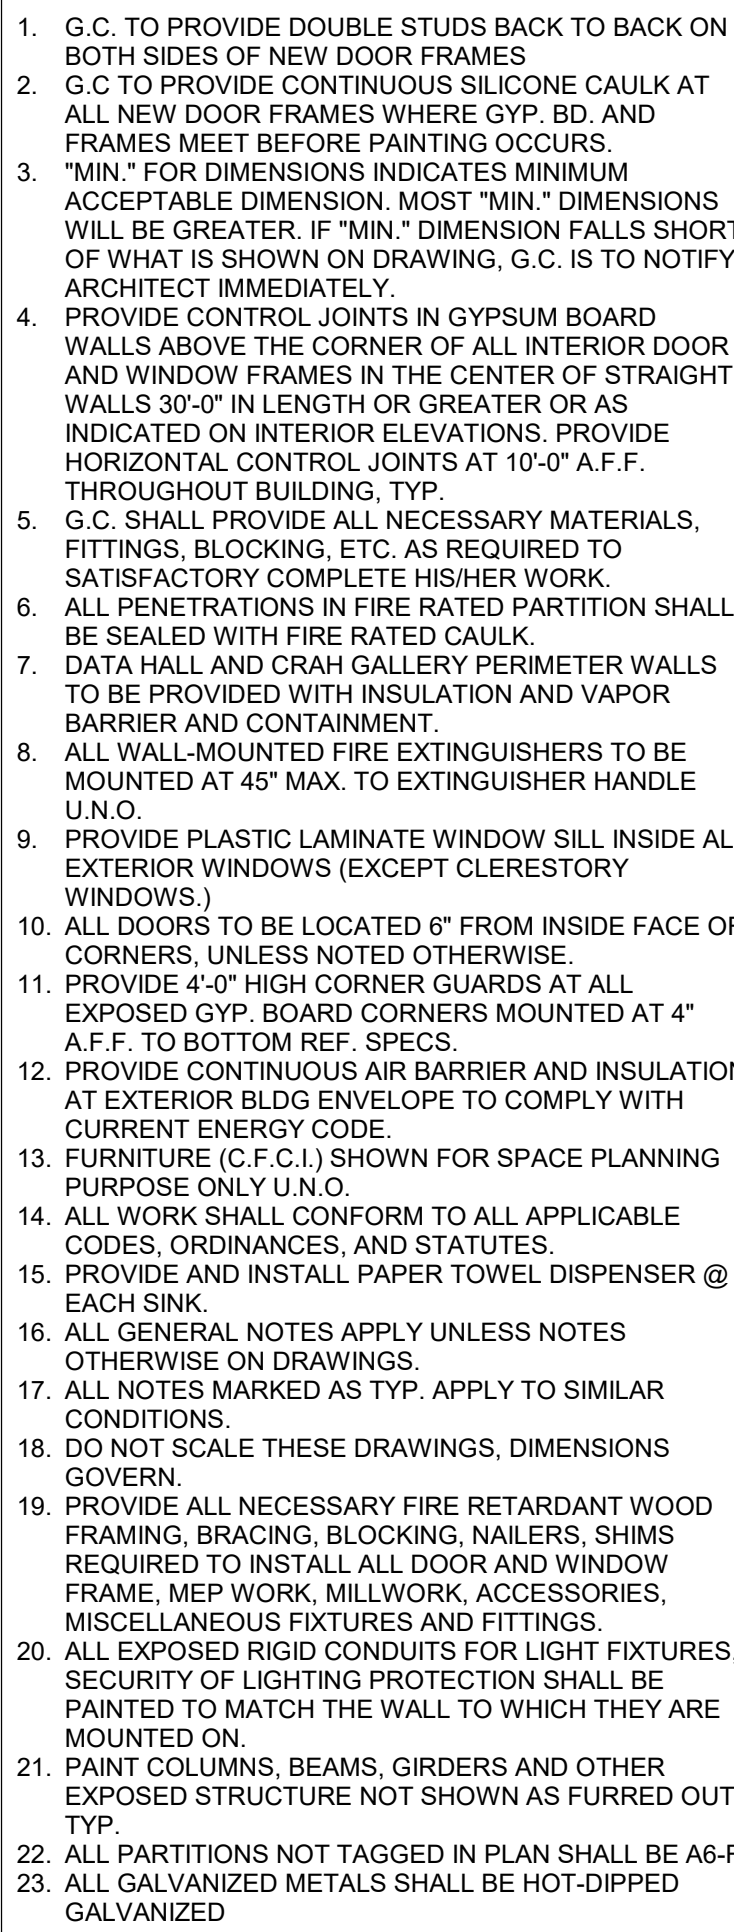

702 01

The QTS logo, featuring the letters "QTS" in a bold, sans-serif font, with the "Q" being significantly larger and stylized with a red outline and a red shadow. A small registered trademark symbol (®) is located to the upper right of the "Q".

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B


FLOOR PLAN -
LEVEL ONE -
SEGMENT P

JOB 24464.0000
DATE 01.31.25
SHEET

A02-01P

THIS SHEET IS FOR
REFERENCE ONLY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

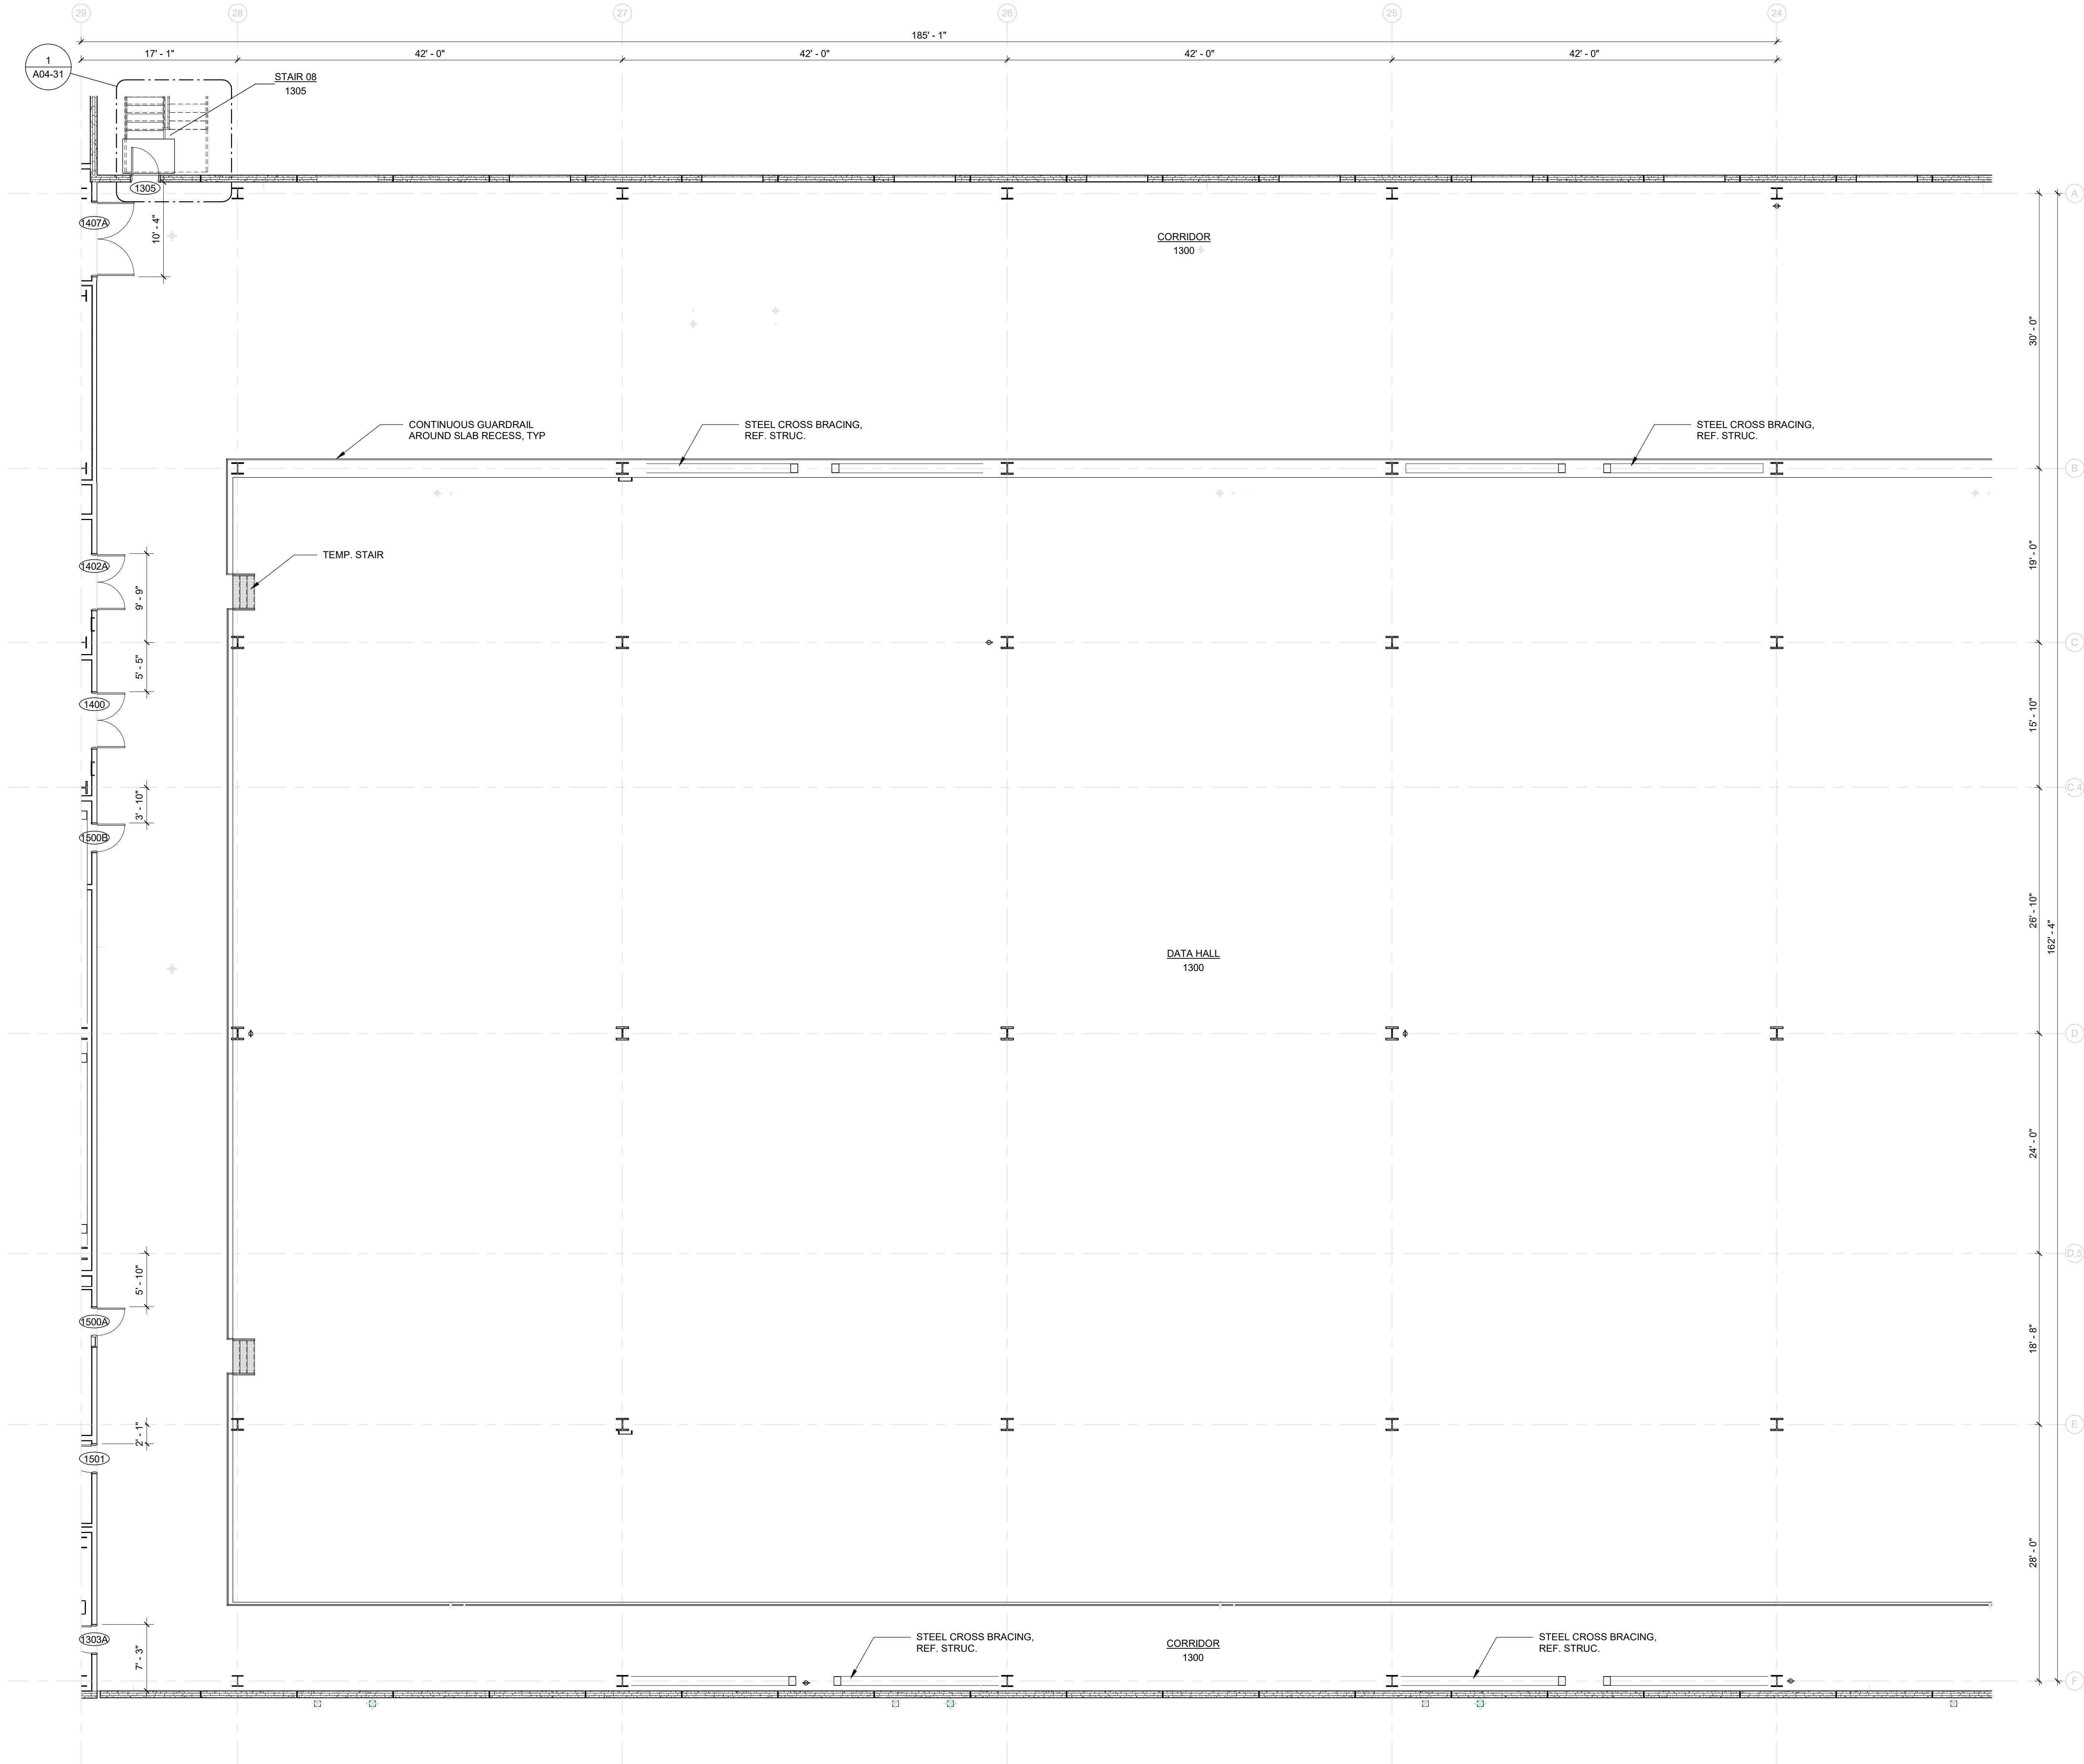

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION




CORGAN



	ISSUES	
1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFP

REVISIONS

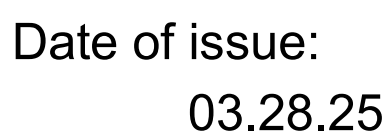[illegible]

QTS DEN1 DC2
1140 N. GUN CLUB ROAD



S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 03.28.25
SHEET

A02-01ST Page 44 of 58

DESIGN CONSULTING LLC

Page 45 of 50

A02-02 Page 45 of 58



401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

SYSKA HENNESSY
GROUP

DESIGN CONSULTING LLC

3/28/25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

	Q	N	L	J	G	E	C	A
S								
T	R	P	M	K	H	F	D	B

A02-02A Page 46 of 58




THIS SHEET IS FOR
REFERENCE ONLY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

TYPICAL NOTE FOR MMR's, DCIMMDF, SDF, IDF's, ENTRANCE FACILITY ROOMS,TELECOM RISER ROOMS & ACCESS CONTROL ROOMS:
- PROVIDE FIRE TREATED PLYWOOD PUNCH DOWN BOARDS / BACKERBOARDS ON FACE OF GYP BD. WALL
- INSTALL 8'-0" x 8'-0" PLYWOOD AREA ON TWO DIFFERENT (PERPENDICULAR) WALLS OF MMR AND DCIMMDF ROOMS.
- ENTRANCE FACILITY ROOMS, TELECOM RISER ROOMS AND IDF's TO RECEIVE ONE 8'-0" x 8'-0" AREA.
- PLYWOOD SHALL BE 3/4" THICK, 4'-0" x 8'-0" SHEETS. MOUNT BOTTOM OF PLYWOOD STARTING AT 2'-0" ABOVE FINISH FLOOR WITH 8'-0" DIMENSION VERTICALLY. PAINT PLYWOOD TO MATCH ROOM WALL COLOR.
- DO NOT PLACE PLYWOOD BELOW MECHANICAL SPLIT SYSTEM(S).
- COORDINATE WITH TLD CONSULTING.

GENERAL PLAN NOTES

- G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
- G.C. TO PROVIDE CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
- "MIN." FOR DIMENSIONS INDICATES MINIMUM ACCEPTABLE DIMENSION. MOST "MIN." DIMENSIONS WILL BE GREATER. IF "MIN." DIMENSION FALLS SHORT OF WHAT IS SHOWN ON DRAWING, G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
- PROVIDE CONTROL JOINTS IN GYPSUM BOARD WALLS ABOVE THE CORNER OF ALL INTERIOR DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30'-0" IN LENGTH OR GREATER OR AS INDICATED ON INTERIOR ELEVATIONS. PROVIDE HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING. TYP.
- G.C. SHALL PROVIDE ALL NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HIS/HER WORK.
- ALL PENETRATIONS IN FIRE RATED PARTITION SHALL BE SEALED WITH FIRE RATED CAULK.
- DATA HALL AND CRAH GALLERY PERIMETER WALLS TO BE PROVIDED WITH INSULATION AND VAPOR BARRIER AND CONTAINMENT.
- ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 45" MAX. TO EXTINGUISHER HANDLE U.N.O.
- PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL EXTERIOR WINDOWS (EXCEPT CLERESTORY WINDOWS).
- ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
- PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXPOSED GYP. BOARD CORNERS MOUNTED AT 4" A.F.F. TO BOTTOM REF. SPECS.
- PROVIDE CONTINUOUS AIR BARRIER AND INSULATION AT EXTERIOR BLDG ENVELOPE TO COMPLY WITH CURRENT ENERGY CODE.
- FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING PURPOSE ONLY U.N.O.
- ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
- PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
- ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE ON DRAWINGS.
- ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
- DO NOT SCALE THESE DRAWINGS, DIMENSIONS GOVERN.
- PROVIDE ALL NECESSARY FIRE RETARDANT WOOD FRAMING, BRACING, BLOCKING, NAILERS, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES, MISCELLANEOUS FIXTURES AND FITTINGS.
- ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PAINTED TO MATCH THE WALL TO WHICH THEY ARE MOUNTED ON.
- PAINT COLUMNS, BEAMS, GIRDERS AND OTHER EXPOSED STRUCTURE NOT SHOWN AS FURRED OUT, TYP.
- ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE A6-F
- ALL GALVANIZED METALS SHALL BE HOT-DIPPED GALVANIZED

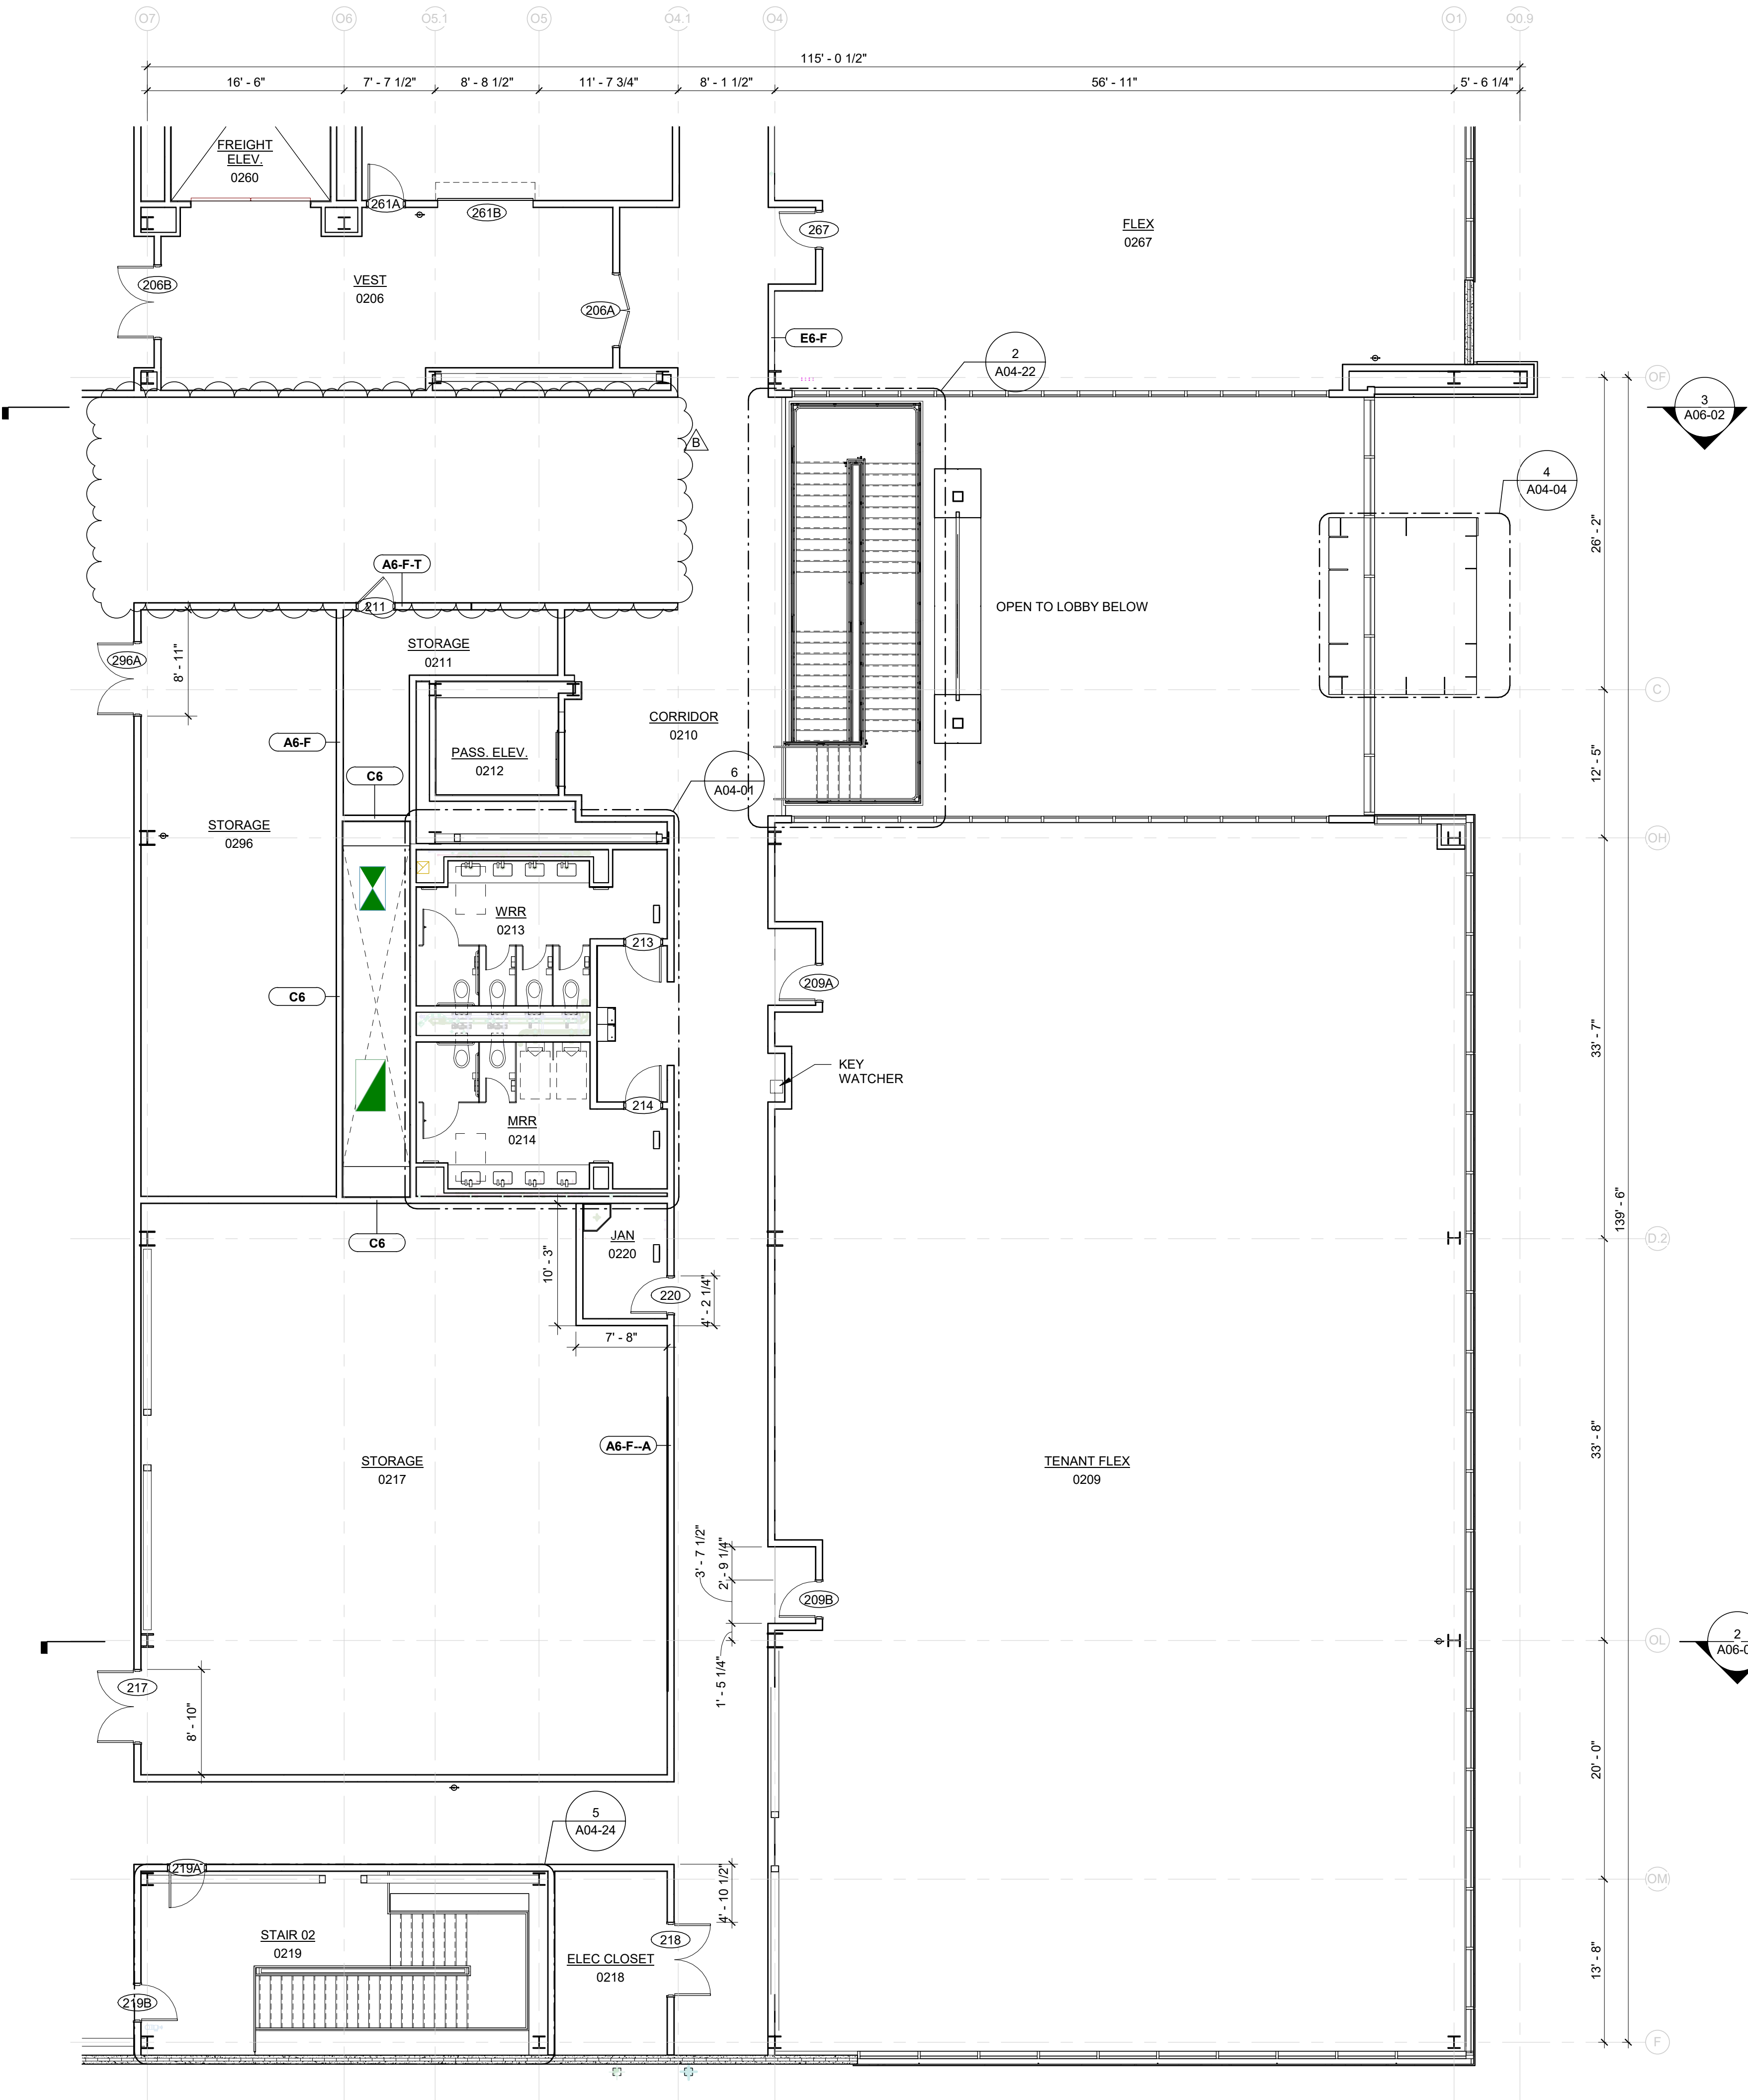

1 FLOOR PLAN -LEVEL TWO - SEGMENT B
1/8" = 1'-0"

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SKY HENNESSY
GROUP

TLD
DESIGN CONSULTING LLC

ISSUES	
1	12.20.24 DESIGN DEVELOPMENT
2	01.31.25 ISSUE FOR PERMIT
3	05.30.25 FOUNDATIONS ONLY IFF
4	
5	
6	
7	
8	
9	
10	
REVISIONS	
A	03.28.25 ADDENDUM 1
B	04.24.25 COA - PERMIT COMMENTS



Date of issue:
04.24.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

FLOOR PLAN -
LEVEL TWO -
SEGMENT B

JOB 24464.0000
DATE 04.24.25
SHEET

A02-02B

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

1. G.C. TO PROVIDE DOOR STUBS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. PROVIDE 1/2" MINIMUM CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
3. PROVIDE 1/2" FORMED AND FINISHED ALUMINUM ACCEPTABLE DIMENSION MOST "MIN" DIMENSIONS WILL BE GREATER IF "MIN" DIMENSIONS SHALL SHORTLY EXCEED 1/2" MINIMUM DIMENSION. G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
4. PROVIDE CONTROL JOINTS IN GYPSUM BOARD TO MATCH THE CONTROL JOINTS IN THE FORMER DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30" IN LENGTH OR GREATER OR AS SPECIFIED BY THE ARCHITECT.
5. PROVIDE CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING. TYPE:
6. G.C. SHALL PROVIDE ALL NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE FISHER WORK.
7. G.C. SHALL PROVIDE ALL NECESSARY PARTITIONS SHALL BE SEALED WITH FIRE RATED CAULK.
8. DATA HALL AND CRAW HALLS PERIMETER WALLS TO BE FINISHED WITH 1/2" GYPSUM BOARD PARTITION BARRIER AND CONTAINMENT.
9. ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE PROVIDED WITH 1/2" GYPSUM BARRIER HANDLE U.N.O.
10. PROVIDE PLASTIC LAMINATE WINDOW SLIP INSIDE ALL CORNER WINDOWS (EXCEPT CERELESTRY WINDOWS.)
11. ALL DOORS TO BE LOCATED 6" FROM FACE OF CORNERS, UNLESS NOTED OTHERWISE.
12. PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXPOSED GY. BOARD CORNERS MOUNTED AT 4" FROM BOTTOM OF CORNER GUARDS.
13. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION AT EXTERIOR WALLS TO EQUIVALENT TO COMPLY WITH EXISTING ENERGY CODE.
14. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING TO BE PROVIDED BY OTHERS.
15. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
16. PROVIDE AND INSTALL PAPER TOWEL DISPENSER EACH SINK.
17. ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE SPECIFIED.
18. ALL NOTES MARKED AS TYPE: APPLY TO SIMILAR CONDITIONS.
19. PROVIDE SCALE THESE DRAWINGS, DIMENSIONS GOVERN.
20. PROVIDE ALL NECESSARY FIRE RETARDANT WOOD AND WOOD PANELS, TRIM, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES.
21. ALL ELECTRICAL AND MECHANICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE FOLLOWING:
22. ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PROVIDED TO MATCH THE WAY TO WHICH THEY ARE MOUNTED ON.
23. ALL PAINT COULMS, BEAMS, GRIDDERS AND CURVED STRUCTURE NOT SHOWN AND TURNED OUT, TYPE.
24. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AG-FINISH.
25. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE HOT-DIPPED GALVANIZED.



1	12.20.24	DESIGN DEVELOPMENT
---	----------	--------------------

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFF
4		
5		
6		
7		
8		
9		
10		

A	03.28.25	ADDENDUM 1
---	----------	------------

[illegible]

QTS DEN1 DC2
1140 N. GUN CLUB ROAD



	Q	N	L	J	G	E	C	A
S								
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 03.28.25
SHEET

A02-02C



702 021

-
- 3/28/25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

A02-02F




FOUNDATION ONLY PERMITTED
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

7102 02

A02-02K Page 52 of 58

3/28/2025 3:10:50 PM A02-02M FLOOR PLAN - LEVEL TWO - SEGMENT M

Permit #25-2535171
RSN 1903242

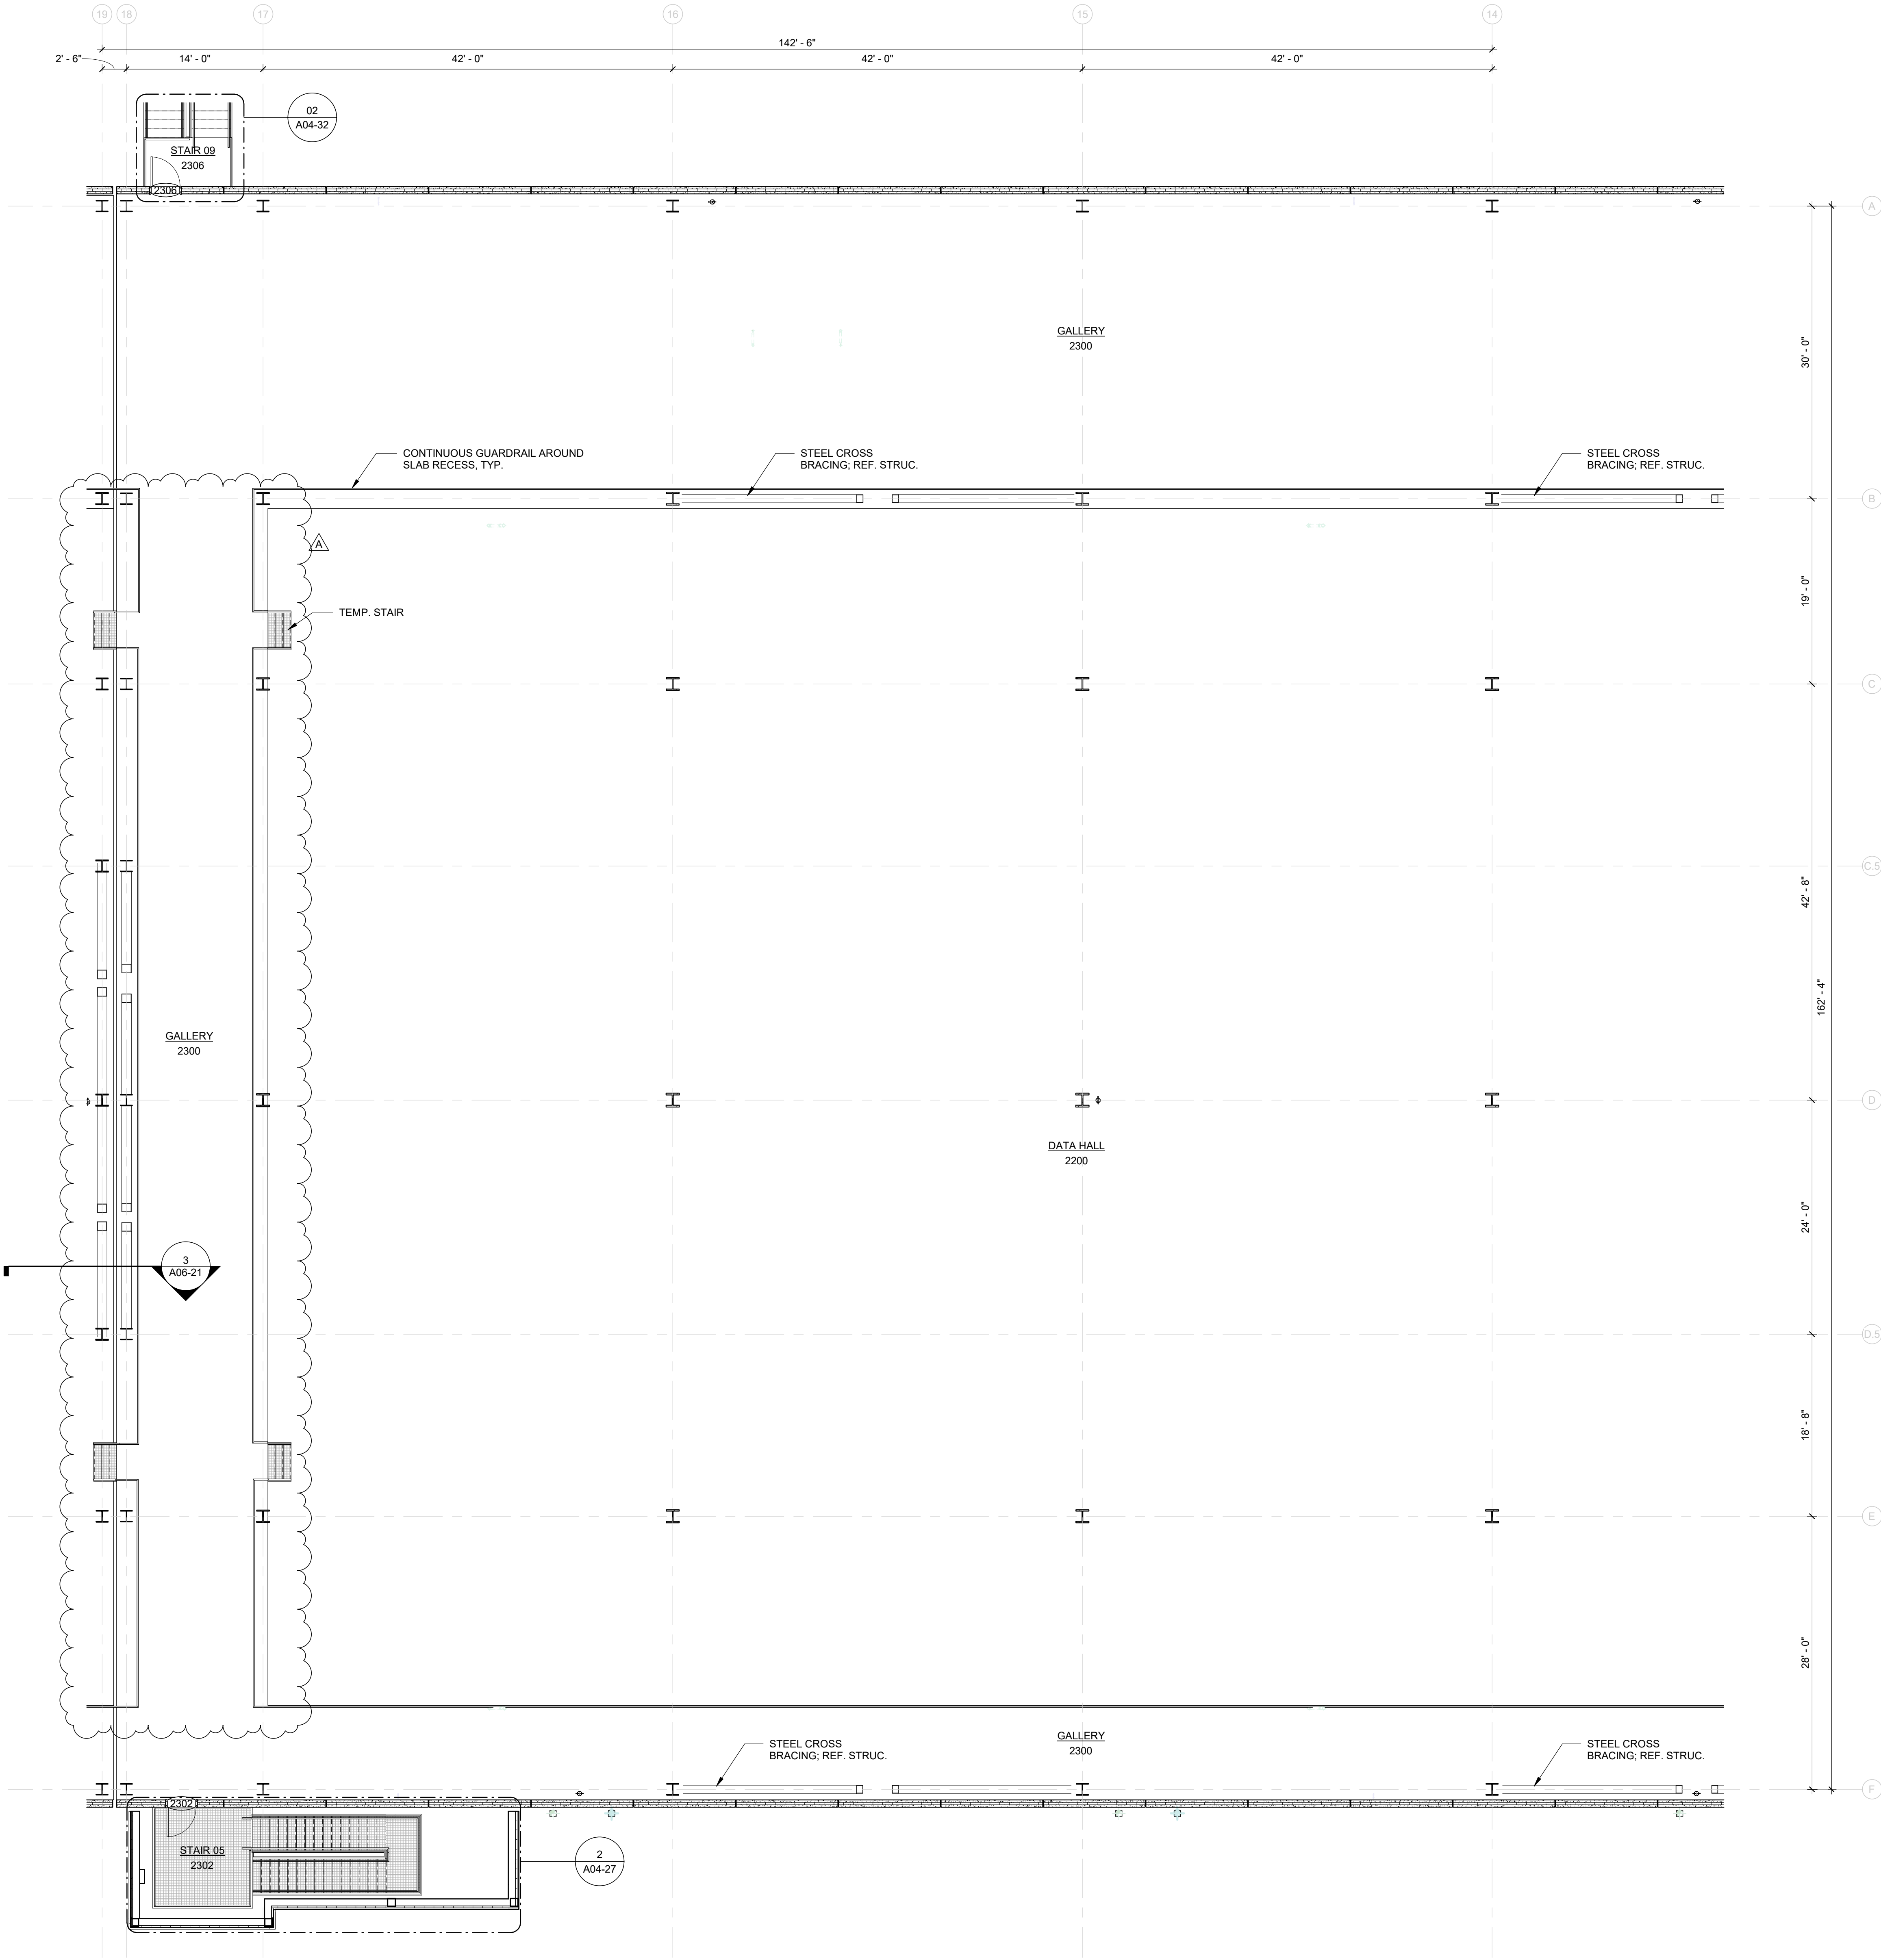

GENERAL PLAN NOTES

- G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
- G.C. TO PROVIDE CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
- "MIN." FOR DIMENSIONS INDICATES MINIMUM. ACCEPTABLE DIMENSION, MOST "MIN." DIMENSIONS WILL BE GREATER. IF "MIN." DIMENSION FALLS SHORT OF WHAT IS SHOWN ON DRAWING, G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
- PROVIDE CONTROL JOINTS IN GYPSUM BOARD WALLS ABOVE THE CORNER OF ALL INTERIOR DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 30'-0" IN LENGTH OR GREATER OR AS INDICATED ON INTERIOR ELEVATIONS. PROVIDE HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING, TYP.
- G.C. SHALL PROVIDE ALL NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HIS/HER WORK.
- ALL PENETRATIONS IN FIRE RATED PARTITION SHALL BE SEALED WITH FIRE RATED CAULK.
- DATA HALL AND CRAH GALLERY PERIMETER WALLS TO BE PROVIDED WITH INSULATION AND VAPOR BARRIER AND CONTAINMENT.
- ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 45" MAX. TO EXTINGUISHER HANDLE U.N.O.
- PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL EXTERIOR WINDOWS (EXCEPT CLERESTORY WINDOWS).
- ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
- PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXPOSED GYP. BOARD CORNERS MOUNTED AT 4" A.F.F. TO BOTTOM REF. SPECS.
- PROVIDE CONTINUOUS AIR BARRIER AND INSULATION AT EXTERIOR BLDG ENVELOPE TO COMPLY WITH CURRENT ENERGY CODE.
- FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING PURPOSE ONLY U.N.O.
- ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
- PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
- ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE ON DRAWINGS.
- ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
- DO NOT SCALE THESE DRAWINGS, DIMENSIONS GOVERN.
- PROVIDE ALL NECESSARY FIRE RETARDANT WOOD FRAMING, BRACING, BLOCKING, NAILERS, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES, MISCELLANEOUS FIXTURES AND FITTINGS.
- ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PAINTED TO MATCH THE WALL TO WHICH THEY ARE MOUNTED ON.
- PAINT COLUMNS, BEAMS, GIRDERS AND OTHER EXPOSED STRUCTURE NOT SHOWN AS FURRED OUT, TYP.
- ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE A6-F
- ALL GALVANIZED METALS SHALL BE HOT-DIPPED GALVANIZED

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000



ISSUES	
1	12.20.24 DESIGN DEVELOPMENT
2	01.31.25 ISSUE FOR PERMIT
3	05.30.25 FOUNDATIONS ONLY IFFP
4	
5	
6	
7	
8	
9	
10	
REVISIONS	
A	03.28.25 ADDENDUM 1



Date of issue:
03.28.25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD
QTS

KEYPLAN

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

FLOOR PLAN -
LEVEL TWO -
SEGMENT M

JOB 24464.0000
DATE 03.28.25
SHEET

A02-02M

1 FLOOR PLAN - LEVEL TWO - SEGMENT M
1/8" = 1'-0"

THIS SHEET IS FOR
REFERENCE ONLY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION



3/28/25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD

S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 03.28.25
SHEET

A02-02P



1. G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAME
2. PROVIDE CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
3. PROVIDE FORMED AND FINISHED CONCRETE ACCEPTABLE DIMENSION MOST "MIN" DIMENSIONS WILL BE GREATER IF "MIN" DIMENSIONS SHALL SHORTLY EXCEED MINIMUM DIMENSIONS. G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
4. PROVIDE CONTROL JOINTS IN GYPSUM BOARD TO MATCH THE CONTROL JOINTS IN THE CONCRETE WALLS 30" IN LENGTH IN THE CENTER OF STRAIGHT WALLS 30" IN LENGTH OR GREATER OR AS SPECIFIED BY THE ARCHITECT.
5. PROVIDE HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING. TYPE:
6. G.C. SHALL PROVIDE ALL NECESSARY MATERIALS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE FISHER WORK.
7. G.C. SHALL PROVIDE ALL NECESSARY MATERIALS TO BE SEALED WITH FIRE RATED CAULK.
8. DATA HALL AND CRAW HALLS PERIMETER WALLS TO BE FINISHED WITH 1/2" GYPSUM PARTITION BARRIER AND CONTAINMENT.
9. ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE PROVIDED WITH 1/2" GYPSUM EXTINGUISHER HANDLE U.N.O.
10. PROVIDE PLASTIC LAMINATE WINDOW SLIP INSIDE ALL CORNER WINDOWS (EXCEPT CERESTRY WINDOWS.)
11. ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
12. PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXPOSED GY. BOARD CORNERS MOUNTED AT 4" TO BOTTOM OF BOARD.
13. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION TO EXTERIOR WALLS TO EQUIVALENT TO COMPLY WITH CURRENT ENERGY CODE.
14. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING TO BE USED FOR SCHEDULING PURPOSES.
15. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
16. PROVIDE AND INSTALL PAPER TOWEL DISPENSER EACH SINK.
17. ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE SPECIFY.
18. ALL NOTES MARKED AS TYPE: APPLY TO SIMILAR CONDITIONS.
19. PROVIDE SCALE THESE DRAWINGS, DIMENSIONS GOVERN.
20. PROVIDE ALL NECESSARY FIRE RETARDANT WOODS AND FINISHES TO ALL PARTITIONS, SHIMS, REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES.
21. ALL ELECTRICAL AND TELEPHONE WORK SHALL BE DONE IN ACCORDANCE WITH THE FOLLOWING:
22. ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PROVIDED TO MATCH THE WAY TO WHICH THEY ARE MOUNTED ON.
23. ALL PAINT COULMS, BEAMS, GRIDDERS AND OTHER EXPOSED STRUCTURE NOT SHOWN AND TURNED OUT, TYPE:
24. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AG-FINISH.
25. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE HOT-DIPPED GALVANIZED.

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

1. G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. PROVIDE 1/2" THICK CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET BEFORE PAINTING OCCURS.
3. PROVIDE 1/2" FORMED DIMENSION MOST "MIN" DIMENSIONS WILL BE GREATER IF "MIN" DIMENSION FALLS SHORT OF MINIMUM DRAWING. G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
4. PROVIDE CONTROL JOINTS IN GYPSUM BOARD PARTITION WALLS TO BE LOCATED IN THE CENTER OF STRAIGHT WALLS 30'-0" IN LENGTH OR GREATER OR AS SPECIFIED BY ARCHITECT. PROVIDE 1/2" DEEP HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING. TYP.
5. PROVIDE ALL NECESSARY PARTITIONS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HIGHER WORK.
6. PENETRATIONS INTO NEW PARTITION SHALL BE SEALED WITH FIRE RATED CAULK.
7. DATA HALL AND CRAM GALLERY PERIMETER WALLS SHALL BE FINISHED WITH PARTITION BARRIER AND CONTAINMENT.
8. ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 4'-0" TO 6'-0" TO EXTINGUISHER HANDLE U.N.O.
9. PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL CORNER WINDOWS (EXCEPT CLERESTORY WINDOWS).
10. ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
11. PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXTERIOR GY. BOARD CORNERS MOUNTED AT 4'-0" A.F.F. TO BOTTOM OF GUARD.
12. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION AT ALL PERIMETERS TO DEVELOP TO COMPLY WITH CURRENT ENERGY CODE.
13. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING TO BE PROVIDED BY OTHERS.
14. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
15. PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
16. ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE SPECIFIED.
17. ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
18. PROVIDE SCALE THESE DRAGS, DIMENSIONS GOVERN.
19. PROVIDE ALL NECESSARY FIRE RETARDANT WOOD PRESERVATIVE TREATMENT TO ALL GRIDS, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES, ETC. ALL WOOD TO BE TREATED TO MEET ALL REQUIREMENTS.
20. ALL EXPOSED GRID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE MAINTAINED TO THE WALL TO WHICH THEY ARE MOUNTED ON.
21. PAINT COLUMNS, BEAMS, GRIDDERS AND OTHER EXPOSED STRUCTURE NOT SHOWING CURED OUT. TYP.
22. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AG-FINISH UNLESS OTHERWISE SHOWN. SHALL BE HOT-DIPPED GALVANIZED.
- 23.

1. G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. PROVIDE 1/2" THICK CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BD. AND FRAMES MEET AFTER PAINTING OCCURS.
3. PROVIDE 1/2" FORMER DIMENSION MOST "MIN" DIMENSIONS WILL BE GREATER IF "MIN" DIMENSION FALLS SHORT OF MINIMUM DRAWING. G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
4. PROVIDE CONTROL JOINTS IN GYPSUM BOARD PARTITION WALLS TO BE LOCATED IN THE CENTER OF STRAIGHT WALLS 30'-0" IN LENGTH OR GREATER OR AS SPECIFIED BY ARCHITECT. PROVIDE 1/2" DEEP HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING. TYP.
5. PROVIDE ALL NECESSARY PARTITIONS, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HIGHER WORK.
6. PENETRATIONS INTO NEW PARTITION SHALL BE SEALED WITH FIRE RATED CAULK.
7. DATA HALL AND CRAM GALLERY PERIMETER SHALL BE PROTECTED BY 1/2" THICK PARTITION BARRIER AND CONTAINMENT.
8. ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 4'-0" TO 6'-0" TO EXTINGUISHER HANDLE U.N.O.
9. PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL CORNER WINDOWS (EXCEPT CLERESTORY WINDOWS).
10. ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF CORNERS, UNLESS NOTED OTHERWISE.
11. PROVIDE 4'-0" HIGH CORNER GUARDS AT ALL EXTERIOR CORNERS. BOARD CORNERS MOUNTED AT 4'-0" A.F.F. TO BOTTOM OF CORNER GUARD.
12. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION AT ALL PERIMETERS TO DEVELOP TO COMPLY WITH CURRENT ENERGY CODE.
13. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING TO BE PROVIDED BY OTHERS.
14. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
15. PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
16. ALL GENERAL NOTES APPLY UNLESS NOTES OTHERWISE INDICATED.
17. ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
18. PROVIDE SCALE THESE DRAWINGS, DIMENSIONS GOVERN.
19. PROVIDE ALL NECESSARY FIRE RETARDANT WOOD PRESERVATIVE TREATMENT TO ALL GRIDS, SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES, ETC. ALL WOOD TO BE TREATED TO MEET ALL REQUIREMENTS.
20. ALL EXPOSED GRID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE MAINTAINED TO THE WALL TO WHICH THEY ARE MOUNTED ON.
21. PAINT COLUMNS, BEAMS, GRIDDERS AND OTHER EXPOSED STRUCTURE NOT SHOWING COVERED OUT. TYP.
22. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE AG-FINISH UNLESS OTHERWISE SHOWN. SHALL BE HOT-DIPPED GALVANIZED.
- 23.

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

1 FLOOR PLAN - LEVEL TWO - SEGMENT R
1/8" = 1'-0"



1. G.C. TO PROVIDE DOUBLE STUDS BACK TO BACK ON BOTH SIDES OF NEW DOOR FRAMES
2. G.C. TO PROVIDE CONTINUOUS SILICONE CAULK AT ALL NEW DOOR FRAMES WHERE GYP. BO. AND FRAMES MEET BEFORE PAINTING OCCURS
3. G.C. TO DIMENSION ALL DOOR AND WINDOW FRAMES TO ACCEPTABLE DIMENSION. MOST "MIN." DIMENSIONS WILL BE GREATER. IF "MIN." DIMENSIONS SHALT SHORT OF WHAT IS SHOWN ON DRAWING, G.C. IS TO NOTIFY ARCHITECT IMMEDIATELY.
4. PROVIDE CONTROL JOINTS IN GYPSUM BOARD: 1) 4'-0" MAX. SPACING OF CONTROL JOINTS AT DOOR AND WINDOW FRAMES IN THE CENTER OF STRAIGHT WALLS 3'-0" IN LENGTH OR GREATER OR AS NOTED IN THE INTERIOR FINISH SCHEDULE. 2) PROVIDE HORIZONTAL CONTROL JOINTS AT 10'-0" A.F.F. THROUGHOUT BUILDING. TYP.
5. PROVIDE ALL NECESSARY MATERIALS AND SUPPLIES, FITTINGS, BLOCKING, ETC. AS REQUIRED TO SATISFACTORY COMPLETE HISHER WORK.
6. ALL PENETRATIONS THROUGH EXTERIOR WALLS SHALL BE SEALED WITH FIRE RATED CAULK.
7. DATA HALL AND GRAH GALLERY PERIMETER WALLS SHALL BE FINISHED WITH 1/2" MIN. THICK GYPSUM BOARD BARRIER AND CONTAINMENT.
8. ALL WALL-MOUNTED FIRE EXTINGUISHERS TO BE MOUNTED AT 4'-0" MAX. HEIGHT, EASIER HANDLE U.N.O.
9. PROVIDE PLASTIC LAMINATE WINDOW SILL INSIDE ALL EXTERIOR WINDOWS (EXCEPT CELESTORY WINDOWS)
10. ALL DOORS TO BE LOCATED 6" FROM INSIDE FACE OF CORNER, UNLESS NOTED OTHERWISE.
11. PROVIDE 4"-Ø HIGH CORNER GUARDS AT ALL EXPOSED GYP. BOARD CORNERS MOUNTED AT 4" FROM BOTTOM RAIL.
12. PROVIDE CONTINUOUS AIR BARRIER AND INSULATION THROUGH BLDG. EXTERIOR TO COMPLY WITH CURRENT ENERGY CODE.
13. FURNITURE (C.F.C.I.) SHOWN FOR SPACE PLANNING TO BE INSTALLED BY OTHERS.
14. ALL WORK SHALL CONFORM TO ALL APPLICABLE CODES, ORDINANCES, AND STATUTES.
15. PROVIDE AND INSTALL PAPER TOWEL DISPENSER @ EACH SINK.
16. ALL GENERAL NOTES APPLY UNLESS NOTES SPECIFIC TO THIS SECTION.
17. ALL NOTES MARKED AS TYP. APPLY TO SIMILAR CONDITIONS.
18. PROVIDE THESE DRAWINGS, DIMENSIONS GOVERN.
19. PROVIDE ALL NECESSARY FIRE RETARDANT WORK FRAMING BRACING, AND FASTENING. FIRE RATING SHIMS REQUIRED TO INSTALL ALL DOOR AND WINDOW FRAME, MEP WORK, MILLWORK, ACCESSORIES.
20. ALL EXPOSED RIGID FOAM INSULATION TO BE PROTECTED BY A NON-FLAMMABLE FINISH.
21. ALL EXPOSED RIGID CONDUITS FOR LIGHT FIXTURES, SECURITY OF LIGHTING PROTECTION SHALL BE PAINTED TO MATCH THE WALL TO WHICH THEY ARE MOUNTED ON.
22. PAINT COLUMNS, BEAMS, GIRDERS AND OTHER EXPOSED STRUCTURE NOT SHOWN AS FURRED OUT, TYP.
23. ALL PARTITIONS NOT TAGGED IN PLAN SHALL BE A6-F. 24. ALL EXPOSED METAL SHALL BE HOT-DIPPED GALVANIZED.

00407039

3/28/25

QTS DEN1 DC2
1140 N. GUN CLUB ROAD



S	Q	N	L	J	G	E	C	A
T	R	P	M	K	H	F	D	B

JOB 24464.0000
DATE 03.28.25
SHEET

A02-02ST

FOUNDATION ONLY PERMITTED
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

2/4/2025 10:13:28 PM A05-01 OVERALL EXTERIOR ELEVATIONS

Permit #25-2535171
RSN 1903242

CORGAN

401 N. Houston Street Dallas, TX
75202
T: 214.748.2000

AG-E

SYSKA HENNESSY
GROUP

TD
DESIGN CONSULTING LLC

ISSUES

1	12.20.24	DESIGN DEVELOPMENT
2	01.31.25	ISSUE FOR PERMIT
3	05.30.25	FOUNDATIONS ONLY IFP

REVISIONS

4		
5		
6		
7		
8		
9		
10		



QTS DEN1 DC2


1140 N. GUN CLUB ROAD




OVERALL
EXTERIOR
ELEVATIONS

JOB 24464.0000
DATE 01.31.25
SHEET


A05-01

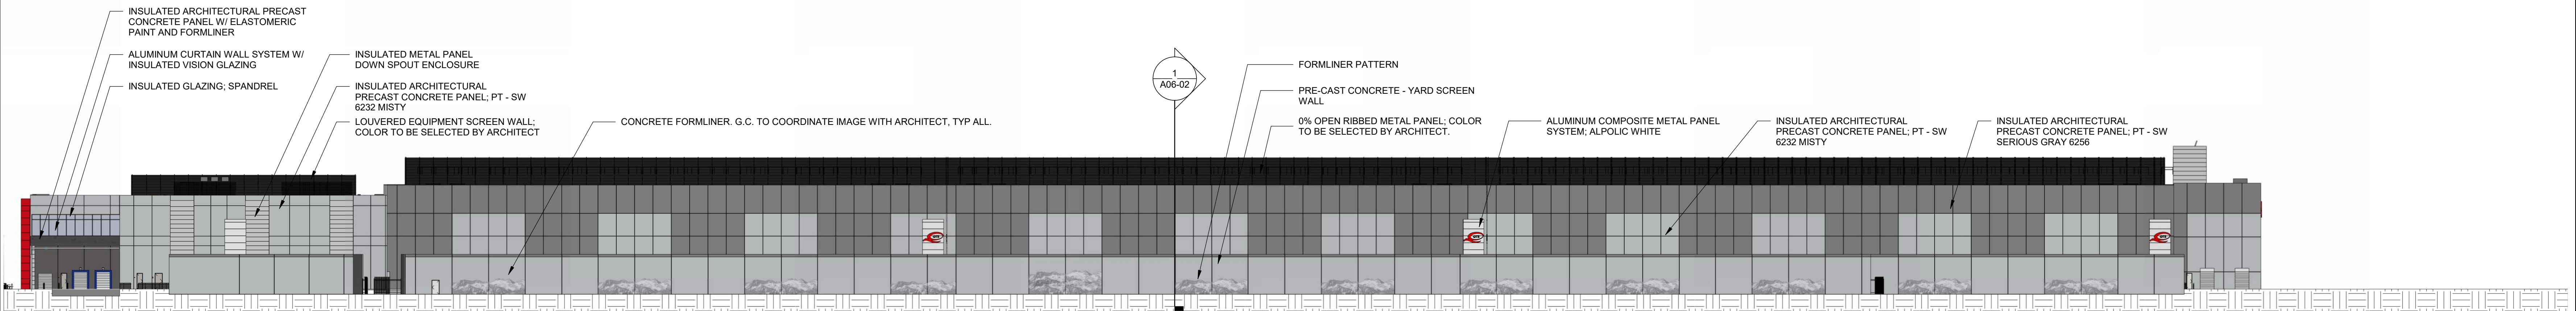


4 EXTERIOR ELEVATION @ NORTH
1" = 40'-0"

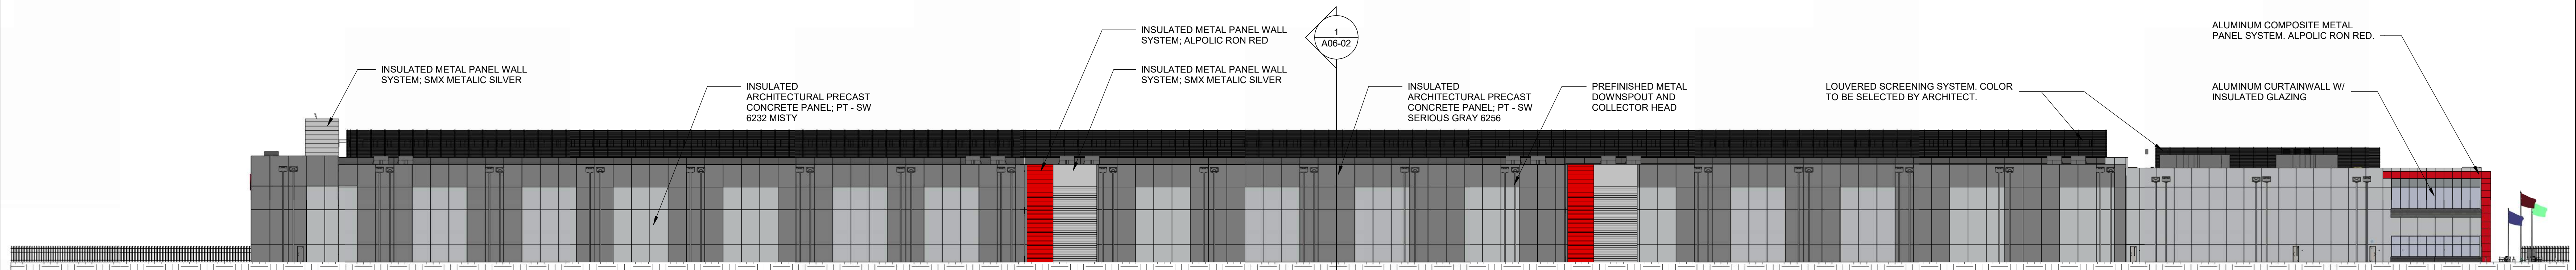

3 EXTERIOR ELEVATION @ SOUTH
1" = 40'-0"

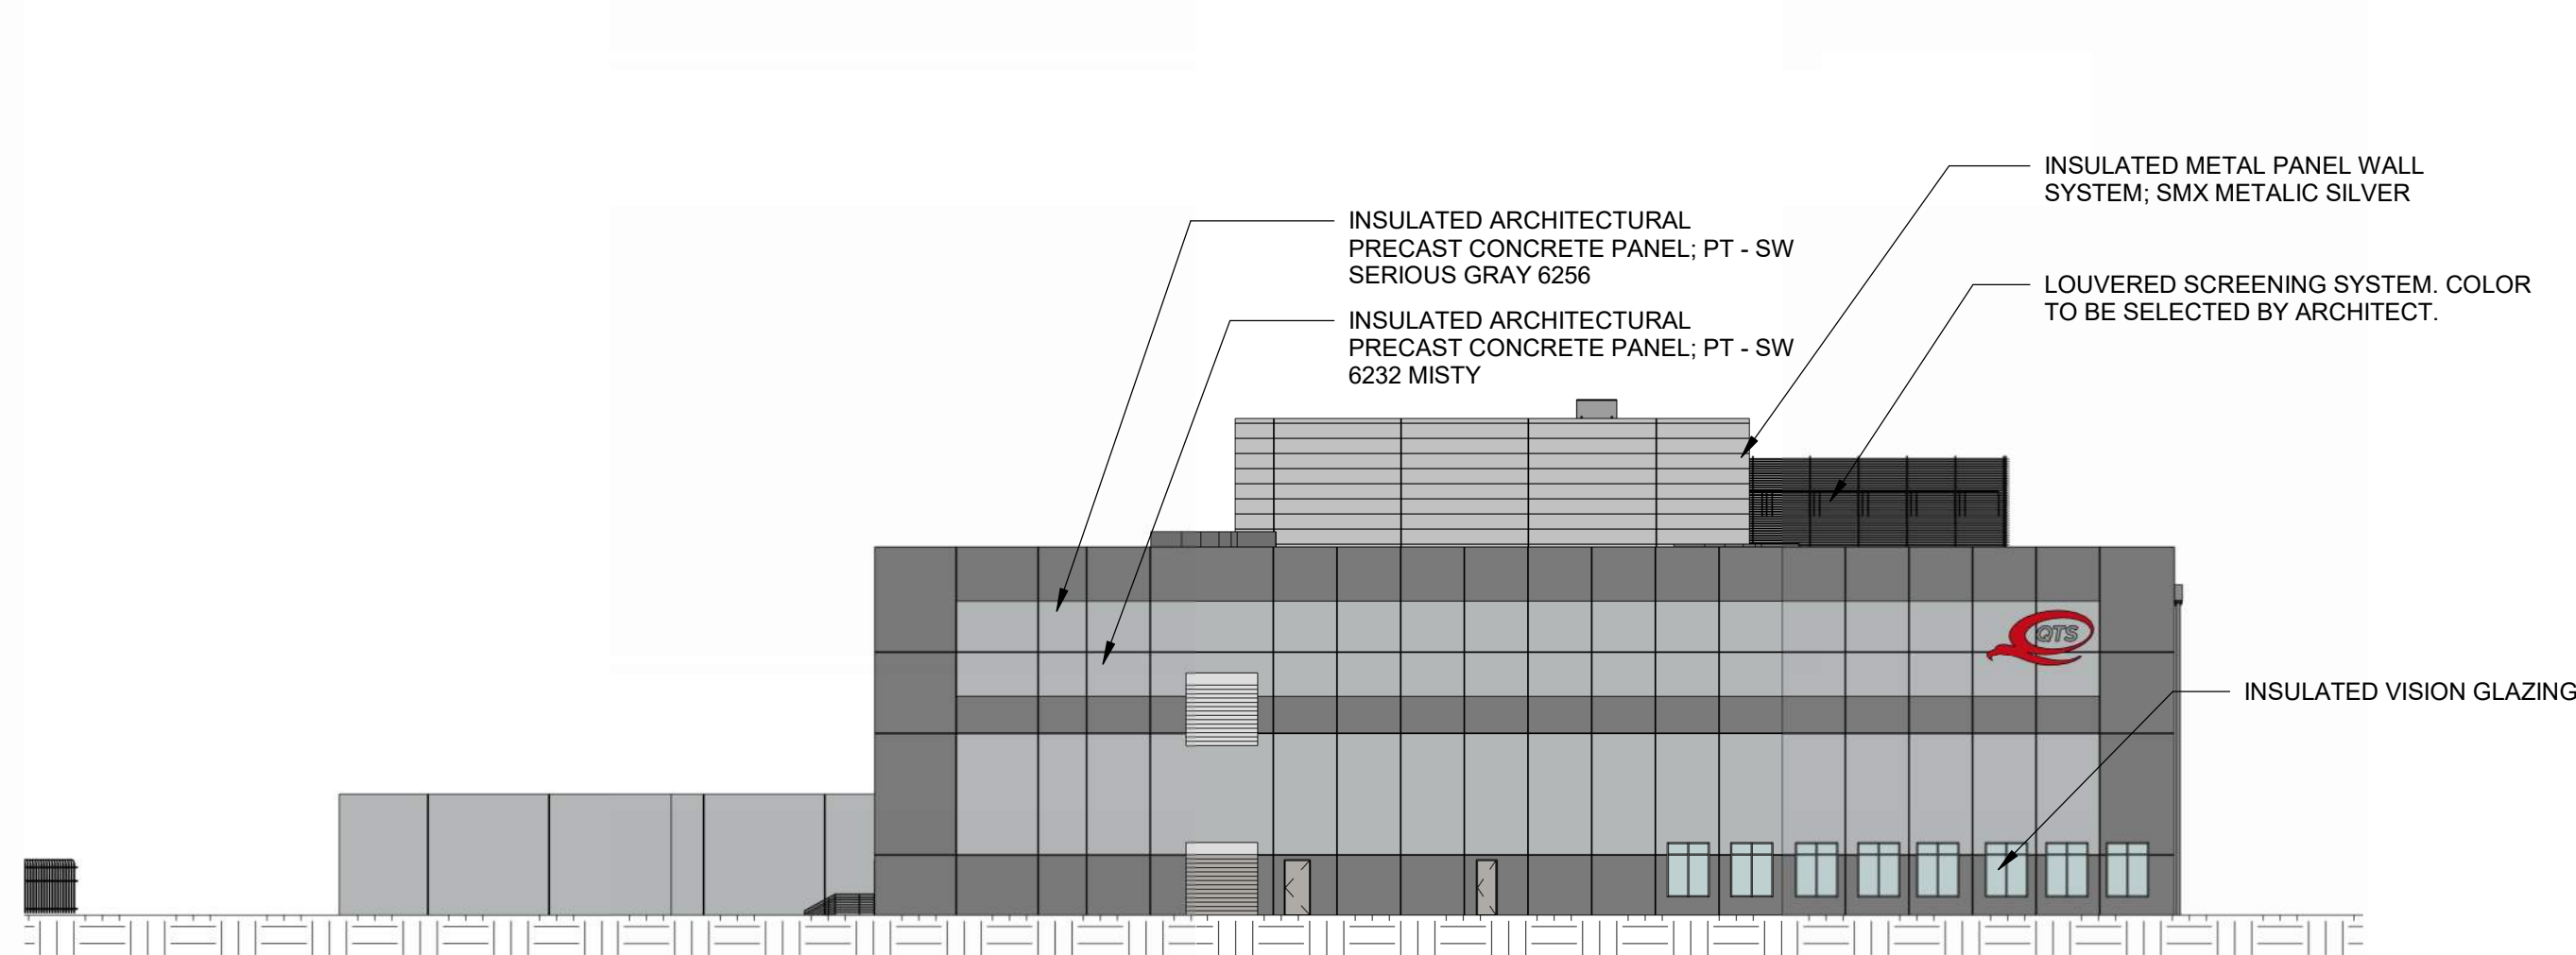

2 EXTERIOR ELEVATION @ EAST
1" = 30'-0"

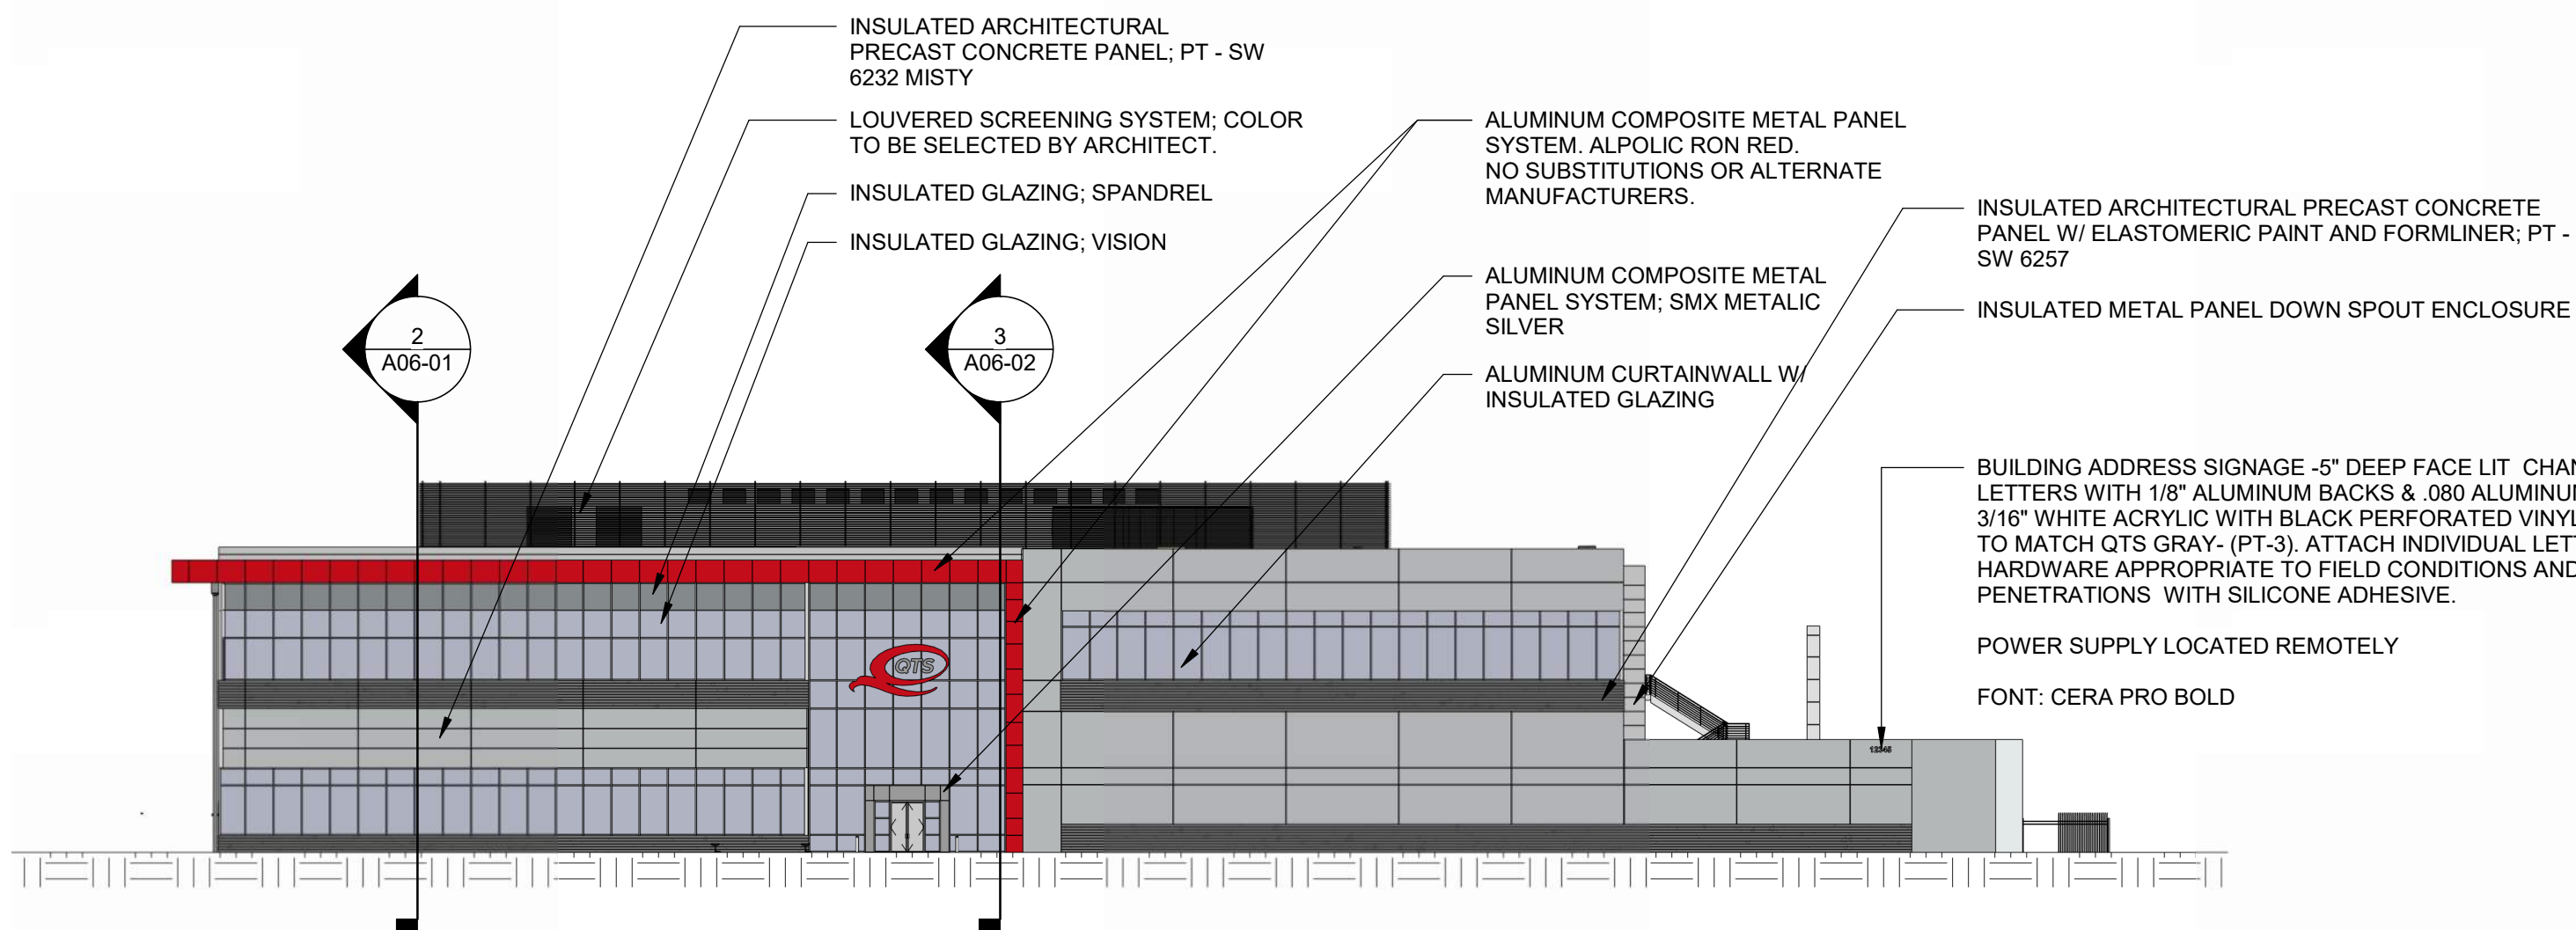

1 EXTERIOR ELEVATION @ WEST
1" = 30'-0"

THIS SHEET IS FOR
REFERENCE ONLY

FOUNDATION ONLY PERMIT
- NOT APPROVED FOR
VERTICAL CONSTRUCTION

DOOR SCHEDULE													
DOOR NUMBER	ROOM		DOOR		DOOR			FRAME			HARDWARE SET		
	FROM ROOM	TO ROOM	WIDTH	HEIGHT	FireRating	PANEL TYPE	MATERIAL	FINISH	FRAME TYPE	MATERIAL		FINISH	
LEVEL 1													
100	VEST	VEST	6'-0"	8'-11 1/2"	-		AL	PT-2		AL	PT-3	714AD	
101	VEST	LOBBY	3'-0"	8'-11 1/2"	-		AL	PT-2		AL	PT-3	CY710AC	
102	FREEDOM CAFE	BREAK	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	403T	
105A	CORRIDOR	BREAK	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	401	
105B	BREAK	LARGE CONFERENCE	3'-0"	9'-0"	-	A : A 3	WD	Walnut	16 : 1	HM	PT-3	403T	
106	CORRIDOR	WELL	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	341	
109A	TENANT OFFICE	CORRIDOR	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	C701CR	
110B	CORRIDOR		3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	D725	
111	ELEV ROOM	CORRIDOR	3'-0"	9'-0"	60 MIN	A : A 3	HM	PT-3	16 : 1	HM	PT-3	C201	
113	WRR	CORRIDOR	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	801	
114	CORRIDOR	MRR	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	801	
115	FITNESS CENTER	SHOWER	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	341	
116	RR	FITNESS CENTER	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	C201	
117	STORAGE	CORRIDOR	6'-0"	9'-0"	60 MIN	AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C200E	
118	STORAGE	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	WD	Walnut	16 : 1	HM	Black	C200E	
119A	CORRIDOR	STAIR 02	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	C741	
119B	CORRIDOR	STAIR 02	3'-0"	9'-0"	60 MIN	B : B 2	HM	PT-3	16 : 1	HM	PT-3	C741	
119C	STAIR 02		3'-0"	9'-0"		B : B 2	HM	PT-3	16 : 1	HM	PT-3	D725	
120	CORRIDOR	JAN	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	201	
132	SECURITY OFFICE	SEC. MANAGER	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	103	
133	SECURITY OFFICE	SDF	3'-6"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	C201W	
134B	SECURITY OFFICE	CORRIDOR	3'-0"	9'-0"		A	AL	<By Category>	31 : 3	HM	PT-3	C2201	
135	SECURITY OFFICE	ARMORY	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	Black	C201	
150A	RR	DOCK	3'-0"	9'-0"		A1 : A	HM	PT-3	16 : 1	HM	PT-3	341	
150B	DOCK	CORRIDOR	3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	CZ207T	
150C	DOCK	CORRIDOR	8'-0"	9'-0"		G1 : G 3	HM	PT-3	No Frame : No Frame 3	AL	PT-3	C001	
150D		DOCK	3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	CY715T	
150E	DOCK		8'-0"	10'-0"		OH-ROLL 1 : OH-ROLL 2	HM	PT-3	No Frame : No Frame 4	HM	PT-3	C001	
150F	DOCK		8'-0"	14'-0"		OH-ROLL 1 : OH-ROLL 2	HM	PT-3	No Frame : No Frame 4	AL	PT-3	C001	
151	DOCK	SECURITY OFFICE	3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	C201	
152	DOCK STORAGE	DOCK	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C200E	
153A	TRASH	DOCK	3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	401	
153B	TRASH	DOCK	8'-0"	9'-0"		G1 : G 4	HM	PT-3	No Frame : No Frame 4	AL	PT-3	001	
153C	TRASH		8'-0"	9'-0"		OH-ROLL 1 : OH-ROLL 2	HM	PT-3	No Frame : No Frame 4	AL	PT-3	001	
154	ELEV ROOM	DOCK	3'-0"	9'-0"		B : B 2	HM	PT-3	16 : 1	HM	PT-3	C201	
161A	STORAGE	CORRIDOR	3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	201	
161B	STORAGE	CORRIDOR	8'-0"	9'-0"		G1 : G 3	HM	PT-3	No Frame : No Frame 3	AL	PT-3	C001	
161C	CORRIDOR	STORAGE	8'-0"	9'-0"		G1 : G 3	HM	PT-3	No Frame : No Frame 3	AL	PT-3	C001	
161D	STORAGE	CORRIDOR	3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	C201	
162	STORAGE	CORRIDOR	3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	C201	
163A	CORRIDOR	STAIR 01	3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	731	
163B	STAIR 01		3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	D725	
164A	CORRIDOR	RISER	3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	CZ201A	
164B	RISER		4'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	C205C	
165A	TENANT STORAGE	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C200E	
165B	TENANT STORAGE	ELEC ROOM	3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	C701CR	
166A	ELEC ROOM	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C700CER	
166B	ELEC ROOM		3'-6"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	D725	
180A	FLEX	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C700CER	
180B	FLEX	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C700CER	
181	CORRIDOR	STAIR 11	3'-0"	9'-0"		A : A 3	HM	PT-3	16 : 1	HM	PT-3	D741E	
190A	FLEX	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C700CER	
190B	FLEX	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C700CER	
192	DCIM	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C200E	
193	MMR1A	CORRIDOR	6'-0"	9'-0"		AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C700CER	
195A	CORRIDOR	STAIR 03	3'-0"	9'-0"		B : B 2	HM	PT-3	16 : 1	HM	PT-3	D741E	
195B	STAIR 03		3'-0"	9'-0"		B : B 2	HM	PT-3	16 : 1	HM	PT-3	D725	
196A	CORRIDOR	STORAGE	6'-0"	9'-0"	60 MIN	AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C200E	
196B	STORAGE	CORRIDOR	3'-0"	9'-0"	60 MIN	A : A 3	HM	PT-3	16 : 1	HM	PT-3	C201	
1301	CORRIDOR		12'-0"	12'-0"		G1 : G	HM	PT-3	No Frame1 : No Frame	HM	PT-3	C001	
1301A	CORRIDOR	STAIR 04	3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D741ET	
1301B	STAIR 04		3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D725	
1302A	GALLERY	STAIR 05	3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D741ET	
1302B	STAIR 05		3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D725	
1303A	CORRIDOR	STAIR 06	3'-0"	9'-0"	60 MIN	B1 : B	HM	PT-3	16 : 1	HM	PT-3	D741ET	
1303B	STAIR 06		3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D725	
1305	CORRIDOR	STAIR 08	3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D741ET	
1306	STAIR 09	GALLERY	3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D721CT	
1307	CORRIDOR	STAIR 10	3'-0"	9'-0"		A	HM	PT-3	1 : 1 3	HM	PT-3	D741ET	
1400	CORRIDOR	MMR1B	6'-0"	9'-0"	45 MIN	AA1 : AA 2	HM	PT-3	16 : 1	HM	PT-3	C700CERT	
1401	MMR1B	EF	3'-0"	9'-0"	45 MIN	A	HM	PT-3	16 : 1	HM	PT-3	C201T	
1402A	CORRIDOR	HOUSE ELEC.	6'-0"	9'-0"	45 MIN	AA1 : AA 2	HM	PT-3	16 : 1	HM	PT-3	C700CERT	
1402B	HOUSE ELEC.		3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	D725	
1403A	CORRIDOR	ELI	6'-0"	9'-0"	45 MIN	AA1 : AA 2	HM	PT-3	16 : 1	HM	PT-3	C200ET	
1403B	HOUSE ELEC.	ELI	3'-0"	9'-0"	45 MIN	A	HM	PT-3	16 : 1	HM	PT-3	C201T	
1404	FREIGHT ELEV.	CORRIDOR	8'-0"	12'-0"		G1 : G	HM	PT-3	No Frame1 : No Frame	HM	PT-3	C001	
1405	IDF	CORRIDOR	3'-6"	9'-0"	90 MIN	A	HM	PT-3	16 : 1	HM	PT-3	C20TW	
1406	FIRE	CORRIDOR	4'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	C205TW	
1407	STORAGE	CORRIDOR	3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	C201T	
1408A	CORRIDOR		3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	CZ201TA	
1408B	CORRIDOR		8'-0"	12'-0"		G1 : G	HM	PT-3	No Frame1 : No Frame	HM	PT-3	C001	
1408C			8'-0"	12'-0"		G1 : G	HM	PT-3	No Frame1 : No Frame	HM	PT-3	C001	
1408D			8'-0"	12'-0"		G1 : G	HM	PT-3	No Frame1 : No Frame	HM	PT-3	C001	
1409		RR	3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	341TG	
1410	ELEV. ROOM		4'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	C201CTW	
1500A	CORRIDOR	FACILITIES OFFICE	3'-0"	9'-0"		A	HM	PT-3	31 : 3	HM	PT-3	C701CRT	
1500B	FACILITIES OFFICE		9'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	C701CRT	
1501	CORRIDOR	RR	3'-0"	9'-0"		A	HM	PT-3	16 : 1	HM	PT-3	341T	
1502	FACILITIES OFFICE	RR	3'-0"	9'-0"		A	WD	Walnut	16 : 1	HM	Black	801T	
1502A	RR		3'-0"	9'-0"		A	WD	Walnut	16 : 1	HM	Black	342T	
1502B	RR		2'-6"	9'-0"		A	WD	Walnut	16 : 1	HM	Black	342	
1502C	RR		2'-6"	9'-0"		A	WD	Walnut	16 : 1	HM	Black	342	
1502D	RR		3'-0"	9'-0"		A	WD	Walnut	16 : 1	HM	Black	342T	
1502E	RR		3'-0"	9'-0"		A	WD	Walnut	16 : 1	HM	Black	342T	
1503	BREAK ROOM	FACILITIES OFFICE	3'-0"	9'-0"		A	AL	PT-3	31 : 3	HM	PT-3	103A	
1504	FACILITIES OFFICE	OFFICE	3'-0"	9'-0"		A	AL	PT-3	31 : 3	HM	PT-3	103A	
1505	FACILITIES OFFICE	OFFICE	3'-0"	9'-0"		A	AL	PT-3	31 : 3	HM	PT-3	103A	
1506	OFFICE	FACILITIES OFFICE	3'-0"	9'-0"		A	AL	PT-3	31 : 3	HM	PT-3	103A	
1507	FACILITIES OFFICE	OFFICE	3'-0"	9'-0"		A	AL	PT-3	31 : 3	HM	PT-3	103A	
SG01			3'-0"	9'-0"		A	AL	PT-3	16 : 1	HM	PT-3		
LEVEL 2													
209A	DATA HALL	DATA HALL	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	PT-3	C701CR	
209B	TENANT FLEX		3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	PT-3	C701CR	
213	WRR	DATA HALL	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	PT-3	801	
214	DATA HALL	MRR	3'-0"	9'-0"		A : A 3	WD	Walnut	16 : 1	HM	PT-3	801	
217	STORAGE	DATA HALL	6'-0"	9'-0"	60 MIN	AA1 : AA 1	HM	PT-3	16 : 1	HM	PT-3	C200E	
218	STORAGE	DATA HALL	6'-0"	9'-0"	45 MIN	AA1 : AA 1	WD	Walnut	16 : 1	HM	PT-3	C200E	
219A	DATA HALL												